



# ASME A112.18.2-2020/ CSA B125.2:20

National Standard of Canada  
American National Standard



## Plumbing waste fittings

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020



Standards Council of Canada  
Conseil canadien des normes

# ***Legal Notice for Harmonized Standard Jointly Developed by ASME and CSA Group***

## **Intellectual property rights and ownership**

As between American Society of Mechanical Engineers (“ASME”) and Canadian Standards Association (Operating as “CSA Group”) (collectively “ASME and CSA Group”) and the users of this document (whether it be in printed or electronic form), ASME and CSA Group are the joint owners of all works contained herein that are protected by copyright, all trade-marks (except as otherwise noted to the contrary), and all inventions and trade secrets that may be contained in this document, whether or not such inventions and trade secrets are protected by patents and applications for patents. The unauthorized use, modification, copying, or disclosure of this document may violate laws that protect the intellectual property of ASME and CSA Group and may give rise to a right in ASME and CSA Group to seek legal redress for such use, modification, copying, or disclosure. ASME and CSA Group reserve all intellectual property rights in this document.

## **Disclaimer and exclusion of liability**

This document is provided without any representations, warranties, or conditions of any kind, express or implied, including, without limitation, implied warranties or conditions concerning this document’s fitness for a particular purpose or use, its merchantability, or its non-infringement of any third party’s intellectual property rights. ASME and CSA Group do not warrant the accuracy, completeness, or currency of any of the information published in this document. ASME and CSA Group make no representations or warranties regarding this document’s compliance with any applicable statute, rule, or regulation.

IN NO EVENT SHALL ASME AND CSA GROUP, THEIR RESPECTIVE VOLUNTEERS, MEMBERS, SUBSIDIARIES, OR AFFILIATED COMPANIES, OR THEIR EMPLOYEES, DIRECTORS, OR OFFICERS, BE LIABLE FOR ANY DIRECT, INDIRECT, OR INCIDENTAL DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES, HOWSOEVER CAUSED, INCLUDING BUT NOT LIMITED TO SPECIAL OR CONSEQUENTIAL DAMAGES, LOST REVENUE, BUSINESS INTERRUPTION, LOST OR DAMAGED DATA, OR ANY OTHER COMMERCIAL OR ECONOMIC LOSS, WHETHER BASED IN CONTRACT, TORT (INCLUDING NEGLIGENCE), OR ANY OTHER THEORY OF LIABILITY, ARISING OUT OF OR RESULTING FROM ACCESS TO OR POSSESSION OR USE OF THIS DOCUMENT, EVEN IF ASME OR CSA GROUP HAVE BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES, INJURY, LOSS, COSTS, OR EXPENSES.

In publishing and making this document available, ASME and CSA Group are not undertaking to render professional or other services for or on behalf of any person or entity or to perform any duty owed by any person or entity to another person or entity. The information in this document is directed to those who have the appropriate degree of experience to use and apply its contents, and ASME and CSA Group accept no responsibility whatsoever arising in any way from any and all use of or reliance on the information contained in this document.

ASME and CSA Group have no power, nor do they undertake, to enforce compliance with the contents of the standards or other documents they jointly publish.

## **Authorized use of this document**

This document is being provided by ASME and CSA Group for informational and non-commercial use only. The user of this document is authorized to do only the following:

If this document is in electronic form:

- load this document onto a computer for the sole purpose of reviewing it;
- search and browse this document; and
- print this document if it is in PDF format.

Limited copies of this document in print or paper form may be distributed only to persons who are authorized by ASME and CSA Group to have such copies, and only if this Legal Notice appears on each such copy.

In addition, users may not and may not permit others to

- alter this document in any way or remove this Legal Notice from the attached standard;
- sell this document without authorization from ASME and CSA Group; or
- make an electronic copy of this document.

If you do not agree with any of the terms and conditions contained in this Legal Notice, you may not load or use this document or make any copies of the contents hereof, and if you do make such copies, you are required to destroy them immediately. Use of this document constitutes your acceptance of the terms and conditions of this Legal Notice.



# ***Standards Update Service***

## ***ASME A112.18.2-2020/CSA B125.2:20 June 2020***

**Title:** *Plumbing waste fittings*

To register for e-mail notification about any updates to this publication

- go to [store.csagroup.org](https://store.csagroup.org)
- click on **Product Updates**

The **List ID** that you will need to register for updates to this publication is **2427758**.

If you require assistance, please e-mail [techsupport@csagroup.org](mailto:techsupport@csagroup.org) or call 416-747-2233.

Visit CSA Group's policy on privacy at [www.csagroup.org/legal](https://www.csagroup.org/legal) to find out how we protect your personal information.

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020

**Canadian Standards Association (operating as “CSA Group”)**, under whose auspices this National Standard has been produced, was chartered in 1919 and accredited by the Standards Council of Canada to the National Standards system in 1973. It is a not-for-profit, nonstatutory, voluntary membership association engaged in standards development and certification activities.

CSA Group standards reflect a national consensus of producers and users — including manufacturers, consumers, retailers, unions and professional organizations, and governmental agencies. The standards are used widely by industry and commerce and often adopted by municipal, provincial, and federal governments in their regulations, particularly in the fields of health, safety, building and construction, and the environment.

Individuals, companies, and associations across Canada indicate their support for CSA Group’s standards development by volunteering their time and skills to Committee work and supporting CSA Group’s objectives through sustaining memberships. The more than 7000 committee volunteers and the 2000 sustaining memberships together form CSA Group’s total membership from which its Directors are chosen. Sustaining memberships represent a major source of income for CSA Group’s standards development activities.

CSA Group offers certification and testing services in support of and as an extension to its standards development activities. To ensure the integrity of its certification process, CSA Group regularly and continually audits and inspects products that bear the CSA Group Mark.

In addition to its head office and laboratory complex in Toronto, CSA Group has regional branch offices in major centres across Canada and inspection and testing agencies in eight countries. Since 1919, CSA Group has developed the necessary expertise to meet its corporate mission: CSA Group is an independent service organization whose mission is to provide an open and effective forum for activities facilitating the exchange of goods and services through the use of standards, certification and related services to meet national and international needs.

For further information on CSA Group services, write to  
CSA Group  
178 Rexdale Boulevard  
Toronto, Ontario, M9W 1R3  
Canada



A National Standard of Canada is a standard developed by a Standards Council of Canada (SCC) accredited Standards Development Organization, in compliance with requirements and guidance set out by SCC. More information on National Standards of Canada can be found at [www.scc.ca](http://www.scc.ca).

SCC is a Crown corporation within the portfolio of Innovation, Science and Economic Development (ISED) Canada. With the goal of enhancing Canada's economic competitiveness and social well-being, SCC leads and facilitates the development and use of national and international standards. SCC also coordinates Canadian participation in standards development, and identifies strategies to advance Canadian standardization efforts.

Accreditation services are provided by SCC to various customers, including product certifiers, testing laboratories, and standards development organizations. A list of SCC programs and accredited bodies is publicly available at [www.scc.ca](http://www.scc.ca).

Standards Council of Canada  
600-55 Metcalfe Street  
Ottawa, Ontario, K1P 6L5  
Canada



**Standards Council of Canada**  
**Conseil canadien des normes**

Cette Norme Nationale du Canada n'est disponible qu'en anglais.

*Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users to judge its suitability for their particular purpose.*

*\*A trademark of the Canadian Standards Association, operating as “CSA Group”*

Click to view the full PDF of ASME A112.18.2 CSA 25.2 2020

# *ASME/CSA Standard*

## *ASME A112.18.2-2020/CSA B125.2:20 Plumbing waste fittings*



®A trademark of the Canadian Standards Association and CSA America Inc., operating as "CSA Group"

*Published in June 2020 by CSA Group  
A not-for-profit private sector organization  
178 Rexdale Boulevard, Toronto, Ontario, Canada M9W 1R3  
1-800-463-6727 • 416-747-4044*

**Visit the CSA Group Online Store at [store.csagroup.org](https://store.csagroup.org)**

*The American Society of Mechanical Engineers (ASME)  
Two Park Avenue  
New York, NY 10016-5990, USA  
1-800-843-2763*

**Visit the ASME Online Store at [www.asme.org](https://www.asme.org)**

## Commitment for Amendments

This Standard is issued jointly by the American Society of Mechanical Engineers (ASME) and the Canadian Standards Association (Operating as “CSA Group”). Amendments to this Standard will be made only after processing according to the Standards writing procedures of both ASME and CSA Group.

The American Society of Mechanical Engineers (ASME)  
Two Park Avenue  
New York, NY 10016-5990  
USA  
1-800-843-2763  
Visit the ASME Online Store at  
[www.asme.org](http://www.asme.org)

ISBN 978-0-7918-7367-0  
Copyright © 2020 by The American Society of Mechanical Engineers (ASME)

This Standard is available for public review on a continuous basis. This provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public at large.

Published in April 2020 by  
CSA Group  
A not-for-profit private sector organization  
178 Rexdale Boulevard  
Toronto, Ontario, Canada  
M9W 1R3  
1-800-463-6727 or 416-747-4044  
Visit the CSA Group Online Store at  
[store.csagroup.org](http://store.csagroup.org)

ISBN 978-1-4883-2644-8  
ICS 23.040  
© 2020 Canadian Standards Association

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

ASMECSAGROUP.COM: Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020

# Contents

ASME A112 Standards Committee on Plumbing Materials and Equipment 4

ASME A112.18.2 Project Team on Fixture Waste Fittings 8

CSA Technical Committee on Plumbing Fixtures 11

CSA Harmonization Task Group on Plumbing Fittings 17

Preface 21

**1 Scope 23**

**2 Reference publications 24**

**3 Definitions and abbreviations 25**

3.1 Definitions 25

3.2 Abbreviations 27

**4 General requirements 27**

4.1 Materials 27

4.1.1 General 27

4.1.2 All waste fittings 27

4.1.3 Plastic tubular waste fittings 27

4.1.4 Plastic pipe and pipe fittings 28

4.1.5 Copper alloys 28

4.1.6 Cast iron 28

4.1.7 Ductile iron 28

4.1.8 Stainless steel 28

4.1.9 Elastomeric fittings 28

4.2 Installation 28

4.2.1 Connection to waste system 28

4.2.2 Protection of finish 29

4.2.3 Fixture seal 29

4.3 Threads 29

4.3.1 DWV plastic pipe and fittings 29

4.3.2 Metallic pipes and fittings 29

4.3.3 Compression and union nuts 29

4.3.4 Tapped bosses 29

4.4 Solder connections 29

4.5 Replacement parts 29

4.5.1 Use of standard tools 29

4.5.2 Replacement part design 29

4.6 Dimensions 30

4.6.1 Outlet size 30

4.6.2 Slip joints 30

4.6.3 Wall thickness 30

4.6.4 Sink strainer assemblies 30

4.6.5	Traps	31
4.6.6	Tubing stops	31
4.6.7	Subdrains for built-up shower pans	31
4.6.8	Grey water diverters	32
4.7	Mechanical stoppers	32
4.8	Additional requirements for linear shower drains	32
<b>5</b>	<b>Performance requirements and test procedures</b>	<b>33</b>
5.1	General	33
5.1.1	Preconditioning	33
5.1.2	Installation for testing	33
5.1.3	Testing sequence	33
5.2	Corrosion	33
5.2.1	Performance requirements	33
5.2.2	Test procedure	34
5.3	Thermal cycling	34
5.3.1	Performance requirements	34
5.3.2	Test procedure	34
5.4	Coatings	35
5.5	Shower drain strainers	35
5.5.1	Performance requirements	35
5.5.2	Load test procedure	35
5.6	Sink strainer assemblies	35
5.6.1	Performance requirements	35
5.6.2	Hot oil exposure	35
5.6.3	Water absorption	36
5.6.4	Point impact	36
5.7	Body and clamping rings of subdrains for built-up shower pans	36
5.8	Minimum flow rate	37
5.8.1	Performance requirements	37
5.8.2	Test procedure	37
5.8.3	Grey water diverters	37
5.9	Strength	37
5.9.1	Thread torque strength	37
5.9.2	Hydrostatic pressure	38
5.10	Life cycle	38
5.10.1	Performance requirements	38
5.10.2	Test procedure	38
5.11	Seals leakage	38
5.11.1	Waste fittings for drainage flow control	38
5.11.2	Other waste fittings	39
5.12	Leakage test for the seam between the bonding flange and membrane	39
5.12.1	Performance requirements	39
5.12.2	Test procedures	39
<b>6</b>	<b>Markings, packaging, and installation instructions</b>	<b>39</b>
6.1	General	39
6.2	Packaging	40
6.3	Instructions for elastomeric waste fittings	40



6.4	Grey water diverters	40
6.4.1	Markings	40
6.4.2	Instructions	40

---

Annex A (informative)	— Unit conversion and rounding criteria	53
-----------------------	---	----

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020

# ASME A112 Standards Committee on Plumbing Materials and Equipment

<b>W. M. Smith</b>	American Society of Plumbing Engineers, Montgomery, Alabama, USA	<i>Chair</i>
<b>S. M. Rawalpindiwala</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Vice-Chair</i>
<b>M. R. Gibeault</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Alternate</i>
<b>R. K. Adler</b>	City of San Jose, San Jose, California, USA	
<b>J. A. Ballanco</b>	JB Engineering and Code Consulting PC, Munster, Indiana, USA	
<b>J. E. Bertrand</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	
<b>C. W. McDonald</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	<i>Alternate</i>
<b>T. Burger</b>	NSF International, South Euclid, Ohio, USA	
<b>R. Burnham</b>	Zurn Industries LLC, Erie, Pennsylvania, USA	
<b>M. Campos</b>	ICC Evaluation Service, LLC, Brea, California, USA	
<b>S. L. Cavanaugh</b>	Cavanaugh Consulting, Santa Fe, New Mexico, USA	<i>Contributing Member</i>
<b>W. E. Chapin</b>	Professional Code Consulting, LLC, Cullman, Alabama, USA	
<b>A. Ciechanowski</b>	NSF International, Ann Arbor, Michigan, USA	<i>Alternate</i>

<b>P. V. DeMarco</b>	IAPMO, Dayton, New Jersey, USA	
<b>N. E. Dickey</b>	Hansgrohe, Inc., Alpharetta, Georgia, USA	
<b>G. S. Duren</b>	Code Compliance, Inc., South Pasadena, Florida, USA	
<b>A. R. Emmerson</b>	Consultant, Arlington Heights, Illinois, USA	
<b>K. Ernst</b>	Oakville Stamping & Bending Limited, Oakville, Ontario, Canada	
<b>R. L. George</b>	Plumb-Tech Design and Consulting Services LLC, Newport, Michigan, USA	
<b>D. Gleiberman</b>	Sloan Valve Co., Los Angeles, California, USA	
<b>J. W. Lauer</b>	Sloan Valve Co., Anaheim, California, USA	<i>Alternate</i>
<b>M. Guard</b>	Bradley Corporation, Wauwatosa, Wisconsin, USA	
<b>C. Haldiman</b>	Watts Water Technologies, Springfield, Missouri, USA	
<b>G. W. Harrison</b>	Consultant/Plumbing Instructor, Edmond, Oklahoma, USA	
<b>L. Himmelblau</b>	The Chicago Faucet Company, Des Plaines, Illinois, USA	
<b>J. Kendzel</b>	American Supply Association, Itasca, Illinois, USA	<i>Contributing Member</i>
<b>J. M. Koeller</b>	Koeller and Co., Yorba Linda, California, USA	

<b>N. M. Kummerlen</b>	Consultant, Lorain, Ohio, USA	<i>Contributing Member</i>
<b>C. J. Lagan</b>	American Standard/LIXIL, Piscataway, New Jersey, USA	
<b>M. Malatesta</b>	American Standard/LIXIL, Piscataway, New Jersey, USA	<i>Alternate</i>
<b>W. LeVan</b>	Cast Iron Soil Pipe Institute, Watersound, Florida, USA	
<b>D. Liang</b>	CSA Group, Toronto, Ontario, Canada	<i>Contributing Member</i>
<b>D. Marbry</b>	Fluidmaster Inc., San Juan Capistrano, California, USA	
<b>R. Mata</b>	American Society of Plumbing Engineers, Mentor, Ohio, USA	
<b>L. A. Mercer</b>	IAPMO, Valley City, Ohio, USA	
<b>W. B. Morris</b>	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	<i>Alternate</i>
<b>A. I. Murra</b>	Abraham Murra Consulting, Oakville, Ontario, Canada	
<b>D. Orton</b>	NSF International, Ann Arbor, Michigan, USA	
<b>R. Pickering</b>	Eastern Research Group, Inc. (ERG), Morrisville, North Carolina, USA	<i>Contributing Member</i>
<b>A. Poon</b>	Delta Faucet Company, Indianapolis, Indiana, USA	
<b>B. Ramkarran</b>	Infinity Drain, Ltd., Amityville, New York, USA	<i>Contributing Member</i>

<b>S. A. Remedios</b>	Remedios Consulting, London, Ontario, Canada	
<b>M. Sigler</b>	Plumbing Manufacturers International, Orlando, Florida, USA	
<b>G. L. Simmons</b>	Charlotte Pipe & Foundry, Charlotte, North Carolina, USA	
<b>S. Tanner</b>	U.S. Environmental Protection Agency, Washington, District of Columbia, USA	<i>Contributing Member</i>
<b>K. Thompson</b>	IAPMO, Ontario, California, USA	
<b>J. Watson</b>	Elkay Manufacturing, Oak Brook, Illinois, USA	
<b>M. Weiss</b>	Plumbing & Drainage Institute, Polson, Montana, USA	
<b>W. C. Whitehead</b>	Whitehead Consulting Services, Peabody, Massachusetts, USA	
<b>A. L. Guzman Rodriguez</b>	American Society of Mechanical Engineers, New York, New York, USA	<i>Secretary</i>

# ASME A112.18.2 Project Team on Fixture Waste Fittings

<b>W. E. Chapin</b>	Professional Code Consulting, LLC, Cullman, Alabama, USA	<i>Chair</i>
<b>A. R. Emmerson</b>	Consultant, Arlington Heights, Illinois, Canada	<i>Vice-Chair</i>
<b>W. T. Ball</b>	WCM Industries Inc., Colorado Springs, Colorado, USA	
<b>D. R. Berge</b>	5D Infusion Canada Inc., St Jean Sur Richelieu, Québec, Canada	
<b>J. E. Bertrand</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	
<b>T. Burke</b>	Victoria + Albert Baths Ltd., Telford, Shropshire, United Kingdom	
<b>R. Burnham</b>	Zurn Industries LLC, Erie, Pennsylvania, USA	
<b>M. Campos</b>	ICC Evaluation Service, LLC, Brea, California, USA	
<b>N. E. Dickey</b>	Hansgrohe, Inc., Alpharetta, Georgia, USA	
<b>M. R. Gibeault</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Alternate</i>
<b>L. Gibson</b>	QAI Laboratories, Coquitlam, British Columbia, Canada	<i>Contributing Member</i>
<b>D. Gleiberman</b>	Sloan Valve Co., Los Angeles, California, USA	
<b>M. Guard</b>	Bradley Corporation, Wauwatosa, Wisconsin, USA	

<b>R. Guinn</b>	Consultant, Oro-Medonte, Ontario, Canada
<b>C. Haldiman</b>	Watts Water Technologies, Springfield, Missouri, USA
<b>L. Himmelblau</b>	The Chicago Faucet Company, Des Paines, Illinois, USA
<b>E. Ho</b>	IAPMO Group, Markham, Ontario, Canada
<b>J. W. Lauer</b>	Sloan Valve Co., Anaheim, California, USA
<b>A. Lunt</b>	Spears Manufacturing, Sylmar, California, USA
<b>M. Malatesta</b>	American Standard/LIXIL, Piscataway, New Jersey, USA
<b>C. W. McDonald</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA
<b>L. A. Mercer</b>	IAPMO, Valley City, Ohio, USA
<b>A. I. Murra</b>	Abraham Murra Consulting, Oakville, Ontario, Canada
<b>R. Neff</b>	Delta Faucet Company, Indianapolis, Indiana, USA
<b>A. Poon</b>	Delta Faucet Company, Indianapolis, Indiana, USA
<b>B. Ramkarran</b>	Infinity Drain Ltd., Amityville, New York, USA
<b>S. M. Rawalpindiwala</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA

<b>S. A. Remedios</b>	Remedios Consulting, London, Ontario, Canada	
<b>K. Thompson</b>	IAPMO, Ontario, California, USA	
<b>D. Viola</b>	IAPMO, Mokena, Illinois, USA	
<b>L. Viswanathan</b>	Oatey Co., Cleveland, Ohio, USA	
<b>J. Watson</b>	Elkay Manufacturing, Oak Brook, Illinois, USA	
<b>A. L. Guzman Rodriguez</b>	American Society of Mechanical Engineers, New York, New York, USA	<i>Secretary</i>

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020



# CSA Technical Committee on Plumbing Fixtures

<b>K. Ernst</b>	Oakville Stamping & Bending Limited, Oakville, Ontario, Canada <i>Category: Producer Interest</i>	<i>Chair</i>
<b>J. E. Bertrand</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA <i>Category: Producer Interest</i>	<i>Vice-Chair</i>
<b>D. McNamara</b>	Franke Kindred Canada Limited, Midland, Ontario, Canada <i>Category: Producer Interest</i>	<i>Vice-Chair</i>
<b>J. Adili</b>	UL LLC, Northbrook, Illinois, USA	<i>Associate</i>
<b>W. T. Ball</b>	WCM Industries Inc., Colorado Springs, Colorado, USA	<i>Associate</i>
<b>S. Breda</b>	Omni Brass Inc., Vaughan, Ontario, Canada	
<b>J. Briggs</b>	NSF International, Ann Arbor, Michigan, USA	<i>Associate</i>
<b>T. Burger</b>	NSF International, South Euclid, Ontario, USA	
<b>T. Burke</b>	Victoria + Albert Baths Ltd., Telford, Shropshire, United Kingdom	<i>Associate</i>
<b>R. Burnham</b>	Zurn Industries LLC, Erie, Pennsylvania, USA <i>Category: Producer Interest</i>	<i>Associate</i>
<b>M. Campos</b>	ICC Evaluation Service, LLC, Brea, California, USA	<i>Associate</i>
<b>W. E. Chapin</b>	Professional Code Consulting, LLC, Cullman, Alabama, USA	<i>Associate</i>

<b>L. Clifton</b>	International Code Council, Brea, California, USA	
<b>A. De Francesca</b>	City of Toronto, Toronto, Ontario, Canada	<i>Associate</i>
<b>N. E. Dickey</b>	Hansgrohe, Inc., Alpharetta, Georgia, USA	<i>Associate</i>
<b>Y. Duchesne</b>	Régie du bâtiment du Québec, Québec, Québec, Canada <i>Category: Regulatory Authority</i>	
<b>A. R. Emmerson</b>	Consultant, Arlington Heights, Illinois, Canada	
<b>W. Falcomer</b>	The Corporation of the City of Ottawa, Ottawa, Ontario, Canada <i>Category: Regulatory Authority</i>	
<b>F. Fernández</b>	Toto U.S.A. Inc., Ontario, California, USA <i>Category: Producer Interest</i>	<i>Associate</i>
<b>M. E. Fish</b>	Zurn Industries, LLC, Cary, North Carolina, USA	<i>Associate</i>
<b>M. R. Gibeault</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Associate</i>
<b>D. Gleiberman</b>	Sloan, Los Angeles, California, USA	<i>Associate</i>
<b>F. Grable</b>	International Code Council (ICC), Country Club Hills, Illinois, USA	
<b>D. Grenier</b>	BainUltra Inc., Lévis, Québec, Canada	<i>Associate</i>
<b>M. Guard</b>	Bradley Corporation, Wauwatosa, Wisconsin, USA	<i>Associate</i>

<b>R. Guinn</b>	Consultant, Oro-Medonte, Ontario, Canada <i>Category: User Interest</i>	
<b>R. Hernandez</b>	CSA Group, Independence, Ohio, USA <i>Category: User Interest</i>	
<b>L. Himmelblau</b>	The Chicago Faucet Company, Des Plaines, Illinois, USA <i>Category: Producer Interest</i>	
<b>E. Ho</b>	IAPMO Group, Markham, Ontario, Canada	Associate
<b>E. Hood</b>	H. H. Angus & Associates Limited Consulting Engineers, Toronto, Ontario, Canada <i>Category: User Interest</i>	
<b>K. S. Hui</b>	Ontario Ministry of Municipal Affairs and Housing, Toronto, Ontario, Canada <i>Category: Regulatory Authority</i>	
<b>J. Knapton</b>	Southern Alberta Institute of Technology, Calgary, Alberta, Canada <i>Category: General Interest</i>	
<b>J. M. Koeller</b>	Koeller and Co., Yorba Linda, California, USA <i>Category: General Interest</i>	
<b>A. Lathia</b>	CSA Group, Independence, Ohio, USA	
<b>F. Lemieux</b>	Health Canada, Ottawa, Ontario, Canada <i>Category: Regulatory Authority</i>	
<b>D. Liang</b>	CSA Group, Toronto, Ontario, Canada	Associate
<b>R. Liao</b>	Xiamen Lota International Co. Ltd., Xiamen, Fujian, China	Associate

<b>D. Lundy</b>	Watts Water Technologies (Canada) Inc., Burlington, Ontario, Canada	<i>Associate</i>
<b>J. MacDonald</b>	Blanco Canada Inc., Brampton, Ontario, Canada	<i>Associate</i>
<b>M. Malatesta</b>	American Standard/LIXIL, Piscataway, New Jersey, USA	<i>Associate</i>
<b>D. Marbry</b>	Fluidmaster Inc., San Juan Capistrano, California, USA	<i>Associate</i>
<b>M. Martinez</b>	Delta Faucet Company, Indianapolis, Indiana, USA	
<b>R. Mata</b>	American Society of Plumbing Engineers, Mentor, Ohio, USA	<i>Non-voting</i>
<b>C. McDonald</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	<i>Associate</i>
<b>L. A. Mercer</b>	IAPMO, Valley City, Ohio, USA	
<b>M. Mohammed</b>	Reliance Worldwide Corp (Canada) Inc., Vaughan, Ontario, Canada	<i>Associate</i>
<b>A. I. Murra</b>	Abraham Murra Consulting, Oakville, Ontario, Canada <i>Category: General Interest</i>	
<b>R. Neff</b>	Delta Faucet Company, Indianapolis, Indiana, USA	<i>Associate</i>
<b>S. R. O'Neill</b>	Mohawk College of Applied Arts and Technology, Stoney Creek, Ontario, Canada	<i>Associate</i>
<b>D. Orton</b>	NSF International, Ann Arbor, Michigan, USA	<i>Associate</i>
<b>P. Paré</b>	Masco Canada Limited, St. Thomas, Ontario, Canada	

<b>M. Pfeiffer</b>	International Code Council (ICC), Country Club Hills, Ontario, Canada	
<b>R. Pickering</b>	Eastern Research Group, Inc. (ERG), Morrisville, North Carolina, USA	<i>Associate</i>
<b>A. Poon</b>	Delta Faucet Company, Indianapolis, Indiana, USA	
<b>S. M. Rawalpindiwala</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA <i>Category: Producer Interest</i>	
<b>S. A. Remedios</b>	Remedios Consulting, London, Ontario, Canada <i>Category: User Interest</i>	
<b>S. Rouleau</b>	Intertek, Ste-Marie, Québec, Canada	<i>Associate</i>
<b>P. Saeed</b>	Powers, A Watts Brand, Mt. Prospect, Illinois, USA	
<b>S. Shang</b>	China Building Material Test & Cert. Group (Shaanxi) Co. Ltd., Shaanxi, Shanxi, China	<i>Associate</i>
<b>M. Sigler</b>	Plumbing Manufacturers International, Orlando, Florida, USA	<i>Associate</i>
<b>W. Smith</b>	American Society of Plumbing Engineers (ASPE), Montgomery, Alabama, USA <i>Category: General Interest</i>	
<b>R. Sparling</b>	-30- Forensic Engineering, Toronto, Ontario, Canada	
<b>S. Tanner</b>	U.S. Environmental Protection Agency, Washington, District of Columbia, USA <i>Category: General Interest</i>	
<b>K. Thompson</b>	IAPMO, Ontario, California, USA	<i>Associate</i>

<b>J. C. Watson</b>	Elkay Manufacturing, Oak Brook, Illinois, USA	<i>Associate</i>
<b>S. Weinman</b>	American Society of Mechanical Engineers (ASME), New York, New York, USA	
<b>S. P. Williams</b>	Sioux Chief Manufacturing Company Inc., Brantford, Ontario, Canada	<i>Associate</i>
<b>E. L. Wirtschoreck</b>	International Code Council (ICC), Country Club Hills, Illinois, USA	
<b>K. Wong</b>	Uponor, Apple Valley, Minnesota, USA	<i>Associate</i>
<b>C. Wright</b>	Ontario Pipe Trades, Dundalk, Ontario, Canada <i>Category: User Interest</i>	
<b>R. Zanola</b>	CSA Group, Lombardia, Milan, Italy	
<b>F. Zhang</b>	China Building Material Test & Cert. Group (Shaanxi) Co. Ltd., Shaanxi, Shanxi, China	<i>Associate</i>
<b>J. Menard</b>	CSA Group, Toronto, Ontario, Canada	<i>Project Manager</i>
<b>L. Pilla</b>	CSA Group, Toronto, Ontario, Canada	<i>Project Manager</i>

# CSA Harmonization Task Group on Plumbing Fittings

<b>P. Paré</b>	Masco Canada Limited, St. Thomas, Ontario, Canada	<i>Chair</i>
<b>S.A. Remedios</b>	Remedios Consulting, London, Ontario, Canada	<i>Chair</i>
<b>W. T. Ball</b>	WCM Industries Inc., Colorado Springs, Colorado, USA	<i>Associate</i>
<b>J. E. Bertrand</b>	Fortune Brands — Global Plumbing Group, North Olmsted, Ohio, USA	
<b>T. Burke</b>	Victoria + Albert Baths Ltd., Telford, Shropshire, United Kingdom	
<b>R. Burnham</b>	Zurn Industries LLC, Erie, Pennsylvania, USA	
<b>M. Campos</b>	ICC Evaluation Service, LLC, Brea, California, USA	<i>Associate</i>
<b>L. Clifton</b>	International Code Council, Brea, California, USA	
<b>N. E. Dickey</b>	Hansgrohe, Inc., Alpharetta, Georgia, USA	<i>Associate</i>
<b>A. R. Emmerson</b>	Consultant, Arlington Heights, Illinois, Canada	
<b>K. Ernst</b>	Oakville Stamping & Bending Limited, Oakville, Ontario, Canada	<i>Associate</i>
<b>F. Fernández</b>	Toto U.S.A. Inc., Ontario, California, USA	
<b>M. E. Fish</b>	Zurn Industries, LLC, Cary, North Carolina, USA	<i>Associate</i>

<b>M. R. Gibeault</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Associate</i>
<b>F. Grable</b>	International Code Council (ICC), Country Club Hills, Illinois, USA	
<b>M. Guard</b>	Bradley Corporation, Wauwatosa, Wisconsin, USA	
<b>R. Guinn</b>	Consultant, Oro-Medonte, Ontario, Canada	<i>Associate</i>
<b>L. Himmelblau</b>	The Chicago Faucet Company, Des Plaines, Illinois, USA	<i>Associate</i>
<b>E. Ho</b>	IAPMO Group, Markham, Ontario, Canada	
<b>A. Lathia</b>	CSA Group, Independence, Ohio, USA	<i>Associate</i>
<b>F. Lemieux</b>	Health Canada, Ottawa, Ontario, Canada	<i>Associate</i>
<b>D. Liang</b>	CSA Group, Toronto, Ontario, Canada	<i>Associate</i>
<b>R. Liao</b>	Xiamen Lota International Co. Ltd., Xiamen, Fujian, China	
<b>J. MacDonald</b>	Blanco Canada Inc., Brampton, Ontario, Canada	<i>Associate</i>
<b>M. Malatesta</b>	American Standard/LIXIL, Piscataway, New Jersey, USA	<i>Associate</i>
<b>D. Marbry</b>	Fluidmaster Inc., San Juan Capistrano, California, USA	
<b>M. Martinez</b>	Delta Faucet Company, Indianapolis, Indiana, USA	



<b>D. McNamara</b>	Franke Kindred Canada Limited, Midland, Ontario, Canada	<i>Associate</i>
<b>L. A. Mercer</b>	IAPMO, Valley City, Ohio, USA	
<b>D. Orton</b>	NSF International, Ann Arbor, Michigan, USA	<i>Associate</i>
<b>M. Pfeiffer</b>	International Code Council (ICC), Country Club Hills, Ontario, Canada	
<b>R. Pickering</b>	Eastern Research Group, Inc., Morrisville, North Carolina, USA	
<b>A. Poon</b>	Delta Faucet Company, Indianapolis, Indiana, USA	<i>Associate</i>
<b>S. M. Rawalpindiwala</b>	Kohler Co. Plumbing Division, Kohler, Wisconsin, USA	<i>Associate</i>
<b>P. Saeed</b>	Powers, A Watts Brand, Mt. Prospect, Florida, USA	<i>Associate</i>
<b>M. Sigler</b>	Plumbing Manufacturers International, Orlando, Florida, USA	
<b>W. Smith</b>	American Society of Plumbing Engineers (ASPE), Montgomery, Alabama, USA	<i>Associate</i>
<b>S. Tanner</b>	U.S. Environmental Protection Agency, Washington, District of Columbia, USA <i>Category: General Interest</i>	
<b>J. C. Watson</b>	Elkay Manufacturing, Oak Brook, Illinois, USA	<i>Associate</i>
<b>S. Weinman</b>	American Society of Mechanical Engineers (ASME), New York, New York, USA	

**E. L. Wirtschoreck** International Code Council (ICC),  
Country Club Hills, Illinois, USA

**C. Wright** Ontario Pipe Trades,  
Dundalk, Ontario, Canada

ASMENORMDOC.COM : Click to view the full PDF of ASME A112.18.2 CSA B125.2 2020

# Preface

This is the fourth edition of ASME A112.18.2/CSA B125.2, *Plumbing waste fittings*. It supersedes the previous editions, published in 2015 and 2011.

Together with ASME A112.18.1/CSA B125.1, *Plumbing supply fittings*, CSA B125.3, *Plumbing fittings*, and ASME A112.18.6/CSA B125.6, *Flexible water connectors*, this Standard forms a series to cover plumbing fittings.

This Standard is considered suitable for use for conformity assessment within the stated scope of the Standard.

This Standard was prepared by the ASME/CSA Joint Harmonization Task Group on Plumbing Fittings, under the jurisdiction of the ASME Standards Committee on Plumbing Materials and Equipment and the CSA Technical Committee on Plumbing Fixtures. The CSA Technical Committee operates under the jurisdiction of the CSA Strategic Steering Committee on Construction and Civil Infrastructure. This Standard was formally approved by the ASME Standards Committee and the CSA Technical Committee.

This Standard has been developed in compliance with Standards Council of Canada requirements for National Standards of Canada. It has been published as a National Standard of Canada by CSA Group.

This Standard was approved as an American National Standard by the American National Standards Institute on April 23, 2020.

## ASME Notes:

- 1) *This standard was developed under procedures accredited as meeting the criteria for American National Standards and it is an American National Standard. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed Standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.*
- 2) *ASME does not “approve,” “rate,” or “endorse” any item, construction, proprietary device, or activity.*
- 3) *ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.*
- 4) *Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this standard.*
- 5) *ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.*
- 6) *ASME issues written replies to inquiries concerning interpretation of technical aspects of this Standard. All inquiries regarding this Standard, including requests for interpretations, should be addressed to:*

*Secretary, A112 Standards Committee  
The American Society of Mechanical Engineers  
Two Park Avenue  
New York, NY 10016-5990*

A request for interpretation should be clear and unambiguous. The request should

- cite the applicable edition of the Standard for which the interpretation is being requested.
- phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. The inquirer may also include any plans or drawings, which are necessary to explain the question; however, they should not contain proprietary names or information.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME Committee.

Interpretations are published on the ASME Web site under the Committee Pages at <https://cstools.asme.org/> as they are issued.

#### CSA Notes:

- 1) Use of the singular does not exclude the plural (and vice versa) when the sense allows.
- 2) Although the intended primary application of this Standard is stated in its Scope, it is important to note that it remains the responsibility of the users of the Standard to judge its suitability for their particular purpose.
- 3) This publication was developed by consensus, which is defined by CSA Policy governing standardization — Code of good practice for standardization as “substantial agreement. Consensus implies much more than a simple majority, but not necessarily unanimity”. It is consistent with this definition that a member may be included in the Technical Committee list and yet not be in full agreement with all clauses of this publication.
- 4) This Standard is subject to review within five years from the date of publication. Suggestions for its improvement will be referred to the appropriate committee.
- 5) To submit a request for interpretation of this Standard, please send the following information to [inquiries@csagroup.org](mailto:inquiries@csagroup.org) and include “Request for interpretation” in the subject line:
  - a) define the problem, making reference to the specific clause, and, where appropriate, include an illustrative sketch;
  - b) provide an explanation of circumstances surrounding the actual field condition; and
  - c) where possible, phrase the request in such a way that a specific “yes” or “no” answer will address the issue.

Committee interpretations are processed in accordance with the CSA Directives and guidelines governing standardization and are available on the Current Standards Activities page at [standardsactivities.csa.ca](http://standardsactivities.csa.ca).

- 6) Attention is drawn to the possibility that some of the elements of this Standard may be the subject of patent rights. CSA Group is not to be held responsible for identifying any or all such patent rights. Users of this Standard are expressly advised that determination of the validity of any such patent rights is entirely their own responsibility.

# ASME A112.18.2-2020/CSA B125.2:20

## Plumbing waste fittings

### 1 Scope

#### 1.1

This Standard covers plumbing waste fittings of sizes NPS-2 and smaller.

#### 1.2

This Standard does not cover

- a) plumbing supply fittings, which are covered by ASME A112.18.1/CSA B125.1;
- b) other devices (e.g., temperature-actuated in-line mixing valves), which are covered by CSA B125.3 or other plumbing product standards; and
- c) flexible water connectors under continuous pressure, which are covered by ASME A112.18.6/CSA B125.6.

#### 1.3

This Standard does not cover pipes and tubes or pipe and tube fittings that are downstream of the trap.

#### 1.4

In this Standard, “shall” is used to express a requirement, i.e., a provision that the user is obliged to satisfy in order to comply with the standard; “should” is used to express a recommendation or that which is advised but not required; and “may” is used to express an option or that which is permissible within the limits of the standard.

Notes accompanying clauses do not include requirements or alternative requirements; the purpose of a note accompanying a clause is to separate from the text explanatory or informative material.

Notes to tables and figures are considered part of the table or figure and may be written as requirements.

Annexes are designated normative (mandatory) or informative (nonmandatory) to define their application.

#### 1.5

SI units are the units of record in Canada. In this Standard, the inch/pound units are shown in parentheses.

The values stated in each measurement system are equivalent in application; however, each system is to be used independently. Combining values from the two measurement systems can result in non-conformance with this Standard.

All references to gallons are to U.S. gallons.

For information on the conversion criteria used in this Standard, see Annex [A](#).

## 2 Reference publications

This Standard refers to the following publications, and where such reference is made, it shall be to the edition listed below, including all amendments published thereto.

### ASME (The American Society of Mechanical Engineers)/CSA Group

ASME A112.18.1-2018/CSA B125.1-18

*Plumbing supply fittings*

ASME A112.18.6-2017/CSA B125.6-17

*Flexible water connections*

### ASME (The American Society of Mechanical Engineers)

B1.20.1-2013

*Pipe Threads, General Purpose, Inch*

B16.23-2016

*Cast Copper Alloy Solder Joint Drainage Fittings: DWV*

B16.29-2017

*Wrought Copper and Wrought Copper Alloy Solder — Joint Drainage Fittings — DWV*

### CSA Group

B125.3-18

*Plumbing fittings*

B1800-18

*Thermoplastic nonpressure piping compendium*

CAN/CSA-B181.1-18

*Acrylonitrile-butadiene-styrene (ABS) drain, waste, and vent pipe and pipe fittings*

CAN/CSA-B181.2-18

*Polyvinylchloride (PVC) and chlorinated polyvinylchloride (CPVC) drain, waste, and vent pipe and pipe fittings*

B602-16

*Mechanical couplings for drain, waste, and vent pipe and sewer pipe*

### ASTM International (American Society for Testing and Materials)

A48/A48M-03 (2016)

*Standard Specification for Gray Iron Castings*

A536-84 (2019) e1

*Standard Specification for Ductile Iron Castings*

B16/B16M-10(2015)

*Standard Specification for Free-Cutting Brass Rod, Bar and Shapes for Use in Screw Machines*

B117-18

*Standard Practice for Operating Salt Spray (Fog) Apparatus*

D1784-11

*Standard Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds*

D2661-14e1

*Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe and Fittings*

D2665-14

*Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings*

D3965-16

*Standard Specification for Rigid Acrylonitrile-Butadiene-Styrene (ABS) Materials for Pipe and Fittings*

D4101-17e

*Standard Specification for Polypropylene Injection and Extrusion Materials*

D5927-17

*Standard Classification System for and Basis for Specifications for Thermoplastic Polyester (TPES) Injection and Extrusion Materials Based on ISO Test Methods*

E29-13(2019)

*Standard Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications*

F628-12e3

*Standard Specification for Acrylonitrile-Butadiene-Styrene (ABS) Schedule 40 Plastic Drain, Waste, and Vent Pipe With a Cellular Core*

F891-16

*Standard Specification for Coextruded Poly(Vinyl Chloride) (PVC) Plastic Pipe With a Cellular Core*

F1498-08(2012)e1

*Standard Specification for Taper Pipe Threads 60° for Thermoplastic Pipe and Fittings*

**TCNA (Tile Council of North America, Inc.)**

TCNA/ANSI A118.10-08

*Standard Specification for Load Bearing, Bonded, Waterproof Membranes for Thin-set Ceramic Tile and Dimension Stone Installation*

### **3 Definitions and abbreviations**

#### **3.1 Definitions**

The following definitions shall apply in this Standard:

**Bonding flange** — an integrated edge or rim that projects from a shower drain for support and to allow attachment to the subsurface of the shower floor or a water proof membrane. See Figure [9](#).

**Centre outlet** — a lavatory waste fitting without an overflow opening.

**Continuous waste assembly** — a drain assembly for multiple compartments of a fixture that is connected to a common trap. See Figures 7 and 8.

**Diversion tee** — a fitting of a continuous waste assembly consisting of a tee fitting and an integral element that directs the flow downward to the outlet of the tee. See Figure 8.

**Grey water** — untreated residential wastewater from bathtubs, showers, lavatories, clothes washers, and laundry tubs that has not come into contact with kitchen waste or waste from a sanitary unit.

**Note:** *Grey water does not include wastewater from kitchen sinks or dishwashers.*

**Grey water diverter** — a waste fitting that incorporates a mechanism that can be operated by a user to direct grey water for reuse or disposal.

**Linear shower drain** — a receptacle containing a trench- or channel-shaped body and a solid cover or grate that is flush with the adjoining surface for receiving wastewater from a shower and conveying it to the drainage system.

**Overflow** — a conduit that is integral or attached to a fixture and whose function is to remove liquid from a fixture after the fixture has been filled past the desired level.

**Patent overflow** — a lavatory waste fitting incorporating an overflow opening.

**Sanitary unit** — a water closet, urinal, bidet, or bedpan washer.

**Significant surface** — an exposed surface that, if blemished, spoils the appearance or affects the performance of a fitting.

**Slip joint** — an adjustable tubing connection that consists of a compression nut and compression washer and is designed to fit a threaded adapter fitting or a standard taper pipe thread.

**Standard tools** — tools that are normally carried by plumbers for installing and maintaining plumbing.

**Note:** *Examples include screwdrivers, key wrenches, flat-jawed wrenches, and pliers.*

**Strainer** — a device designed to prevent debris from entering a drainage system.

**Strainer basket** — a removable component of a sink strainer assembly, designed to collect debris.

**Strainer body** — the fixed, exposed component of a sink strainer assembly connected to the fixture that accommodates the strainer basket.

**Strainer shell** — the unexposed component of a sink strainer assembly that connects the strainer body to the fixture that accommodates the strainer basket.

**Strainer sleeve** — the unexposed component of a sink strainer assembly that connects the assembly to the fixture waste connection.

**Trap** — a fitting that provides, when installed in a properly vented system, a liquid seal that prevents the back passage of gas without affecting the flow of sewage or wastewater through the system.

**Trap seal** — the vertical depth of a liquid that a trap retains, measured from the trap weir (the lowest point in the cross-section of the horizontal waterway at the trap exit) and the top of the tube at the lowest point of its bend. See Figure 1.



**Trap wall adapter** — a part of the waste system that is used to connect a trap outlet to a building drainage system. See Figure 2.

**Twin waste elbow** — a fitting of a continuous waste assembly that diverts waste from two horizontal branches in the same plane to a vertical outlet. See Figure 6.

**Waste fitting** — part of a waste system from a plumbing fixture to, and including, a fixture trap outlet or trap wall adapter.

### 3.2 Abbreviations

The following abbreviations apply in this Standard:

ABS	— acrylonitrile-butadiene-styrene
ASA	— American Standards Association
DWV	— drain, waste, and vent
NC	— National Coarse
NPS	— Nominal Pipe Size
NPSM	— National Pipe Straight Mechanical
NPT	— National Pipe Tapered
OD	— outside diameter
PBT	— polybutylene terephthalate
PP	— polypropylene
PVC	— polyvinylchloride

## 4 General requirements

### 4.1 Materials

**Note:** The requirements of Clauses 4.1.2 to 4.1.9 are not intended to prevent the use of alternative materials for components that are not part of the drainage envelope.

#### 4.1.1 General

The requirements specified in Clauses 4.1.2 to 4.1.9 shall apply only to wetted components that are part of the drainage envelope.

**Note:** The drainage envelope includes traps, tailpieces, trap wall adapters (see Figure 2), diversion tees, twin waste elbows, overflow elbows, drain elbows, and strainer bodies. Components that are not considered part of the drainage envelope include pop-up stoppers, overflow plates, coupling nuts, strainer baskets and sleeves, and lift rods.

#### 4.1.2 All waste fittings

Waste fittings and waste fitting components shall be made from materials that comply with this Standard.

#### 4.1.3 Plastic tubular waste fittings

Plastic tubular waste fittings shall be made of acrylonitrile-butadiene-styrene (ABS), polypropylene (PP),

polyvinylchloride (PVC), or polybutylene terephthalate (PBT), and shall comply with or exceed one or more of the following cell classifications:

- a) ABS for fittings and mechanical joints: cell classification 20211 in ASTM D3965;
- b) ABS for tubes: cell classification 42222 in ASTM D3965;
- c) reinforced PP: cell classification PP0105G20A33350 in ASTM D4101;
- d) unreinforced PP:
  - i) cell classification PP0110B55140 in ASTM D4101; or
  - ii) cell classification 55230 or higher in Table B of ASTM D4101;
- e) PVC: cell classification 12454 or 14333 in ASTM D1784; or
- f) PBT: cell classification TPES 0113 in ASTM D5927.

#### 4.1.4 Plastic pipe and pipe fittings

ABS or PVC used for manufacturing drain, waste, and vent (DWV) plastic pipe and pipe fittings shall comply with one of the following Standards:

- a) CAN/CSA-B181.1;
- b) CAN/CSA-B181.2;
- c) ASTM D2661;
- d) ASTM D2665;
- e) ASTM F628; or
- f) ASTM F891.

#### 4.1.5 Copper alloys

Copper alloys shall have a minimum copper content of 56% by weight.

#### 4.1.6 Cast iron

Cast iron shall be of class 25, as specified in ASTM A48/A48M.

#### 4.1.7 Ductile iron

Ductile iron shall be Grade 60-40-18 or Grade 60-45-12, as specified in ASTM A536.

#### 4.1.8 Stainless steel

Stainless steel alloys shall be of the 300 or 400 Series.

#### 4.1.9 Elastomeric fittings

##### 4.1.9.1 Elastomers

Elastomeric waste fittings shall comply with the material requirements of CSA B602.

##### 4.1.9.2 Elastomeric tubular parts

The wall thickness of elastomeric tubular parts shall be at least 2.0 mm (0.079 in).

#### 4.2 Installation

##### 4.2.1 Connection to waste system

Waste fittings shall be provided with a means to connect to a type of trap or waste system in common use.

## 4.2.2 Protection of finish

Provision shall be made to enable waste fittings to be connected and mounted without marring the finish or otherwise damaging the fitting or the surface on which it is to be mounted.

## 4.2.3 Fixture seal

Provision shall be made for a method of establishing a seal between a waste fitting and the fixture to which it is fastened.

## 4.3 Threads

### 4.3.1 DWV plastic pipe and fittings

Taper threads used on plastic tubular waste fittings complying with Clause [4.1.3](#) and used on ABS or PVC DWV plastic pipe and pipe fittings complying with Clause [4.1.4](#) shall

- a) be moulded;
- b) comply with ASTM F1498; and
- c) be a minimum of 2.5 threads long, with a minimum of one thread engagement.

### 4.3.2 Metallic pipes and fittings

Threads used on pipe and fittings manufactured from metallic base materials shall comply with ASME B1.20.1.

### 4.3.3 Compression and union nuts

Threads for compression and union nuts shall be a minimum of 2.5 threads long, with a minimum of one thread engagement. The threads shall be NPSM threads. The thread form shall comply with Table 6 of ASME B1.20.1.

### 4.3.4 Tapped bosses

Tapped bosses for threaded tubing shall have 1-1/4 or 1-1/2 × 27 or 28 threads per inch ASA 60° thread and shall be at least 2.5 threads long.

## 4.4 Solder connections

The dimensions of solder joint ends for connection to copper tube or copper tube fittings (except factory-assembled parts) shall comply with ASME B16.23 or ASME B16.29.

## 4.5 Replacement parts

### 4.5.1 Use of standard tools

Repair and maintenance of waste fittings shall be accomplished with the use of standard tools.

### 4.5.2 Replacement part design

Joints that have to be taken apart to replace worn parts after the fitting is installed shall be designed so that disassembly and replacement are possible without damaging or marring the fitting or significant surface on which the fitting is installed.

## 4.6 Dimensions

### 4.6.1 Outlet size

#### 4.6.1.1 Lavatory and bidet waste fittings

Lavatory and bidet waste fittings shall be provided with a minimum 1-1/4 in nominal outside diameter (OD) outlet.

#### 4.6.1.2 Sink, shower, bathtub, laundry tub, and bar sink waste fittings

Sink, shower, bathtub, laundry tub, and bar sink waste fittings shall be provided with a minimum 1-1/2 in nominal OD outlet.

### 4.6.2 Slip joints

The inside diameter of slip joints shall fit with tubing of the same nominal size. Slip joints located on the inlet side of a trap shall be at least 13 mm (0.5 in) above the trap weir. See Figure 1.

### 4.6.3 Wall thickness

#### 4.6.3.1 Metal tube and tubular fittings

When measured on a straight portion of the part, the wall thickness of metal tube and tubular fittings shall be at least the following:

- a) brass or copper:
  - i) 0.73 mm (0.029 in) unthreaded;
  - ii) 0.83 mm (0.032 in) threaded by cutting; and
  - iii) 0.40 mm (0.016 in) for corrugated tubing; and
- b) stainless steel:
  - i) 0.30 mm (0.012 in) unthreaded; and
  - ii) 0.83 mm (0.032 in) threaded by cutting.

#### 4.6.3.2 Plastic tube and tubular fittings

The wall thickness of plastic tube and tubular fittings shall be at least 1.58 mm (0.062 in).

**Note:** This requirement does not apply to tapered or bevelled edges.

### 4.6.4 Sink strainer assemblies

#### 4.6.4.1

Components of sink strainer assemblies made of stainless steel or brass shall include a body, a basket, and, if applicable, a sleeve and shall have the following minimum thicknesses, measured before forming:

- a) body: 0.56 mm (0.022 in);
- b) basket: 0.38 mm (0.015 in); and
- c) sleeve: 0.38 mm (0.015 in).

#### 4.6.4.2

The gap between the strainer basket and the body shall be not greater than 5 mm (0.2 in). The depth of the strainer basket shall be such that, in the open position, the lip does not project above the body flange. Holes in the strainer basket shall be not greater than 5 mm (0.2 in) in the minor dimension.

#### 4.6.4.3

The strainer body thread shall be made to accommodate a nut with a 1-1/2–11-1/2 NPSM thread that complies with ASME B1.20.1. See Figure 3.

#### 4.6.4.4

Tailpieces incorporating an adapter for a dishwasher hose connection shall comply with Figure 4.

### 4.6.5 Traps

#### 4.6.5.1

Fixture traps shall have a minimum trap seal of 50 mm (2.0 in). See Figure 1.

#### 4.6.5.2

A cleanout plug shall not reduce the waterway through the trap and shall not have projections that could cause accumulation of debris or other matter in the trap. The plug shall be threaded and the thread may be tapered or straight.

### 4.6.6 Tubing stops

Tubing stops in diversion tees, other tees, and twin waste elbows shall be integral and designed in such a way that the insert tubing shall not obstruct the flow. See Figures 5 to 8.

### 4.6.7 Subdrains for built-up shower pans

#### 4.6.7.1 Crown and collar material

A 24 gauge corrosion-resistant crown and/or collar or a brass ring 6 mm (0.25 in) thick shall be placed between the strainer and the cast-iron bodies in subdrains for built-up shower pans. See Figure 9.

#### 4.6.7.2 Obstructions

There shall be no obstructions in the caulking area.

#### 4.6.7.3 Weep holes

Subdrains shall have an open weeping area of 95 mm<sup>2</sup> (0.147 in<sup>2</sup>). Weep holes shall be located in or above the clamping ring. Weep holes shall not be required on sub drain when used in applications with linear drains with integrated bonding flanges that are used with top-mounted, bonded waterproof membranes.

#### 4.6.7.4 Clamping bolts and fasteners

Clamping bolts and fasteners shall be made of 300 Series stainless steel or copper alloy that complies with ASTM B16/B16M. At least three bolts per drain shall be provided.

Clamping bolts and fasteners for cast iron or copper alloy drains shall be a minimum of 5/16 in NC (7.9 mm), with a minimum thread length of 13 mm (0.50 in).

Clamping bolts and fasteners for plastic drains shall be a minimum of 1/4 in NC (6.4 mm), with a minimum thread length of 19 mm (0.75 in).

## 4.6.8 Grey water diverters

### 4.6.8.1 General

In addition to the requirements specified in Clauses [4.6.8.2](#) to [4.6.8.4](#), [5.8.3](#), and [6.4](#), grey water diverters shall comply with all other applicable requirements of this Standard.

### 4.6.8.2 Inlets and outlets

Inlets and outlets of grey water diverters shall have a minimum nominal OD of 1-1/4 in.

### 4.6.8.3 Internal waterway sizes

The internal waterway sizes of grey water diverters shall be equal to or larger than the size of the inlet connection.

### 4.6.8.4 Strainers

Grey water diverters shall incorporate a strainer with a mesh opening area not larger than 6.25 mm<sup>2</sup> (0.01 in<sup>2</sup>). The strainer shall be readily removable for cleaning.

## 4.7 Mechanical stoppers

### 4.7.1

The movable parts in a mechanical stopper shall be accessible without disconnecting the body from the fixture.

### 4.7.2

Seals between the linkage and the body of a mechanical stopper shall be designed to allow repacking or replacement.

## 4.8 Additional requirements for linear shower drains

### 4.8.1

The free grate area of a strainer shall be not less than the cross-sectional area of the connecting pipe.

### 4.8.2

The strainer shall be

- a) smooth and free of sharp edges; and
- b) removable without the use of special tools.

### 4.8.3

The drain body shall have internal surfaces that convey the water to the drain outlet and shall not have any concealed fouling surfaces.

### 4.8.4

When provided, waterproof membrane shall comply with the

- a) applicable requirements in TCNA/ANSI A118.10; and
- b) requirements of Clause [5.12.1](#) when tested in accordance with Clause [5.12.2](#).

## 5 Performance requirements and test procedures

### 5.1 General

#### 5.1.1 Preconditioning

Before testing, specimens shall be conditioned at ambient laboratory conditions for at least 12 h.

#### 5.1.2 Installation for testing

For test purposes, each specimen shall be installed in accordance with the manufacturer's instructions.

#### 5.1.3 Testing sequence

##### 5.1.3.1 General

In addition to the other applicable tests and requirements specified in this Standard, two fittings shall

- a) be selected at random from a lot of five production fittings;
- b) be subjected to the test sequence specified in Clauses [5.1.3.2](#) and [5.1.3.3](#); and
- c) comply with Clauses [5.2](#) to [5.11](#).

##### 5.1.3.2 Specimen 1

One of the two specimens described in Clause [5.1.3.1](#) shall be subjected to the following test sequence:

- a) thermal cycling (see Clause [5.3](#));
- b) minimum flow rate (see Clause [5.8](#));
- c) hydrostatic pressure (see Clause [5.9.2](#)); and
- d) load (shower drain) (see Clause [5.5](#)).

##### 5.1.3.3 Specimen 2

The second of the two specimens described in Clause [5.1.3.1](#) shall be subjected to the following test sequence:

- a) thread torque strength (see Clause [5.9.1](#)); and
- b) life cycle (see Clause [5.10](#)).

**Note:** In this test sequence, the seals leakage test is conducted twice: once during the thread torque strength test and once during the life cycle test.

##### 5.1.3.4 Remaining specimens

The three remaining fittings from the lot of five production fittings described in Clause [5.1.3.1](#) shall be subjected to the remaining tests specified in this Standard.

### 5.2 Corrosion

#### 5.2.1 Performance requirements

##### 5.2.1.1

When tested in accordance with Clause [5.2.2](#), functional metallic parts shall not exhibit corrosion that would adversely affect the functioning of the fitting or the disassembly and reassembly of the components. Disassembly and reassembly of the functional metallic parts shall be accomplished without damage to the components or the fitting on completion of the test procedure specified in Clause [5.2.2](#).

### 5.2.1.2

After undergoing the test specified in Clause 5.2.2, the specimen described in Clause 5.2.2.1 shall comply with Clause 5.11.1.1 or 5.11.2.1, as applicable.

### 5.2.1.3

When tested in accordance with Clause 5.2.2, the specimen described in Clause 5.2.2.1 shall be capable of being

- a) disassembled with standard tools to enable access to all serviceable parts without damage to the specimen; and
- b) reassembled with standard tools without damage to the specimen.

## 5.2.2 Test procedure

### 5.2.2.1

Fittings shall be tested in accordance with ASTM B117 for 96 h. The specimen selected for the corrosion test shall be tested as received from the manufacturer and shall not have been subjected to any other test.

### 5.2.2.2

The specimen shall be assembled in accordance with the manufacturer's instructions, including the use of mounting hardware specified by the manufacturer.

### 5.2.2.3

The specimen shall be hung in the corrosion chamber in a position as similar as possible to the position it would be in when installed. If multiple specimens are being tested, no specimen shall be suspended above another specimen.

### 5.2.2.4

Immediately after the 96 h exposure period, the corrosion chamber shall be opened and the specimen shall be rinsed under running deionized water not warmer than 38 °C (100 °F) and immediately dried for a minimum of 24 h at ambient laboratory conditions before inspection or attempts to disassemble. The specimen shall not be rubbed during rinsing or drying or before being examined.

## 5.3 Thermal cycling

### 5.3.1 Performance requirements

When tested in accordance with Clause 5.3.2, waste fittings shall show no signs of cracking, leaking, or deformation.

### 5.3.2 Test procedure

#### 5.3.2.1 Bath, shower, drinking fountain, bidet, and lavatory waste fittings

The thermal cycling test for bath, shower, drinking fountain, bidet, and lavatory waste fittings shall be conducted as follows:

- a) Install the specimen in accordance with the manufacturer's instructions.
- b) Subject the specimen to a water flow of  $7.5 \pm 0.8$  L/min ( $2.0 \pm 0.2$  gpm) at  $60 \pm 2$  °C ( $140 \pm 3$  °F) for 1.5 min, followed immediately by a water flow at  $21 \pm 2$  °C ( $70 \pm 3$  °F) for 1.5 min.
- c) Continue the test for six more cycles without pausing between cycles, for a total of seven cycles.



### 5.3.2.2 Other waste fittings

The thermal cycling test for waste fittings other than those specified in Clause [5.3.2.1](#) shall be conducted as follows:

- a) Install the specimen in accordance with the manufacturer's instructions.
- b) Subject the specimen to a water flow of  $7.5 \pm 0.8$  L/min ( $2.0 \pm 0.2$  gpm) at  $82 \pm 2$  °C ( $180 \pm 3$  °F) for 1.5 min, followed immediately by a water flow at  $21 \pm 2$  °C ( $70 \pm 3$  °F) for 1.5 min.
- c) Continue the test for six more cycles without pausing between cycles.

## 5.4 Coatings

Coatings shall comply with Clause 5.2 of ASME A112.18.1/CSA B125.1.

## 5.5 Shower drain strainers

### 5.5.1 Performance requirements

When tested in accordance with Clause [5.5.2](#), shower drain strainers shall not crack or deflect more than 3% of the largest transverse dimension with the load in place.

### 5.5.2 Load test procedure

The load test for shower drain strainers shall be conducted as follows:

- a) Mount the specimen on the body of the drain.
- b) Apply a uniformly distributed load of 1.3 kN (300 lbf) for 2 min to a 50 mm (2.0 in) diameter plate placed in the centre of the specimen.

## 5.6 Sink strainer assemblies

### 5.6.1 Performance requirements

The plastic components of sink strainer assemblies shall comply with Clauses [5.6.2](#) to [5.6.4](#).

### 5.6.2 Hot oil exposure

#### 5.6.2.1 Performance requirements

When tested in accordance with Clause [5.6.2.2](#), the exposed components of a sink strainer shall show no change in surface texture due to cracking, crazing, blistering, or delamination, and no permanent discoloration.

Discoloration that can be removed by abrading the surface and repolishing to a maximum depth of 0.15 mm (0.006 in) shall be acceptable.

#### 5.6.2.2 Test procedure

The hot oil exposure test shall be conducted as follows:

- a) Use cooking oil with a smoke point greater than 240 °C (464 °F) (e.g., safflower, sunflower, or soybean oil).
- b) Install the specimen in the sink as it would be installed in normal service, with the outlet closed.
- c) Preheat the oil to  $230 \pm 5$  °C ( $446 \pm 9$  °F).
- d) Pour  $750 \pm 50$  mL (0.20 ± 0.01 gal) of preheated oil onto the exposed surface of the specimen.
- e) Allow the oil to stand in the sink at ambient conditions for 30 min ± 5 min, then drain.
- f) Check the surface for defects as follows:
  - i) thoroughly degrease the surface of the specimen using household detergent;

- ii) apply water-soluble ink or dye of contrasting colour to the entire area to be inspected;
- iii) after 30 min, rinse with fresh water and wipe dry; and
- iv) examine the surface for changes in texture and permanent discoloration.

**Note:** Safety clothing and eye protection should be worn when conducting this test.

## 5.6.3 Water absorption

### 5.6.3.1 Performance requirements

When tested in accordance with Clause [5.6.3.2](#), no specimen shall absorb water in excess of 0.50% by mass in 24 h.

### 5.6.3.2 Test procedure

The water absorption test shall be conducted as follows:

- a) Use specimens (one each) of any plastic strainer component that will be exposed to water.
- b) Condition the specimens for 24 h in an oven at  $50 \pm 3$  °C ( $122 \pm 5$  °F).
- c) Cool the specimens in a desiccator.
- d) Weigh the specimens immediately after cooling to ambient room temperature.
- e) Place the specimens in distilled water at  $23 \pm 1$  °C ( $73 \pm 2$  °F) for 24 h, with the specimens entirely immersed and resting on an edge.
- f) At the end of the 24 h, remove the specimens from the water, one at a time.
- g) Wipe off all surface water with a dry cloth.
- h) Weigh the specimens within 30 s of removal from the water.
- i) Calculate the percentage increase in mass to the nearest 0.01%.

## 5.6.4 Point impact

### 5.6.4.1 Performance requirements

When tested in accordance with Clause [5.6.4.2](#), the strainer assembly shall not crack.

### 5.6.4.2 Test procedure

The point impact test shall be conducted as follows:

- a) Install the specimen in a kitchen sink as it would be installed in normal service.
- b) Drop a 38 mm (1.5 in) diameter steel ball weighing 230 g (0.5 lb) from a height of 600 mm (24 in) so that it strikes the upper flat rim surface of the strainer body.
- c) Drop a 38 mm (1.5 in) diameter steel ball weighing 230 g (0.5 lb) from a height of 600 mm (24 in) so that it strikes
  - i) another location on the rim surface; and
  - ii) a location on the strainer basket.
- d) Rub the surface of the specimen with a sponge containing a 50% solution of tap water and water-soluble ink (either black or another contrasting colour).
- e) Wipe excess solution from the specimen.
- f) Check for evidence of cracks.

## 5.7 Body and clamping rings of subdrains for built-up shower pans

When tested in accordance with Clause [5.11.2.2](#), the body and clamping rings of subdrains for built-up shower pans shall provide a watertight joint when installed in accordance with the manufacturer's instructions.

## 5.8 Minimum flow rate

### 5.8.1 Performance requirements

The minimum flow rate for a waste fitting with all of its component parts installed shall be 27 L/min (7.0 gpm) when a sustained water head of 150 mm (6.0 in) is applied above the inlet and the outlet is open to the atmosphere.

For purposes of determining compliance with this flow rate, an observed or calculated value shall be rounded "to the nearest unit" in the last right-hand digit used in expressing the specification limit in accordance with the rounding method specified in ASTM E29.

### 5.8.2 Test procedure

The minimum flow rate test shall be conducted using water at  $10 \pm 6$  °C ( $50 \pm 10$  °F). Each inlet of a multiple-inlet fitting shall be tested separately.

**Note:** This test is not applicable to the overflow, condensate, and branch of the tailpiece connection components of waste fitting assemblies.

## 5.8.3 Grey water diverters

### 5.8.3.1 General

Grey water diverters shall comply with Clause [5.8.3.2](#). The outlets of grey water diverters shall meet the minimum flow rate requirements specified in Clause [5.8.1](#). See Figures [10](#) and [11](#).

### 5.8.3.2 Performance requirements

When tested in accordance with Clause [5.8.3.3](#), grey water diverters shall have a minimum excess flow of 27 L/min (7.0 gpm) out of the sanitary outlet when a sustained water head of 150 mm (6.0 in) is applied above the inlet. See Figure [12](#).

### 5.8.3.3 Test procedure

The test shall be conducted as follows:

- Conduct the test as specified in Clause [5.8.2](#) with the diversion outlet of the specimen blocked and the diversion mechanism directing the flow to the blocked outlet.
- Measure the flow rate out of the sanitary drainage outlet.

## 5.9 Strength

### 5.9.1 Thread torque strength

#### 5.9.1.1 Performance requirements

Field-assembled threaded connections of union joints, slip joints, and gasketed joints shall not show evidence of stripping, cracking, or thread damage when tested in accordance with Clause [5.9.1.2](#) and shall not leak when tested in accordance with Clause [5.11](#).

#### 5.9.1.2 Procedure

The test shall be conducted as follows:

- Subject the joint(s) to a torque of 20 N•m (15 ft•lbf).
- Disassemble the joint(s).

- c) Examine the joint(s) for evidence of stripping, cracking, or thread damage. If no such evidence is found, proceed with Item d).
- d) Reassemble and retighten the joint(s) with a torque of 20 N•m (15 ft•lbf).
- e) Test the joint(s) in accordance with Clause [5.11](#) and check for leaks.

## 5.9.2 Hydrostatic pressure

### 5.9.2.1 Performance requirements

The drainage envelope parts of waste fittings shall show no signs of leakage, cracking, or permanent deformation when tested in accordance with Clause [5.9.2.2](#).

### 5.9.2.2 Procedure

The hydrostatic pressure test shall be conducted using water at  $10 \pm 6$  °C ( $50 \pm 10$  °F). Waste fittings shall be assembled in accordance with the manufacturer's instructions and subjected to a hydrostatic pressure of 34 kPa (5.0 psi) for at least 1 min.

## 5.10 Life cycle

### 5.10.1 Performance requirements

During and after the test described in Clause [5.10.2](#), waste fittings shall continue to function as they did at the beginning of the test and shall not develop defects that might adversely affect their serviceability. In addition, they shall comply with Clause [5.11](#).

### 5.10.2 Test procedure

Waste fittings incorporating moving or potentially wearing parts shall be tested for 10 000 cycles. The speed of the life cycle test apparatus shall be adjusted to a minimum of 600 cycles per hour. The fitting shall be cycled without water.

**Note:** If the design of a device is such that 600 cycles per hour cannot be attained, a more suitable cycle rate specified by the manufacturer may be used.

## 5.11 Seals leakage

### 5.11.1 Waste fittings for drainage flow control

#### 5.11.1.1 Performance requirements

When tested in accordance with Clause [5.11.1.2](#), the seals of waste fittings used to control drainage flow shall not leak more than 63 mL/min (1.0 gph).

#### 5.11.1.2 Test procedure

The seals leakage test for waste fittings for drainage flow control shall be conducted as follows:

- a) Install the specimen in accordance with the manufacturer's instructions.
- b) Subject the specimen to the static pressure of a 150 mm (6.0 in) column of water at  $10 \pm 6$  °C ( $50 \pm 10$  °F).
- c) Measure the leakage rate over a period of 5 min.

## 5.11.2 Other waste fittings

### 5.11.2.1 Performance requirements

When tested in accordance with Clause [5.11.2.2](#), the seals of waste fittings other than waste fittings for drainage flow control shall not leak.

### 5.11.2.2 Test procedures

#### 5.11.2.2.1 Pop-up assemblies

The joint in a pop-up assembly at the entry of the assembly's operating rod into the drain body shall be subjected for 5 min to the static pressure of a 150 mm (6.0 in) column of water at  $10 \pm 6$  °C ( $50 \pm 10$  °F) above the entry to the drain with the drain open and the outlet plugged. See Figure [13](#).

#### 5.11.2.2.2 Overflow gaskets

Overflow gaskets and seals shall not leak when subjected for 5 min to the static pressure of a 150 mm (6.0 in) column of water at  $10 \pm 6$  °C ( $50 \pm 10$  °F) above the midpoint of the inlet. See Figure [14](#).

#### 5.11.2.2.3 Other seals

Except as specified in Clauses [5.11.2.2.1](#) and [5.11.2.2.2](#), seals used in waste fittings shall be subjected for 5 min to the static pressure of a 500 mm (20.0 in) column of water at  $10 \pm 6$  °C ( $50 \pm 10$  °F).

## 5.12 Leakage test for the seam between the bonding flange and membrane

### 5.12.1 Performance requirements

There shall be no signs of leakage under the drain body at the location of attachment between the bonding flange and membrane.

### 5.12.2 Test procedures

The leakage test for the seam between the bonding flange and the membrane shall be conducted as follows:

- Attach the membrane to the bonding flange in accordance with the manufacturer's installation instructions. When the membrane is factory installed skip this step.
- Clamp the outer ends of the membrane at a level higher than the linear shower drain body to create a "pond" with a slope towards the drain outlet.
- Seal the linear shower drain outlet.
- Fill the "pond" with water to a depth of at least 6.4 mm (0.25 in) along the seam.
- Let the water stand for 24 h.
- Check for leaks along the seam.

## 6 Markings, packaging, and installation instructions

### 6.1 General

Products covered by and complying with this Standard shall be marked with

- the manufacturer's recognized name, trademark, or other mark; or
- in the case of private labelling, the name, trademark, or other mark of the customer for whom the fitting was manufactured.

The marking shall be accomplished by use of a permanent mark or by placing a permanent label on the product.

Markings shall be located in such a way so that they are visible after installation.

## 6.2 Packaging

Packaging shall be marked with

- a) the manufacturer's recognized name, trademark, or other mark as well as the model number; or
- b) in the case of private labelling, the name, trademark, or other mark of the customer for whom the fitting was manufactured as well as the model number.

## 6.3 Instructions for elastomeric waste fittings

Installation instructions shall be provided for elastomeric waste fittings and shall describe the methods for properly aligning the fittings.

## 6.4 Grey water diverters

### 6.4.1 Markings


The following shall be clearly marked on grey water diverters:

- a) the inlet;
- b) the outlet to the sanitary drainage system;
- c) the diversion outlet; and
- d) the direction of flow.


### 6.4.2 Instructions

Installation instructions shall be provided with grey water diverters. At a minimum, instructions shall indicate the direction of installation and how to operate and maintain the grey water diverter.


**Figure 1**  
**Sink and lavatory waste, trap, centre outlet, and patent overflow fittings**  
(See Clauses 3, 4.6.2, and 4.6.5.1.)

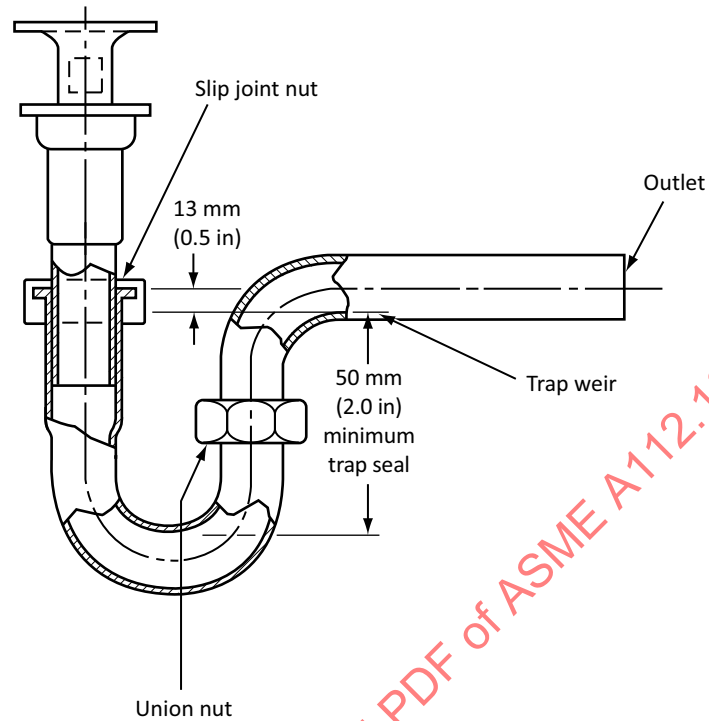

**Figure 2**  
**Trap wall adapter**  
(See Clauses 3 and 4.1.1.)

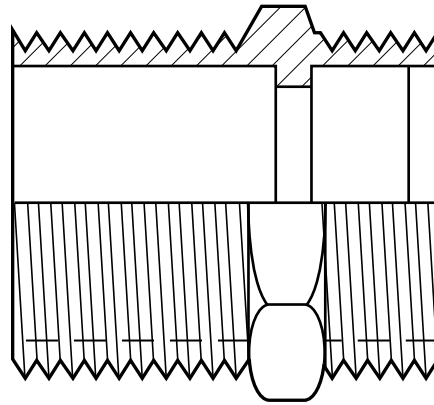

Male

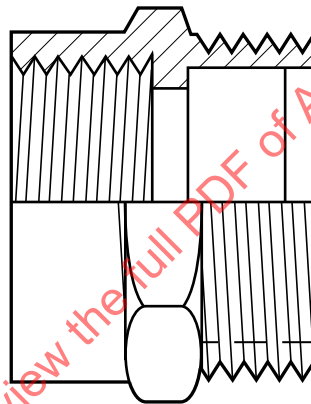

Female

**Figure 3**  
**Sink strainer**  
(See Clause 4.6.4.3.)

