

NFPA[®]

75

Standard for the
Fire Protection of
Information Technology Equipment

2020



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2019 National Fire Protection Association®. All Rights Reserved.

NFPA® 75

Standard for the

Fire Protection of Information Technology Equipment

2020 Edition

This edition of NFPA 75, *Standard for the Fire Protection of Information Technology Equipment*, was prepared by the Technical Committee on Electronic Computer Systems. It was issued by the Standards Council on November 4, 2019, with an effective date of November 24, 2019, and supersedes all previous editions.

This edition of NFPA 75 was approved as an American National Standard on November 24, 2019.

Origin and Development of NFPA 75

The Committee on Electronic Computer Systems was formed by the action of the NFPA Board of Directors in January 1960, following a request for standardization of fire protection recommendations by the computer industry.

The committee first submitted the *Standard for the Protection of Electronic Computer Systems* to the 1961 NFPA Annual Meeting, and it was tentatively adopted. At the 1962 Annual Meeting, it was officially adopted as an NFPA standard. Revisions were adopted in 1963, 1964, 1968, 1972, 1976, 1981, 1987, and 1989. The document was completely rewritten for the 1992 edition. The document was revised in 1995, 1999, and again in 2003. The 2003 edition incorporated the *Manual of Style for NFPA Technical Committee Documents* revisions.

In editions of this standard prior to 2003, the terms *electronic computer/data processing equipment* and *electronic computer system* were used where the current terms *information technology equipment* and *information technology equipment system*, respectively, are used. Similarly, the terms *computer room* and *computer area* were replaced by *information technology equipment room* and *information technology equipment area*, respectively. The title was changed from *Standard for the Protection of Electronic Computer/Data Processing Equipment* to *Standard for the Protection of Information Technology Equipment*. While the title and some terminology were changed in the 2003 edition to more closely align this standard's terminology with terminology being used in other standards, such as *NFPA 70, National Electrical Code*, and *UL 60950, Safety of Information Technology Equipment*, the scope of this standard and any definitions associated with those like terms remained the same.

For the 2009 edition, Section 4.2, Telecommunications Risks, was updated; many of the UL references were updated; new requirements were added for signage to indicate that equipment will remain energized where continuous power is provided; and flame spread indexes were provided for many of the materials listed in the standard.

For the 2013 edition, the title was again changed, to *Standard for the Fire Protection of Information Technology Equipment*, to better reflect the scope of the document and to be clear that the standard is strictly for fire protection. The 2013 edition featured a new section on the emerging use of aisle containment systems for information technology equipment and how such systems must be assessed for their interaction with fire protection features. A number of definitions were extracted from *NFPA 70* to define words used in the body of the standard that previously were not defined.

The 2017 edition of the standard was revised to permit performance-based designs for specific provisions of the standard. Chapter 4 was revised to state the approaches that are permitted to be followed (prescriptive or performance-based), and a new Chapter 5 was added that details the requirements when a performance-based approach is selected. This was done to account for changes in the operation of data centers that can require more flexibility than is often provided by prescriptive approaches.

Extensive annex material that provides guidance on designing detection for high airflow environments, including detector sensitivity and spacing, was added to the standard based on Fire Protection Research Foundation reports.

For the 2020 edition of the standard, air sampling detector port location and coverage was clarified. The requirement for inside hose stream was deleted as the fire department utilizes their own hose and will most likely not use the inside hose located in the structure. New Chapter 13, Modular Data Centers, was added to specify which requirements from other chapters apply to modular data centers. The requirements for 1- and 2-hour fire barriers were clarified for structures that contain multiple occupancies. Battery requirements were extracted from Chapter 52 of NFPA 1, *Fire Code*.

Technical Committee on Electronic Computer Systems

Lee A. Kaiser, *Chair*
Orr Protection Systems, Inc., KY [IM]

Scott R. Lang, *Secretary*
Honeywell International, IL [M]
Rep. Automatic Fire Alarm Association, Inc.

Mark J. Aaby, Koffel Associates, Inc., MD [SE]

Alastair R. Brown, HKA Global, Scotland [SE]

Thomas M. Burke, UL LLC, CA [RT]
Rep. UL LLC

Sheila C. DeMand, Aon, MO [I]

Jeffrey T. Dudley, National Aeronautics & Space Administration,
Kennedy Space Center (NASA), FL [U]

Jim Faber, Van Wagner Sports & Entertainment, TX [SE]

Vince Hawxhurst, Schneider Electric, MA [U]

Robert Kasiski, FM Global, MA [I]

Stanley Kaufman, CableSafe, Inc./OFS, GA [M]
Rep. Plastics Industry Association (Plastics)

Richard G. Kluge, Ericsson, NJ [U]
Rep. Alliance for Telecommunications Industry Solutions

James R. Lugar, JENSEN HUGHES, MD [SE]
Rep. JENSEN HUGHES

Chad Mariska, APS FireCo, OK [IM]
Rep. National Association of Fire Equipment Distributors

Rita L. Neiderheiser, UA Sprinkler Fitters LU 669, CO [L]

Michael Paras, Environmental Systems Design, Inc., IL [SE]

Keith J. Polasko, US National Security Agency, MD [E]

Jack Poole, Poole Fire Protection, Inc., KS [SE]

Bryan K. Powell, AXA XL/XL Risk Consulting/Global Asset
Protection Services, LLC, VA [I]

Rodger Reiswig, Johnson Controls, FL [M]

Mark L. Robin, Chemours, DE [M]
Rep. Fire Suppression Systems Association

Jason D. Rotondo, CODEpliance Inc., MA [U]

Joseph A. Spataro, American International Group, Inc., NY [I]

Derek P. Wester, Amerex Corporation, AL [M]
Rep. Fire Equipment Manufacturers' Association

Randy Willard, US Central Intelligence Agency, MD [U]

Kevin Wiseman, Allianz, TX [I]

Thomas J. Wysocki, Guardian Services, Inc., IL [SE]

Alternates

Wayne J. Aho, Jr., Johnson Controls, MA [M]
(Alt. to Rodger Reiswig)

Robert J. Ballard, Victaulic, PA [M]
(Alt. to Mark L. Robin)

Connie Bottemiller, Aon Global Risk, WA [I]
(Alt. to Sheila C. DeMand)

James S. Crews, Allianz, GA [I]
(Alt. to Kevin Wiseman)

Richard Ffrench, FM Global, RI [I]
(Alt. to Robert Kasiski)

Louis Guerrazzi, National Fire Sprinkler Association, MD [M]
(Voting Alt.)

Steven M. Guthrie, Global Asset Protection Services, LLC, PA [I]
(Alt. to Bryan K. Powell)

William D. Johnson, Mid State Fire Equipment Inc., FL [IM]
(Alt. to Chad Mariska)

Scott Kincaid, Brooks Equipment Company, NC [M]
(Alt. to Derek P. Wester)

William E. Koffel, Koffel Associates, Inc., MD [SE]
(Alt. to Mark J. Aaby)

Daniel Dean Lloyd, Munich Re/Hartford Steam Boiler, TX [I]
(Voting Alt.)

Max McLeod, Siemens Industry, Inc., AL [M]
(Alt. to Scott R. Lang)

Andrew W. Poole, Poole Fire Protection, Inc., KS [SE]
(Alt. to Jack Poole)

Randy H. Schubert, Ericsson, NJ [U]
(Alt. to Richard G. Kluge)

Blake M. Shugarman, UL LLC, IL [RT]
(Alt. to Thomas M. Burke)

Mark Suski, JENSEN HUGHES, IL [SE]
(Alt. to James R. Lugar)

Stacie K. Tunnessen, US Central Intelligence Agency, VA [U]
(Alt. to Randy Willard)

Anthony Villamor, Oracle America, Inc., CA [M]
(Voting Alt.)

Nonvoting

Edward D. Leedy, Naperville, IL [SE]
(Member Emeritus)

Donald E. Reilly, Staten Island, NY [I]
(Member Emeritus)

Richard P. Bielen, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the protection of electronic computer equipment, components, and associated records.

Contents

Chapter 1 Administration	75- 5	9.5 Warning Signs.	75- 14
1.1 Scope.	75- 5	9.6 Training.	75- 14
1.2 Purpose.	75- 5	9.7 Expansion or Renovations.	75- 14
1.3 Application.	75- 5	9.8 Water Mist Fire Protection Systems.	75- 14
1.4 Retroactivity.	75- 5		
1.5 Equivalency.	75- 5	Chapter 10 Records Kept or Stored in Information Technology Equipment Rooms	75- 15
Chapter 2 Referenced Publications	75- 5	10.1 Protection Required for Records Within the ITE Room.	75- 15
2.1 General.	75- 5	10.2 Records Stored Outside the ITE Room.	75- 15
2.2 NFPA Publications.	75- 5		
2.3 Other Publications.	75- 6	Chapter 11 Utilities	75- 15
2.4 References for Extracts in Mandatory Sections. ...	75- 6	11.1 Heating, Ventilating, and Air Conditioning (HVAC).	75- 15
Chapter 3 Definitions	75- 6	11.2 Coolant Systems.	75- 15
3.1 General.	75- 6	11.3 Electrical Service.	75- 15
3.2 NFPA Official Definitions.	75- 6	11.4 Supply Circuits and Interconnecting Cables.	75- 15
3.3 General Definitions.	75- 7	11.5 Uninterruptible Power Supplies (UPSs).	75- 16
3.4 Aisle Containment.	75- 8	Chapter 12 Emergency and Recovery Procedures	75- 19
Chapter 4 Fire Protection Approaches	75- 8	12.1 Emergency Fire Plan.	75- 19
4.1 Fire Protection Approach.	75- 8	12.2 Damage Control Plan.	75- 19
4.2 Fire Risk Assessment.	75- 8	12.3 Recovery Procedures Plan.	75- 19
4.3 Telecommunications Risks.	75- 9	Chapter 13 Modular Data Centers	75- 19
Chapter 5 Performance-Based Design Approach	75- 9	13.1 General.	75- 19
5.1 Performance-Based Design Approach.	75- 9	13.2 (Reserved).	75- 19
5.2 Goals and Objectives.	75- 9	13.3 (Reserved).	75- 19
5.3 Qualifications.	75- 9	13.4 Fire Protection Approaches.	75- 19
5.4 Independent Review.	75- 9	13.5 (Reserved).	75- 19
5.5 Final Determination.	75- 9	13.6 Construction Requirements.	75- 19
5.6 Maintenance of Design Features.	75- 9	13.7 Materials and Equipment Permitted in Modular Data Centers.	75- 19
5.7 Performance Criteria.	75- 9	13.8 (Reserved).	75- 19
Chapter 6 Construction Requirements	75- 9	13.9 Fire Protection and Detection Equipment.	75- 19
6.1 Building Construction.	75- 9	13.10 Records Kept or Stored in Modular Data Centers.	75- 20
6.2 Combustibility of Materials.	75- 10	13.11 Utilities.	75- 20
6.3 Location of ITE Area Within the Building.	75- 10	13.12 Emergency and Recovery Procedures.	75- 20
6.4 ITE Area Interior Construction Materials.	75- 10		
6.5 Raised Floors.	75- 11	Annex A Explanatory Material	75- 20
6.6 Penetrations and Openings in Fire-Resistant-Rated Enclosures.	75- 11	Annex B What to Do in the First 24 Hours for Damaged Electronic Equipment and Magnetic Media	75- 31
6.7 Aisle Containment and Hot Air Collar Systems for ITE.	75- 11	Annex C Risk Considerations, Business Interruption, and Temperature Considerations	75- 31
Chapter 7 Materials and Equipment Permitted in the Information Technology Equipment Area	75- 12	Annex D General Guidance for Gaseous Agent Systems in Information Technology Equipment Spaces	75- 32
7.1 General.	75- 12	Annex E Fire Detection for Information Technology Equipment Area Risks and Special Conditions	75- 33
7.2 Record Storage.	75- 12	Annex F Informational References	75- 34
7.3 General Storage.	75- 12	Index	75- 36
Chapter 8 Construction of Information Technology Equipment	75- 13		
8.1 ITE.	75- 13		
8.2 Construction Features.	75- 13		
Chapter 9 Fire Protection and Detection Equipment	75- 13		
9.1 Automatic Fire Protection Systems.	75- 13		
9.2 Automatic Detection Systems.	75- 13		
9.3 Portable Extinguishers.	75- 14		
9.4 Gaseous Total Flooding Extinguishing Systems. ...	75- 14		

NFPA 75

Standard for the

Fire Protection of Information Technology Equipment

2020 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex F.

Chapter 1 Administration

1.1 Scope. This standard covers the requirements for the protection of information technology equipment (ITE) and ITE areas.

1.2* Purpose. The purpose of this standard is to set forth the minimum requirements for the protection of ITE equipment and ITE areas from damage by fire or its associated effects — namely, smoke, corrosion, heat, and water.

1.3* Application. The application of this standard is based on the risk considerations outlined in Chapter 4.

1.3.1 A documented risk assessment shall be the basis for implementation of this standard.

1.3.2 The mere presence of the ITE shall not constitute the need to invoke the requirements of this standard.

1.3.3 If applied, the requirements of this standard shall include the installation of ITE in modular data centers, fabricated containers, and other groupings.

1.4 Retroactivity.

1.4.1 The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

1.4.2 Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

1.5 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard. Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency. The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2018 edition.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2018 edition.

NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*, 2018 edition.

NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*, 2018 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2020 edition.

NFPA 70®, *National Electrical Code*®, 2020 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2019 edition.

NFPA 76, *Standard for the Fire Protection of Telecommunications Facilities*, 2020 edition.

NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, 2019 edition.

NFPA 90A, *Standard for the Installation of Air-Conditioning and Ventilating Systems*, 2018 edition.

NFPA 101®, *Life Safety Code*®, 2018 edition.

NFPA 105, *Standard for Smoke Door Assemblies and Other Opening Protectives*, 2019 edition.

NFPA 220, *Standard on Types of Building Construction*, 2018 edition.

NFPA 232, *Standard for the Protection of Records*, 2017 edition.

NFPA 259, *Standard Test Method for Potential Heat of Building Materials*, 2018 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2017 edition.

NFPA 750, *Standard on Water Mist Fire Protection Systems*, 2019 edition.

NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, 2018 edition.

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 2018.

ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, 2016a.

ASTM E814, *Standard Method of Fire Tests of Through-Penetration Fire Stops*, 2013a, reapproved 2017.

ASTM E1354, *Standard Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter*, 2017.

ASTM E1537, *Standard Test Method for Fire Testing of Upholstered Furniture*, 2016.

ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-Shaped Airflow Stabilizer, at 750°C*, 2016.

2.3.2 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 72, *Standard for Tests for Fire Resistance of Record Protection Equipment*, 2015.

ANSI/UL 242, *Nonmetallic Containers for Waste Paper*, 2015.

ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*, 2018.

ANSI/UL 900, *Standard for Air Filter Units*, 2015.

ANSI/UL 1315, *Metal Waste Paper Containers*, 2017.

ANSI/UL 1479, *Standard for Fire Tests of Penetration Firestops*, 2015.

ANSI/UL 1564, *Standard for Industrial Battery Chargers*, 2014.

ANSI/UL 1778, *Uninterruptible Power Supply*, 2017.

ANSI/UL 1973, *Standard for Batteries for Use in Stationary, Vehicle Auxiliary Power and Light Electric Rail (LER) Applications*, 2007.

ANSI/UL 9540, *Standard for Safety for Energy Storage Systems and Equipment*, 2016.

ANSI/UL 60950, *Safety of Information Technology Equipment*, 2000, including revisions through October 30, 2007.

ANSI/UL 60950-1, *Information Technology Equipment — Safety — Part 1: General Requirements*, 2007.

ANSI/UL 62368-1, *Audio/Video, Information and Communication Technology Equipment — Part 1: Safety Requirements*, 2014.

2.3.3 Other Publications.

California Technical Bulletin 133, *Flammability Test Procedure for Seating Furniture for Use in Public Occupancies*, State of California, Department of Consumer Affairs, 1625 North Market Boulevard, Suite N-119, Sacramento, CA 95834.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 1, *Fire Code*, 2018 edition.

NFPA 70®, *National Electrical Code®*, 2017 edition.

NFPA 90A, *Standard for the Installation of Air-Conditioning and Ventilating Systems*, 2018 edition.

NFPA 101®, *Life Safety Code®*, 2018 edition.

NFPA 111, *Standard on Stored Electrical Energy Emergency and Standby Power Systems*, 2019 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards,

including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Abandoned Cables. Installed cables that are not terminated at equipment and not identified for future use with a tag.

3.3.2 Air Space. The space below a raised floor or above a suspended ceiling used to circulate environmental air within the ITE equipment room/ITE area.

3.3.3 Automated Information Storage System (AISS). An enclosed storage and retrieval system that moves recorded media between storage and ITE systems.

N 3.3.4 Battery Types Stationary.

N 3.3.4.1 Lithium-Ion Battery. A storage battery that consists of lithium-ions imbedded in a carbon graphite or nickel metal oxide substrate. The electrolyte is a carbonate mixture or a gelled polymer. The lithium-ions are the charge carriers of the battery. [1, 2018]

N 3.3.4.2 Nickel Cadmium (NiCd) Battery. An alkaline storage battery in which the positive active material is nickel oxide, the negative contains cadmium, and the electrolyte is potassium hydroxide. [1, 2018]

N 3.3.4.3* Valve-Regulated Lead Acid (VRLA). A lead-acid battery consisting of sealed cells furnished with a valve that opens to vent the battery whenever the internal pressure of the battery exceeds the ambient pressure by a set amount.

N 3.3.4.4* Vented (Flooded). A lead-acid battery consisting of cells that have electrodes immersed in liquid electrolyte.

3.3.5 Business Interruption. The effect on business operations from the time that equipment was initially lost or damaged until it has been restored to the former level of operation.

3.3.6 Communications Circuit. The circuit that extends voice, audio, video, data, interactive services, telegraph (except radio), outside wiring for fire alarm and burglar alarm from the communications utility to the customer's communications equipment up to and including terminal equipment such as a telephone, fax machine, or answering machine. [70:800.2]

3.3.7 Communications Equipment. The electronic equipment that performs the telecommunications operations for the transmission of audio, video, and data, and includes power equipment (e.g., dc converters, inverters, and batteries) and technical support equipment (e.g., computers), and conductors dedicated solely to the operation of the equipment. [70:100]

3.3.8 Detector.

3.3.8.1 Heat Detector. A fire detector that detects either abnormally high temperatures or rate of temperature rise, or both.

3.3.8.2 Smoke Detector. A device that senses visible or invisible particles of combustion.

3.3.9 Electronically Interconnected. Units that must be connected by a signal channel to complete a system or perform an operation.

3.3.10 Fire-Resistant-Rated Construction. Construction in which the structural members, including walls, partitions, columns, floors, and roof construction, have fire resistance ratings of time duration not less than that specified in this standard.

3.3.11 Fire Risk Analysis. A process to characterize the risk associated with fire that addresses the fire scenario or fire scenarios of concern, their probability, and their potential consequences.

3.3.12 Interconnecting Cables. Signal and power cables for operation and control of a system.

3.3.13* Information Technology Equipment (ITE). Equipment and systems rated 600 volts or less, normally found in offices or other business establishments and similar environments classified as ordinary locations, that are used for creation and manipulation of data, voice, video, and similar signals that are not communications equipment as defined in Part I of Article 100 and do not process communications circuits as defined in 800.2 [of NFPA 70]. [70:645.2]

3.3.14* ITE Area. An area of a building where the ITE room is located, including support rooms served by the same special air-conditioning/air-handling equipment as the ITE room.

3.3.15 ITE Room. A room within the ITE area that contains the ITE.

3.3.16* ITE System. Any electronic digital or analog computer, along with all peripheral, support, memory, programming, or other directly associated equipment, records, storage, and activities.

3.3.17 Material.

3.3.17.1 Combustible Material. A material that, in the form in which it is used and under the conditions anticipated, will ignite and burn; a material that does not meet the definition of noncombustible or limited-combustible.

3.3.17.2 Limited-Combustible Material. See 6.2.2.

3.3.17.3 Noncombustible Material. See 6.2.1.

N 3.3.17.4* Maximum Allowable Quantity (MAQ). The quantity of hazardous material permitted in a control area. [1, 2018]

N 3.3.18* Modular Data Center. Prefabricated units, rated 1000 volts or less, consisting of an outer enclosure housing multiple racks or cabinets of information technology equipment (ITE) (e.g., servers) and various support equipment, such as electrical service and distribution equipment, HVAC systems, and the like. [70:646.2]

3.3.19 Optical Fiber Cable. A factory assembly or field assembly of one or more optical fibers having an overall covering. [70:770.2]

3.3.20 Plenum. A compartment or chamber to which one or more ducts are connected and that forms part of the air distribution system. [90A, 2018]

3.3.21* Raceway. An enclosed channel of metallic or nonmetallic materials designed expressly for holding wires, cables, or busbars, with additional functions as permitted in NFPA 70.

3.3.22* Raised Floor. A platform with removable panels where equipment is installed, with the intervening space

between it and the main building floor used to house the interconnecting cables and at times is used as a means for supplying conditioned air to the ITE and the room.

3.3.23 Records.

3.3.23.1 Important Records. Records that could be reproduced only at considerable expense and labor or only after considerable delay.

3.3.23.2 Master Record. An information record on a medium that can be referred to whenever there is a need to rebuild a data base.

3.3.23.3 Vital Records. Records that are irreplaceable, such as records of which a reproduction does not have the same value as an original; records needed to sustain the business promptly or to recover monies used to replace buildings' equipment, raw materials, finished goods, and work in progress; and records needed to avoid delay in restoration of production, sales, and service.

3.3.24 Remote Disconnect Control. An electric device and circuit that controls a disconnecting means through a relay or equivalent device. [70:645.2]

3.3.25 Separate Fire Division. A portion of a building cut off from all other portions of the building by fire walls, fire doors, and other approved means adequate to prevent any fire that can occur in one fire division from extending to another fire division.

3.3.26* Support Equipment. Permanently installed equipment that is essential to the operation of ITE, as well as equipment temporarily used for maintenance, installation, or deinstallation of ITE.

N 3.3.27 Uninterruptible Power Supply (UPS). A device or system that provides quality and continuity of ac power through the use of a stored-energy device as the backup power source during any period when the normal power supply is incapable of performing acceptably. [111, 2019]

3.3.28 Water Sensor. A device or means that will detect the presence of water.

3.3.29 Zone. A physically identifiable area (such as barriers or separation by distance) within an ITE room, with dedicated power and cooling systems for the ITE or systems. [70:645.2]

3.4 Aisle Containment.

3.4.1* Aisle. The passageway between ITE or between ITE and a wall that allows personnel access to the ITE for service or operation of the equipment.

3.4.2* Aisle Containment. An HVAC method deployed in the occupied area of an air-cooled ITE space utilizing physical separation of hot exhaust air from cooler intake air between equipment cabinets, rows of ITE, or associated power and cooling infrastructure; containment is typically above and at both ends of a hot aisle or a cold aisle, in whole or part.

3.4.3* Cold Aisle. The aisle in front of the airflow intakes on the ITE where HVAC cooling airflow is controlled.

3.4.4* Hot Air Collar. An air conveyance assembly used to direct heated exhaust air from ITE cabinet(s), enclosure(s), or rack(s) directly to a return air path.

3.4.5* Hot Aisle. The aisle at the rear of the ITE where heated exhaust air is controlled and directed into the aisle for return to the HVAC equipment.

Chapter 4 Fire Protection Approaches

4.1 Fire Protection Approach. The fire protection approach for ITE systems, ITE rooms, and ITE areas shall be permitted to be determined based on an evaluation of fire risks and hazards associated with the site and services provided and the business continuity planning and disaster restoration capabilities of the ITE specific to the site.

4.1.1 The fire protection approach shall be established with consideration given to the following factors:

- (1) Exposure threat to facility occupants, the general public, emergency responders, and exposed property from a fire occurring at the facility, adjacent to or within ITE areas
- (2) The importance of the continuity of the data being stored or processed by the ITE
- (3) Methods and equipment employed as part of a risk management or business continuity strategy that allow data to remain viable during and after an event or to be replaced or restored
- (4) The potential for a given protection strategy to result in a service or data disruption or inhibit the ability of the data provider to restore operation and access to the data in a timely manner post-event

4.1.2 The fire protection approach shall be developed in conjunction with the considerations in 4.2.3 resulting in the use of one or both of the following strategies within ITE areas:

- (1) Prescriptive-based approaches in accordance with this standard
- (2) A fire risk-based approach in accordance with 4.1.3 and Section 4.2

4.1.3 A fire risk-based approach shall be permitted to be used to determine the construction, fire suppression, fire detection, and utility requirements for ITE systems, ITE rooms, and ITE areas where specifically permitted by this standard that are necessary to achieve the purpose of this standard. (See Section 1.2.)

4.2 Fire Risk Assessment.

4.2.1* The fire risk assessment permitted by 4.1.2 shall be documented and acceptable to the authority having jurisdiction (AHJ).

4.2.2 The fire risk assessment shall include an evaluation of the risk management considerations outlined in 4.2.3.

4.2.3* The following elements shall be considered to determine the level of acceptable fire risk documented as part of the fire risk assessment (see also Annex C):

- (1) Life safety aspects of the function (e.g., process controls, air traffic controls)
- (2) Fire threat of the installation to occupants or exposed property
- (3) Continuity of service, operation, and data access
- (4) Size and value of the ITE areas
- (5) Economic loss from loss of function or loss of records
- (6) Economic loss from value of equipment
- (7) Loss of customer data hosted on ITE
- (8) Regulatory impact

- (9) Reputation impact
- (10) Construction and compartmentation of the ITE areas
- (11) Fire suppression and detection features provided for the ITE areas
- (12) Response time to an alarm
- (13) Local fire-fighting capabilities
- (14) Redundant infrastructure, including off-site processing systems
- (15) Life safety of occupants of ITE areas and adjacent spaces, emergency responders, and general public

4.2.4 The fire risk assessment shall cover the entire ITE area, including all adjacent exposures.

4.2.5 An approved performance-based approach, in accordance with Chapter 5, shall be permitted to be applied selectively to specifically identified areas, hazards, or equipment or to specific fire protection requirements for an entire ITE area.

4.3 Telecommunications Risks.

4.3.1 Telecommunications Risks for the Private Network.

4.3.1.1 To assess and evaluate the damage and interruption potential of the loss of ITE room operations, a risk evaluation shall be conducted on the impact of the loss of data and communications.

4.3.1.2 The provisions of this standard shall apply to those areas housing telecommunications equipment that are part of a private network or where the need for protection has been determined by the risk evaluation outlined in 4.3.1.1.

4.3.2 Telecommunications Risks for the Public Networks.

4.3.2.1 NFPA 76 shall apply to telecommunications facilities that are part of the public network as outlined in the scope of NFPA 76.

4.3.2.2 The provisions of this standard shall not apply to telecommunications facilities that are part of the public network.

Chapter 5 Performance-Based Design Approach

5.1 Performance-Based Design Approach. The requirements of Chapter 5 shall apply to recognize performance-based practices.

5.2 Goals and Objectives. The performance-based design shall meet the following goals and objectives:

- (1) The performance-based approach allows the alternative means to be utilized for the elements of the ITE systems, ITE rooms, and ITE areas as permitted in this standard.
- (2) The risk analysis, design criteria, design brief, system performance, and testing criteria are developed in accordance with this section.
- (3) The design meets the scope and purpose of the standard as detailed in Sections 1.1 and 1.2.
- (4) The performance-based design provides equivalent performance to the prescriptive requirements of this standard.

5.3* Qualifications. The performance-based design documents shall be prepared by a licensed design professional with experience in fire protection, and acceptable to the AHJ.

5.4* Independent Review. The AHJ shall be permitted to require an approved, independent third party to review the

proposed design brief based on the documented fire risk assessment accepted by the AHJ to provide an evaluation of the design.

5.5 Final Determination. The authority having jurisdiction shall make the final determination as to whether the performance objectives have been met.

5.6 Maintenance of Design Features. The design features required for the ITE area to continue to meet the performance goals and objectives of this standard shall be maintained for the life of the building.

5.7 Performance Criteria.

5.7.1 General. All designs shall meet the goals and objectives specified in Section 5.2 and provided that the performance criterion of 5.7.2 is met and the design team concurs with the design and with the risk management considerations in 4.2.3.

5.7.2 Performance Criterion. The performance criterion shall include the protection of ITE systems and ITE areas from damage by fire or its associated effects, including smoke, corrosion, heat, and water.

5.7.3 Design Team. The design team shall comprise the design professional, the owner or owner's representative, representatives of the authority having jurisdiction, and representatives of the emergency response entities.

5.7.4* Design Brief. The design of the ITE area shall include the preparation of a design brief that is prepared utilizing recognized performance-based design practices.

5.7.4.1 Any deviation from a prescriptive requirement shall be detailed in the design brief.

5.7.4.2 Design specifications and briefs used in the performance-based design shall be clearly stated and shown to be realistic and sustainable.

5.7.4.3 Specific inspection, testing, or maintenance requirements that are necessary to maintain reliable performance of the fire safety features of the information technology area shall be stated in the design brief.

Chapter 6 Construction Requirements

6.1* Building Construction.

6.1.1 The ITE area shall be housed in a fully sprinklered building in accordance with NFPA 13 or housed in one of the following:

- (1) A building constructed in accordance with NFPA 220 Type I (443) or (332), or Type II (222) or (111) (*for nonsprinklered buildings, see 9.1.1.1*)
- (2) A single-story building constructed in accordance with NFPA 220 Type II (000) (*for nonsprinklered buildings, see 9.1.1.1*)

6.1.1.1 The building construction requirements in 6.1.1 shall be permitted to be modified where a risk assessment, as outlined in Chapter 4, identifies that an alternative means of construction is acceptable.

6.1.2* Protection for the building housing the ITE area shall be provided where it is subject to damage from external exposure.

6.1.3* The ITE area shall be separated from other occupancies within the building, including atria or other open-space construction, by fire-resistant-rated construction.

6.1.3.1 The ITE room shall be separated from other occupancies in the ITE area by fire-resistant-rated construction.

6.1.3.2 The fire resistance rating shall be commensurate with the exposure but not less than 1 hour for both.

6.1.3.3 The fire-resistant-rated enclosures shall extend from the structural floor to the structural floor above or to the roof.

6.1.3.4 Every opening in the fire-resistant-rated construction shall be protected to limit the spread of fire and to restrict the movement of smoke from one side of the fire-resistant-rated construction to the other. The fire resistance rating for doors shall be as follows:

- (1) 2-hour fire-resistant-rated construction — 1½-hour fire-resistance-rated doors
- (2) 1-hour fire-resistant-rated construction — ¾-hour fire-resistance-rated doors

6.1.3.5 The fire-resistant-rated construction shall be in accordance with NFPA 101 and applicable building and fire codes.

Δ 6.1.3.6 Under the following conditions, the fire separation requirements of 6.1.3 through 6.1.3.4 shall be permitted to be evaluated as part of the risk assessment as outlined in Chapter 4:

- (1) The anticipated fire exposures are documented.
- (2) Alternate forms of fire separation are provided based on the anticipated fire exposures.

6.2* Combustibility of Materials.

6.2.1 Noncombustible Material. [101:4.6.13]

6.2.1.1 A material that complies with any of the following shall be considered a noncombustible material:

- (1)* A material that, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat
- (2) A material that is reported as passing ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*
- (3) A material that is reported as complying with the pass/fail criteria of ASTM E136 when tested in accordance with the test method and procedure in ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-Shaped Airflow Stabilizer, at 750°C*

[101:4.6.13]

6.2.1.2 Where the term *limited-combustible* is used in this standard, it shall also include the term *noncombustible*. [101:4.6.13.2]

6.2.2 Limited-Combustible Material. A material shall be considered a limited-combustible material where one of the conditions of 6.2.2.1 and 6.2.2.2, and the conditions of either 6.2.2.3 or 6.2.2.4, are met. [101:4.6.14]

Δ 6.2.2.1 The material shall not comply with the requirements for noncombustible material in accordance with 6.2.1. [101:4.6.14.1]

6.2.2.2 The material, in the form in which it is used, shall exhibit a potential heat value not exceeding 3500 Btu/lb (8141

kJ/kg) where tested in accordance with NFPA 259. [101:4.6.14.2]

Δ 6.2.2.3 The material shall have the structural base of a noncombustible material with a surfacing not exceeding a thickness of ⅛ in. (3.2 mm) where the surfacing exhibits a flame spread index not greater than 50 when tested in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*. [101:4.6.14.3]

6.2.2.4* The material shall be composed of materials that, in the form and thickness used, neither exhibit a flame spread index greater than 25 nor evidence of continued progressive combustion when tested in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*, and shall be of such composition that all surfaces that would be exposed by cutting through the material on any plane would neither exhibit a flame spread index greater than 25 nor exhibit evidence of continued progressive combustion when tested in accordance with ASTM E84 or ANSI/UL 723. [101:4.6.14.4]

6.2.2.5 Where the term *limited-combustible* is used in this standard, it shall also include the term *noncombustible*. [101:4.6.14.5]

6.3 Location of ITE Area Within the Building.

6.3.1* The ITE area shall not be located above, below, or adjacent to areas or other structures where hazardous processes are located unless approved protective features are provided.

6.3.2* Access to the ITE area shall be restricted to authorized persons.

6.3.3* A structural floor where an ITE system is located or that supports a raised floor installation shall incorporate provisions to allow for removal of leaks from chilled water, heating water, steam condensate, domestic water, liquid coolants, or water from sprinklers or fire-fighting operations.

6.3.3.1* One or more of the following methods shall be used for liquid removal:

- (1) Floor drain(s)
- (2) Liquid containment with removal pumps
- (3) Alternate methods as approved by the AHJ

6.3.3.2* Underfloor spaces shall be provided with a leak detection system where any utility fluids or computer auxiliary cooling fluids are piped into the ITE room or are capable of entering the room from adjoining areas.

6.3.4 Where an alternate solution, such as containment with leak detection, is provided, the drainage requirements in 6.3.3 shall be permitted to be evaluated as part of the performance-based risk analysis as outlined in Chapters 4 and 5.

6.4 ITE Area Interior Construction Materials.

6.4.1 All interior wall and ceiling finishes in the ITE area shall have a Class A rating in accordance with NFPA 101.

6.4.1.1 Interior wall and ceiling finishes in fully sprinklered ITE areas shall be permitted to be Class B in accordance with NFPA 101.

6.4.1.2 Interior floor finishes used in ITE areas shall be Class I in accordance with NFPA 101.

6.4.1.2.1 Interior floor finishes in fully sprinklered ITE areas shall be permitted to be Class II in accordance with NFPA 101.

6.4.1.3 Exposed cellular plastics shall not be used in ITE area construction.

6.5* Raised Floors. Where raised floors are used, they shall comply with 6.5.1 through 6.5.4.

6.5.1 Structural supporting members for raised floors shall be of noncombustible material.

6.5.2 Decking for raised floors shall be one of the following:

- (1) Noncombustible
- (2) Pressure-impregnated, fire-retardant-treated lumber having a flame spread index of 25 or less in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*
- (3) Wood or similar core material that is encased on the top and bottom with sheet, cast, or extruded metal, with all openings or cut edges covered with metal or plastic clips or grommets so that none of the core is exposed, and that has an assembly flame spread index of 25 or less in accordance with ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*

6.5.3 Access sections or panels shall be provided in raised floors so that all the space beneath is accessible. Tools needed to provide access to the underfloor space shall be located in the room, and their location shall be well marked.

6.5.4* Electric cable openings in floors shall be made smooth or shall be otherwise protected to preclude the possibility of damage to the cables.

6.6 Penetrations and Openings in Fire-Resistant-Rated Enclosures.

Δ 6.6.1 Cable penetrations or other penetrations through required fire-rated assemblies shall be firestopped with a listed firestop system that has a rating as specified in 6.6.1.1 and 6.6.1.2 where tested with minimum positive furnace pressure differential of 2.5 Pa (0.01 in. of water) under ASTM E814, *Standard Method of Fire Tests of Through-Penetration Fire Stops*, or ANSI/UL 1479, *Standard for Fire Tests of Penetration Firestops*.

N 6.6.1.1 F Ratings. Firestop systems and devices shall have an F rating of not less than 1 hour, and not less than the required fire resistance rating of the barrier penetrated. [101:8.3.4.2.3]

N 6.6.1.2 T Ratings. Penetrations in fire resistance-rated horizontal assemblies shall have a T rating of not less than 1 hour, and not less than the fire resistance rating of the horizontal assembly. [101:8.3.4.2.4.1]

N 6.6.1.2.1 A T rating shall not be required for either of the following:

- (1) Floor penetrations contained within the cavity of a wall assembly
 - (2) Penetrations through floors or floor assemblies where the penetration is not in direct contact with combustible material
- [101:8.3.4.2.4.2]

6.6.2 Pass-throughs or windows located in fire-resistant-rated construction shall be equipped with an automatic fire-rated shutter, a service counter fire door, or fire-rated windows installed and maintained in accordance with NFPA 80.

6.6.2.1 The shutters, service counter door, or windows shall be operated automatically by the presence of either smoke or fire on either side of the wall.

6.6.2.2 The fire rating of the shutters, service counter door, or windows shall not be less than the fire rating of the wall in which it is located.

6.6.3 All air ducts and air transfer openings passing through fire-resistant-rated construction shall be provided with automatic fire and smoke dampers.

6.6.3.1* Fire and smoke dampers shall be installed in accordance with NFPA 90A.

6.6.3.2 Fire dampers shall be maintained in accordance with NFPA 80.

6.6.3.3 Smoke dampers and combination fire/smoke dampers shall be maintained in accordance with NFPA 105.

6.7* Aisle Containment and Hot Air Collar Systems for ITE.

6.7.1 Aisle containment and hot air collar systems shall be permitted to be one of the following:

- (1) Factory-packaged and aftermarket: systems designed, provided, and installed in accordance with the manufacturer's instructions
- (2) Field-constructed: systems designed and constructed using common construction materials

6.7.2 Both types of aisle containment systems shall comply with 6.7.3 through 6.7.10.1.

6.7.3 Elements of aisle containment and hot air collars shall be constructed of materials that have a maximum flame spread index of 50 and a maximum smoke development of 450 in accordance with one or more of the following:

- (1) ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*
- (2) ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*

6.7.4* Aisle containment systems and hot air collars shall not be considered to be plenums.

6.7.5 Aisle containment systems shall be permitted to be applied to hot aisles or cold aisles of ITE.

6.7.6* Detection and suppression components within aisle containment systems shall be rated for the intended temperatures of hot aisles when installed in those locations.

6.7.7 Where aisle containment systems are installed, the existing suppression and detection systems shall be evaluated, modified, and tested as necessary to maintain compliance with the applicable codes and standards.

6.7.8 Where automatic sprinklers are present and the application of aisle containment systems or hot air collars creates obstructions to proper operation of sprinkler systems, the sprinkler system shall be modified as necessary to comply with NFPA 13.

▲ 6.7.8.1* Sprinkler system modifications shall not be required where all of the following conditions are met:

- (1)* An automatic means of smoke detection initiates the removal of the obstruction prior to operation of the suppression system.
- (2) Removing the obstruction or a portion thereof does not compromise means of egress per NFPA 101.
- (3) The design and installation of removable obstruction elements does not diminish the level of protection that existed prior to the installation of the aisle containment or hot air collar.
- (4)* The releasing devices are listed for the application.
- (5) All removable obstructions are removed for the entire suppression zone.

6.7.9 Where gaseous suppression systems are present, they shall be designed to develop the required concentration of agent for the entire volume they serve, in accordance with NFPA 2001.

▲ 6.7.10 If the aisle containment prevents the gaseous suppression system, where present, from producing the required design concentrations, the gaseous suppression system shall be modified to produce the required concentration throughout the volume served.

▲ 6.7.10.1* Gaseous suppression system modifications shall not be required where all the following conditions are met:

- (1)* An automatic means of smoke detection initiates the removal of the obstruction prior to the suppression system operation.
- (2) Removing the obstruction or portion thereof does not compromise means of egress per NFPA 101.
- (3) The design and installation of removable obstruction elements does not diminish the level of protection that existed prior to the installation of the aisle containment or hot air collar.
- (4)* The releasing devices are listed for the application.
- (5) All removable obstructions are removed for the entire suppression zone.

Chapter 7 Materials and Equipment Permitted in the Information Technology Equipment Area

7.1 General.

7.1.1* Only ITE and support equipment shall be permitted in the ITE room.

7.1.2 Small work areas shall be permitted within the ITE room provided all the following conditions are met:

- (1) Areas are not occupied on a full-time basis.
- (2) Case furniture, including desks, is constructed of noncombustible material (e.g., metal). The construction can include a high-pressure laminate veneer on the desktop.
- (3) Space dividers and system furniture panels and chairs with upholstered assemblies exhibit a maximum rate of heat release not exceeding 80 kW and a maximum total heat release not exceeding 25 MJ within the first 10 minutes of test where tested in accordance with one of the following:
 - (a) ASTM E1537, *Standard Test Method for Fire Testing of Upholstered Furniture*

(b) California Technical Bulletin 133, *Flammability Test Procedure for Seating Furniture for Use in Public Occupancies*

- (4) Paper records, manuals, drawings, and all other combustible materials are stored in fully enclosed noncombustible cabinets or cases.
- (5) The quantity of records, manuals, drawings, and all other combustible materials kept in the room are limited to the absolute minimum required for essential and efficient operation.
- (6) Trash receptacles, where provided, are listed, provided with tight-fitting or self-closing lids, and constructed of materials that are either noncombustible or meet a peak heat release rate not exceeding 300 kW/m² where tested in accordance with ASTM E1354, *Standard Test Method for Heat and Visible Smoke Release Rates for Materials and Products Using an Oxygen Consumption Calorimeter*, at an incident heat flux of 50 kW/m² in the horizontal orientation, ANSI/UL 242, *Nonmetallic Containers for Waste Paper*, or ANSI/UL 1315, *Metal Waste Paper Containers*.

7.2 Record Storage.

7.2.1 The amount of records within the ITE room shall be kept to the absolute minimum required for essential and efficient operation.

7.2.1.1 Only records that are essential to the ITE operations shall be permitted to be kept in the ITE room.

7.2.1.2 An automated information storage system (AISS) conforming to the requirements of 9.1.4 shall be permitted in the ITE room.

7.2.2 Tape libraries and record storage rooms within the ITE area shall be protected by an extinguishing system and separated from the ITE room and other portions of the ITE area by fire-resistant-rated construction. The fire resistance rating shall be commensurate with the exposure but not less than 1 hour.

7.2.3 The records storage room shall be used only for the storage of records.

7.2.3.1 All other operations, including splicing, repairing, erasing, reproducing, cataloging, and so forth, shall be prohibited in this room.

7.2.3.2 Spare media shall be permitted to be stored in this room if they are unpacked and stored in the same manner as the media containing records.

7.3 General Storage.

7.3.1 Paper stock, inks, unused recording media, and other combustibles within the ITE room shall be restricted to the absolute minimum necessary for efficient operation. Any such materials in the ITE room shall be kept in totally enclosed metal file cases or cabinets or, if provided for in individual machine design, shall be limited to the quantity prescribed and located in the area designated by the equipment manufacturer.

7.3.2 Reserve stocks of paper, inks, unused recording media, and other combustibles shall be stored outside the ITE room.

7.3.3 The space beneath the raised floor shall not be used for storage purposes.

■ 7.3.4 Storage in Battery Rooms. Combustible material shall not be stored in battery rooms, battery cabinets, or battery enclosures.

Chapter 8 Construction of Information Technology Equipment

8.1 ITE.

8.1.1 Equipment and replacement parts shall meet the requirements of ANSI/UL 60950, *Safety of Information Technology Equipment*; ANSI/UL 60950-1, *Information Technology Equipment — Safety — Part 1: General Requirements*; or ANSI/UL 62368-1, *Audio/Video, Information and Communication Technology Equipment — Part 1: Safety Requirements*.

8.1.2* Each individual unit shall be constructed in such a way that by limiting combustible materials or by use of enclosures, fire is not likely to spread beyond the unit where the source of ignition is located. Automatic protection shall be provided for all units not so constructed.

8.1.3 Listed ITE shall be considered as meeting the requirements of 8.1.2.

8.1.4* Enclosures of floor-standing equipment having external surfaces of combustible materials of such size that can contribute to the spread of an external fire shall have a flame spread index of 50 or less in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*.

8.1.4.1 Equipment conforming to the requirements of ANSI/UL 60950, *Safety of Information Technology Equipment*; ANSI/UL 60950-1, *Information Technology Equipment — Safety — Part 1: General Requirements*; or ANSI/UL 62368-1, *Audio/Video, Information and Communication Technology Equipment — Part 1: Safety Requirements*, shall be considered as meeting the requirements of 8.1.4.

8.2 Construction Features. If the design of the unit is such that oil or equivalent liquid is required for lubrication, cooling, or hydraulic purposes, it shall have a closed-cup flash point of 149°C (300°F) or higher, and the container shall be of a sealed construction, incorporating automatic pressure relief devices.

8.2.1* Acoustical Materials. (Reserved)

Chapter 9 Fire Protection and Detection Equipment

9.1 Automatic Fire Protection Systems.

9.1.1 ITE rooms and ITE areas located in a sprinklered building shall be provided with an automatic sprinkler system.

9.1.1.1 ITE rooms and ITE areas located in a nonsprinklered building shall be provided with one or more automatic fire suppression systems as permitted by Chapter 9.

9.1.1.2 The requirement of 9.1.1.1 shall be permitted to be evaluated as part of the fire risk assessment as outlined in Chapter 4.

9.1.1.3* An automatic fire suppression system, as permitted by Chapter 9, shall be provided for the protection of the area below a raised floor in an ITE room or ITE area where the area below the raised floor contains combustible material other than what is permitted in 9.1.1.4.

9.1.1.4 An automatic fire suppression system shall not be required for the protection of the area below a raised floor in

an ITE room or ITE area where combustible material under the floor is limited to the following:

- (1) Cables listed for plenum use
- (2) Listed plenum communications raceways
- (3) Listed equipment power cords up to 4.6 m (15 ft) each
- (4) Cables installed in metallic raceways
- (5) Installations in compliance with Section 300.22(C) of *NFPA 70*
- (6) Listed cooling hoses

9.1.1.5 Where a gaseous fire extinguishing system is provided only under a raised floor, the gaseous system shall be either carbon dioxide or an inert gas.

9.1.1.6 Where a clean agent fire extinguishing system is provided to protect the space above the raised floor, the space under the raised floor shall be simultaneously protected by the clean agent fire extinguishing system.

9.1.2* Automatic sprinkler systems protecting ITE rooms or ITE areas shall be installed in accordance with *NFPA 13*.

9.1.3 Sprinkler systems protecting ITE areas shall be valved separately from other sprinkler systems.

9.1.3.1 Valves shall be in an approved location that is exterior to the room, readily accessible, and labeled as to what they control.

9.1.4* Automated information storage system (AISS) units containing combustible media with an aggregate storage capacity of more than 0.76 m³ (27 ft³) shall be protected within each unit by an automatic sprinkler system or a gaseous agent extinguishing system with extended discharge.

9.1.5 The requirement of 9.1.4 shall be permitted to be evaluated as part of the fire risk assessment as outlined in Chapter 4.

9.1.6 Automatic sprinkler systems protecting ITE rooms or ITE areas shall be maintained in accordance with *NFPA 25*.

9.2* Automatic Detection Systems.

9.2.1 Automatic detection equipment shall be installed to provide early warning of fire.

9.2.1.1 The equipment used shall be a listed smoke detection-type system installed and maintained in accordance with *NFPA 72*.

9.2.1.2 Each of the ITE areas, including aisle containment and hot air collar systems, where present, shall be evaluated to determine the hazards and ambient conditions that are present and the corresponding performance level of the detection system.

9.2.2* Automatic detection systems shall be installed to provide early warning of fire in the following locations:

- (1) At the ceiling level throughout the ITE area
- (2) Below the raised floor of the ITE area containing cables
- (3)* In the exhaust/return air stream where aisle containment systems are used
- (4) In the return air stream where the above ceiling area is used as a return air plenum

9.2.2.1 Smoke detectors or sampling ports installed on return air openings shall have a coverage area of no more than 0.4 m² (4 ft²).

N 9.2.3* Where detection is used for the monitoring of fire in individual ITE cabinets, the following shall be met:

- (1) Detectors or sampling ports shall be located in the main airflow at the exhaust vents, downstream of the airflow distribution path, or in accordance with the manufacturer's published instructions.
- (2) Multiple detectors or ports shall be provided when the cabinet has multiple outlet vents.
- (3) If the cabinet is compartmentalized, each compartment shall have a detector or port.
- (4) Where cabinets are fitted with in-cabinet suppression systems, the detection system shall provide an alarm signal for each cabinet or group of cabinets if the suppression system is to be released into several cabinets simultaneously.

N 9.2.4 Where detection is used for the monitoring of fire in ITE equipment with close-coupled cooling units, detectors or sampling ports shall be provided at the return inlets.

9.2.5 In the ITE area, where the space above the suspended ceiling or below the raised access floor is used to circulate air to other parts of the building, automatic smoke detection shall be installed in one of the following locations to operate the smoke dampers required by 6.6.3:

- (1) Throughout the above ceiling space or below raised access floor space
- (2) At each smoke damper
- (3) At other approved locations to detect smoke entering or exiting the ITE area

9.2.6 Where interlock and shutdown devices are provided, the electrical power to the interlocks and shutdown devices shall be supervised by the fire alarm control panel.

9.2.7 Where power is required for the operation of the disconnecting means in 11.4.5, that electrical power shall be supervised by the fire alarm control panel.

9.2.8 The alarms and trouble signals of automatic detection or extinguishing systems shall be arranged to annunciate at a constantly attended location.

Δ 9.3 Portable Extinguishers.

9.3.1 Listed portable fire extinguishers of the carbon dioxide type or a halogenated agent type shall be provided for the protection of electronic equipment. The extinguishers shall be maintained in accordance with NFPA 10.

9.3.2* Listed extinguishers with a minimum rating of 2-A shall be provided for use on fires in ordinary combustible materials, such as paper and plastics. Dry chemical extinguishers shall not be permitted.

9.3.3 A sign shall be located adjacent to each portable extinguisher and shall plainly indicate the type of fire for which it is intended.

• 9.4 Gaseous Total Flooding Extinguishing Systems.

9.4.1* Where there is a critical need to protect data in process, reduce equipment damage, and facilitate return to service, consideration shall be given to the use of a gaseous agent inside units or total flooding systems in sprinklered or nonsprinklered ITE areas.

9.4.2 Where gaseous agent or inert gas agent total flooding systems are used, they shall be designed, installed, and main-

tained in accordance with the requirements of NFPA 12, NFPA 12A, or NFPA 2001. The agent selected shall not cause damage to the ITE systems and media. (See Annex D.)

9.4.2.1 The power to all electronic equipment shall be disconnected upon activation of a gaseous agent total flooding system, unless the risk considerations outlined in Chapter 4 indicate the need for continuous power.

9.4.3* Hot aisle or cold aisle containment systems shall not obstruct the free flow of gaseous clean agent suppression systems to the ITE or cooling system serving the contained aisle within an ITE room or zone.

9.4.4* Gaseous agent systems shall be automatically actuated by an approved method of detection meeting the requirements of NFPA 72 and a listed releasing device compatible with the system.

9.4.5* Where operation of the air-handling system would exhaust the agent supply, it shall be interlocked to shut down when the extinguishing system is actuated.

9.4.6* Alarms shall be provided to give positive warning of a pending discharge and an actual discharge.

9.5 Warning Signs. Where continuous power is provided, signs shall be posted at each perimeter entrance to the ITE areas warning that electrical equipment will remain energized, either upon activation of the suppression system or disconnect of main electrical service.

9.6 Training. Designated ITE area personnel shall be continually and thoroughly trained in the functioning of the alarm system, desired response to alarm conditions, location of all emergency equipment and tools, and use of all available extinguishing equipment. This training shall encompass both the capabilities and the limitations of each available type of extinguisher and the proper operating procedures of the extinguishing systems.

9.7 Expansion or Renovations.

9.7.1 Whenever changes are made to the ITE area — for example, size, installation of new partitions, modification of the air-handling systems, or revised ITE layout — the potential impact on existing fire detection and extinguishing systems shall be evaluated and corrective changes shall be made if necessary.

9.7.2 Modifications or alterations as outlined in 9.7.1 shall be submitted to the AHJ for approval.

9.8 Water Mist Fire Protection Systems.

9.8.1 Where provided, water mist fire protection systems shall be installed in accordance with the requirements of NFPA 750.

9.8.2 Water mist fire protection systems shall be designed and installed for the specific hazards and protection objectives specified in the listing.

9.8.3 Detection systems utilized for the operation of water mist fire protection systems shall be installed in accordance with the listing criteria.

Chapter 10 Records Kept or Stored in Information Technology Equipment Rooms

10.1* Protection Required for Records Within the ITE Room. Any records regularly kept or stored in the ITE room shall be provided with the following protection:

- (1) Vital or important records that have not been duplicated shall be stored in listed record protection equipment with a Class 150 1-hour or better fire resistance rating as outlined in ANSI/UL 72, *Standard for Tests for Fire Resistance of Record Protection Equipment*.
- (2) All other records shall be stored in closed metal files or cabinets.

10.2 Records Stored Outside the ITE Room.

10.2.1* All vital and important records shall be duplicated. Duplicated records shall be stored in a remote location that would not be exposed to a fire involving the original records. Records shall be stored in fire-resistive rooms in accordance with NFPA 232.

▲ **10.2.2** The installation of portable extinguishing equipment shall be in accordance with [Section 9.3](#).

Chapter 11 Utilities

11.1 Heating, Ventilating, and Air Conditioning (HVAC).

11.1.1 All materials and products, including the materials of construction of the HVAC system, shall comply with the requirements of NFPA 90A.

11.1.2* Any HVAC system that serves other occupancies shall also be permitted to serve the ITE area.

11.1.3 Dampers in HVAC systems serving ITE areas shall operate upon activation of smoke detectors and by operation of the disconnecting means required by 11.4.5. The automatic fire and smoke dampers required by 6.6.3 shall also operate upon activation of smoke detectors and by operation of disconnecting means required by 11.4.5.

11.1.4 Air ducts that pass through the information technology area and only serve other rooms shall be provided with fire dampers.

11.1.5 All pipe and duct insulation and linings, including vapor barriers and coatings, shall have a flame spread index of 25 or less without evidence of continued progressive combustion and a smoke developed index no higher than 50, in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*.

11.1.6* Air filters for use in air-conditioning systems shall comply with the requirements of ANSI/UL 900, *Standard for Air Filter Units*.

11.2 Coolant Systems. If a separate coolant system is required for operation of an ITE installation, it shall be provided with an approved alarm to indicate loss of fluid.

11.3* Electrical Service. Equipment, power-supply wiring, equipment interconnecting wiring, and grounding of ITE and systems in an ITE room shall comply with this section.

11.3.1* Installation of all electrical equipment and wiring and all optical fiber cabling shall conform to NFPA 70.

11.3.2 Transformers installed in the ITE area shall be of the dry type or the type filled with a noncombustible dielectric medium. Such transformers shall be installed in accordance with the requirements of NFPA 70, Article 450.

11.3.3 Service entrance transformers shall not be permitted in the electronic ITE area.

11.3.4* Protection against lightning surges shall be provided in accordance with the requirements of Articles 280 and 285 of NFPA 70.

11.3.5 Emergency lighting shall be provided in the ITE area.

11.3.6 All electrical wiring and optical fiber cabling in the air space above a suspended ceiling shall conform to the requirements in NFPA 90A for installation in a ceiling cavity plenum and to the requirements in NFPA 70 for installation in "other spaces used for environmental air" when that air space is used for the movement of air.

11.3.7* Signal wiring and cabling, including optical fiber cables, installed in an air space below a raised floor shall be listed.

11.3.7.1 Where the air space below a raised floor is protected by an automatic fire suppression system, signal wiring and cabling listed for plenum, riser, and general-purpose use shall be permitted to be installed exposed to the airflow in the air space.

11.3.7.2 Where the air space below a raised floor is not protected by an automatic fire suppression system, only signal wiring and cabling listed for plenum use shall be permitted to be installed exposed to the airflow in the air space.

11.3.7.3 Where the air space below a raised floor is not protected by an automatic fire suppression system, signal wiring and cabling listed for plenum, riser, and general-purpose use shall be permitted to be installed in metal raceways in the air space.

11.3.8 Electrical power supply cords up to 4.6 m (15 ft) in length shall be permitted in an air space below a raised floor.

11.4 Supply Circuits and Interconnecting Cables.

11.4.1 Interconnecting Cables. Separate ITE units shall be permitted to be interconnected by means of listed cables and cable assemblies.

11.4.2 The 4.6 m (15 ft) limitation on power cords shall not apply to interconnecting cables.

11.4.3* Abandoned Cables. The accessible portion of abandoned cables shall be removed unless contained in a raceway.

• 11.4.4 Installed Circuits and Cables Identified for Future Use.

11.4.4.1 Circuits and cables shall be permitted to be installed in ITE areas and identified for future use if they comply with 11.4.4.2 and 11.4.4.3.

11.4.4.2 The circuits and cables shall be marked with a tag of sufficient durability to withstand the environment involved.

11.4.4.3 The tags shall have the following information:

- (1) Date identified for future use
- (2) Date of intended use
- (3) Information relating to the intended future use

11.4.5 Disconnecting Means.

11.4.5.1* An approved means shall be provided to disconnect power to all electronic equipment in the ITE room or in designated zones within the room.

11.4.5.2* There shall be a similar approved means to disconnect the power to all dedicated HVAC systems serving the room or designated zones.

11.4.5.3 Activation of an HVAC disconnecting means shall cause all required fire/smoke dampers to close.

11.4.5.4* Disconnecting means shall be implemented by one of the methods listed in 11.4.5.4.1 through 11.4.5.4.2.

11.4.5.4.1 Remote Disconnect Controls.

11.4.5.4.1.1 Remote disconnect controls shall be located at approved locations readily accessible in case of fire to authorized personnel and emergency responders.

11.4.5.4.1.2 The remote disconnect controls for the control of electronic equipment power and HVAC systems shall be grouped and identified.

11.4.5.4.1.3 A single means to control electronic equipment power and HVAC systems shall be permitted.

11.4.5.4.1.4 Where multiple zones are created, each zone shall have an approved means to confine fire or products of combustion to within the zone.

11.4.5.4.1.5 Additional means to prevent unintentional operation of remote disconnect controls shall be permitted.

11.4.5.4.2 Alternative Disconnecting Means. Remote disconnecting controls shall not be required where all the following criteria are met:

- (1) An approved procedure has been established and maintained for removing power and air movement within the room or zone.
- (2) Qualified personnel are continuously available to advise emergency responders and to instruct them of disconnecting methods.
- (3) A smoke-sensing fire detection system is in accordance with Chapter 9.
- (4) An approved fire protection system is in accordance with Chapter 9.
- (5) Cables installed under a raised floor, other than branch circuit wiring and power cords, are installed in compliance with *NFPA 70*, Sections 645.5(D)(2) or (3), or are in compliance with *NFPA 70*.

11.4.5.5* Installations qualifying under the provisions of *NFPA 70*, Article 685, shall be permitted.

11.4.6 Marking. Each unit of an information technology system supplied by a branch circuit shall be provided with a manufacturer's nameplate, which shall also include the input power requirements for voltage, frequency, and maximum rated load in amperes. [70:645.16]

Δ 11.5 Uninterruptible Power Supplies (UPSs).

Δ 11.5.1 UPS Systems. UPS systems installed within the information technology equipment [ITE] room, and their supply and output circuits, shall comply with 11.4.5, except for the following installations and constructions:

- (1) Installations complying with Article 685
- (2) Power sources limited to 750 volt-amperes or less derived either from UPS equipment or from battery circuits integral to electronic equipment [70:645.11]

N 11.5.1.1 The disconnecting means shall also disconnect the battery from its load. [70:645.11]

11.5.1.2 Storage battery systems in the ITE area shall comply with the requirements of *NFPA 70*, Article 480.

• N 11.5.2 Batteries. Batteries used in ITE UPS systems exceeding the quantities in 11.5.3.1 and 11.5.4.1 shall comply with this chapter.

N 11.5.2.1 Location and Occupancy Separation. [1:52.2.2.3]

N 11.5.2.1.1 Battery systems shall be permitted in the same room as the equipment that they support. [1:52.2.2.3.1]

N 11.5.2.1.2 Battery systems shall be housed in a noncombustible, locked cabinet or other enclosure to prevent access by unauthorized personnel unless located in a separate equipment room accessible only to authorized personnel. [1:52.2.2.3.2]

N 11.5.2.1.3 Battery systems shall be located in a room separated from other portions of the building by a minimum of a 1-hour fire barrier.

N 11.5.2.1.4 Where the ITE is located in a structure or building housing multiple tenants or occupancies that include business, industrial, mercantile, or storage, battery systems shall be located in a room separated from other portions of the building by a minimum of a 1-hour fire barrier.

N 11.5.2.1.5 Where the ITE is located in a structure or building housing multiple tenants or occupancies that include assembly, educational, detention, and correction facilities, health care, ambulatory care, and day care center, and residential board and care and residential occupancies, battery systems shall be located in a room separated from other portions of the building by a minimum of a 2-hour fire barrier.

N 11.5.2.2 Environment. The battery environment shall be controlled or analyzed to maintain temperature in a safe operating range for the specific battery technology used. [1:52.2.2.7]

N 11.5.2.3 Labels. Battery cabinets shall be provided with exterior labels that identify the manufacturer and model number of the system and electrical rating (i.e., voltage and current) of the contained battery system. [1:52.2.2.8.4]

N 11.5.2.4 Signs. Signs shall be provided within battery cabinets to indicate the relevant electrical, chemical, and fire hazard. [1:52.2.2.8.5]

N 11.5.2.5 Seismic Protection. Battery systems shall be seismically braced in accordance with the building code. [1:52.2.2.9]

N 11.5.2.6 Smoke Detection. An approved automatic smoke detection system shall be installed in rooms containing stationary battery storage systems in accordance with *NFPA 72*. [1:52.2.2.10]

N 11.5.3 Lead-Acid and Nickel-Cadmium Batteries.

N 11.5.3.1 General. UPS systems having an electrolyte capacity of more than 100 gal (378.5 L) in sprinklered buildings or 50 gal (189.3 L) in unsprinklered buildings for vented lead-acid, nickel-cadmium, and valve-regulated lead-acid (VRLA) batteries shall be in accordance with 11.5.3 and Table 11.5.3.1.

N 11.5.3.2 Safety Features. [1:52.2.2]

N 11.5.3.2.1 Safety Venting. Batteries shall be provided with safety venting caps per 11.5.3.2.1.1 and 11.5.3.2.1.2. [1:52.2.2.1]

N 11.5.3.2.1.1 Nonrecombinant Batteries. Vented lead-acid and nickel-cadmium shall be provided with safety venting caps. [1:52.2.2.1.1]

N 11.5.3.2.1.2 Recombinant Batteries. VRLA shall be equipped with self-sealing flame-arresting safety vents. [1:52.2.2.1.2]

N 11.5.3.2.2 Thermal Runaway. VRLA systems shall be provided with a listed device or other approved method to preclude, detect, and control thermal runaway. [1:52.2.2.2]

N 11.5.3.2.3 Spill Control. [1:52.2.2.4]

N 11.5.3.2.3.1 Rooms, buildings, or areas containing free-flowing liquid electrolyte in individual vessels having a capacity of more than 55 gal (208 L) or multiple vessels having an aggregate capacity exceeding 1000 gal (3785 L) shall be provided with spill control to prevent the flow of liquids to adjoining areas. [1:52.2.2.4.1]

N 11.5.3.2.3.2* An approved method and materials for the control of a spill of electrolyte shall be provided that will be capable of controlling a spill from the single largest vessel. [1:52.2.2.4.2]

N 11.5.3.2.3.3 VRLA batteries with immobilized electrolyte shall not require spill control. [1:52.2.2.4.3]

N 11.5.3.2.4 Neutralization.

N 11.5.3.2.4.1* An approved method to neutralize spilled electrolyte shall be provided. [1:52.2.2.5.1]

N 11.5.3.2.4.2 For VRLA batteries, the method shall be capable of neutralizing a spill from the largest battery to a pH between 7.0 and 9.0. [1:52.2.2.5.2]

N 11.5.3.2.5* Ventilation. For vented lead-acid, flooded nickel-cadmium, and VRLA batteries, ventilation shall be provided for rooms and cabinets in accordance with the mechanical code and one of the following:

- (1) The ventilation system shall be designed to limit the maximum concentration of hydrogen to 1.0 percent of the total volume of the room during the worst-case event of simultaneous “boost” charging of all the batteries, in accordance with nationally recognized standards.
- (2) Continuous ventilation shall be provided at a rate of not less than 1 ft³/min/ft² (5.1 L/sec/m²) of floor area of the room or cabinet.

N 11.5.3.2.6 Signs.

N 11.5.3.2.6.1 Doors or accesses into the following shall be provided with approved signs:

- (1) Rooms containing stationary storage battery systems
- (2) Other areas containing stationary storage battery systems

N 11.5.3.2.6.2 For rooms that contain VRLA batteries, the signs required by 11.5.3.2.6.1 shall state the following:

This room contains:

- (1) Stationary storage battery systems
- (2) Energized electrical circuits

[1:52.2.2.8.2]

N 11.5.3.2.6.3 For rooms that contain lead-acid or vented Ni-Cd batteries, the signs required by 11.5.3.2.6.1 shall state the following:

This room contains:

- (1) Stationary storage battery systems
- (2) Energized electrical circuits
- (3) Corrosive battery electrolyte

N 11.5.4 Lithium-Ion Batteries.

N 11.5.4.1 General. UPS systems having a capacity of more than 20 kWh (18.0 MJ) shall be in accordance with 11.5.4.

N Table 11.5.3.1 Lead-Acid and Nickel-Cadmium Battery Requirements

Requirement	Nonrecombinant Batteries		Recombinant Batteries
	Vented Lead-Acid	Vented Nickel-Cadmium (Ni-Cd)	Valve-Regulated Lead-Acid (VRLA)
Safety caps	Venting caps	Venting caps	Self-sealing flame-arresting caps
Thermal runaway management	Not required	Not required	Required
Spill control	Required	Required	Not required
Neutralization	Required	Required	Required
Ventilation	Required	Required	Required
Signage	Required	Required	Required
Seismic control	Required	Required	Required
Fire detection	Required	Required	Required

N 11.5.4.1.1 For batteries rated in amp-hours, kWh shall equal rated voltage times amp-hour rating divided by 1000.

N 11.5.4.2 Maximum Allowable Quantities.

N 11.5.4.2.1 Fire areas within buildings containing lithium-ion battery UPS systems exceeding the maximum allowable quantity of 600 kWh (2160 MJ) shall comply with all applicable ordinary-hazard and high-hazard requirements as identified in 6.2.2 of NFPA 101 and the building code.

N 11.5.4.2.2 Where approved by the AHJ, areas containing lithium-ion battery UPS systems that exceed 600 kWh (2160 MJ) shall be permitted to be treated as an ordinary-hazard and not a high-hazard classification based on a hazardous mitigation analysis in accordance with 11.5.4.4 and large-scale fire and fault condition testing conducted or witnessed and reported by an approved testing laboratory.

N 11.5.4.3* Battery Arrays.

N 11.5.4.3.1 Battery arrays shall comply with 11.5.4.3.2 and 11.5.4.3.3 unless otherwise permitted by 11.5.4.3.4 or 11.5.4.3.5.

N 11.5.4.3.2 Lithium-ion batteries, prepackaged lithium-ion battery UPS systems, and pre-engineered lithium-ion battery UPS systems shall be segregated into arrays not exceeding 50 kWh (180 MJ) each.

N 11.5.4.3.3 Each array shall be spaced a minimum 3 ft (914 mm) from other arrays and from walls in the storage room or area. The storage arrangements shall comply with the egress provisions in NFPA 101.

N 11.5.4.3.4 Listed pre-engineered lithium-ion battery UPS systems and prepackaged lithium-ion battery UPS systems shall not exceed 250 kWh (900 MJ) each.

N 11.5.4.3.5 The AHJ shall be permitted to approve listed pre-engineered lithium-ion battery UPS systems and prepackaged lithium-ion battery UPS systems with larger capacities or smaller battery array spacing if large-scale fire and fault condition testing conducted or witnessed and reported by an approved testing laboratory is provided showing that a fire involving one array will not propagate to an adjacent array and will be contained within the room for a duration equal to the fire resistance rating of the room separation required by 11.5.2.1.3.

N 11.5.4.4 Hazard Mitigation Analysis. A failure mode and effects analysis (FMEA) or other approved hazard mitigation analysis shall be provided to the AHJ when any of the following conditions are present:

- (1) More than one stationary storage battery technology is provided in a room or indoor area where there is a potential for adverse interaction between technologies.
- (2) When allowed as a basis for increasing maximum allowable quantities as specified in 11.5.4.2.2.

N 11.5.4.4.1 The analysis shall evaluate the consequences of the following failure modes, and others deemed necessary by the AHJ. Only single failure modes shall be considered for each mode:

- (1) Thermal runaway condition in a single module or array
- (2) Failure of a battery management system
- (3) Failure of a required ventilation system
- (4) Voltage surges on the primary electric supply

- (5) Short circuits on the load side of the stationary battery storage system
- (6) Failure of the smoke detection, fire suppression, or gas detection system

N 11.5.4.4.2 The AHJ shall be permitted to approve the hazardous mitigation analysis provided the consequences of the FMEA demonstrate the following:

- (1) Fires or explosions will be contained within unoccupied stationary storage battery system rooms for the minimum duration of the fire resistance rated specified in 11.5.2.1.3 or 11.5.2.1.4, as applicable
- (2) Fires and explosions in stationary storage battery system cabinets in occupied work centers allow occupants to safely evacuate
- (3) Toxic and highly toxic gases released during charging, discharging, and normal operation shall not exceed the permissible exposure limit (PEL)
- (4) Toxic and highly toxic gases released during fires and other fault conditions shall not reach concentrations in access of IDLH level in the building or adjacent means of egress routes during the time deemed necessary to evacuate from that area
- (5) Flammable gases released from batteries during charging, discharging, and normal operation shall not exceed 25 percent of the lower flammable limit (LFL)

N 11.5.4.4.3 Construction, equipment, and systems that are required for the lithium-ion battery UPS system to comply with the hazardous mitigation analysis shall be installed, maintained, and tested in accordance with nationally recognized standards and specified design parameters.

N 11.5.4.5 Listings. Lithium-ion batteries used in UPS systems shall be listed in accordance with UL 1973, *Standard for Batteries for Use in Stationary, Vehicle Auxiliary Power and Light Electric Rail (LER) Applications*. Prepackaged and pre-engineered lithium-ion battery UPS systems shall be listed in accordance with ANSI/UL 9540, *Standard for Safety for Energy Storage Systems and Equipment*.

N 11.5.4.5.1 Prepackaged and pre-engineered UPS systems shall be listed in accordance with ANSI/UL 1778, *Uninterruptible Power Supply Systems*.

N 11.5.4.5.2* Prepackaged and Pre-engineered Systems. Prepackaged and pre-engineered lithium-ion battery UPS systems shall be installed in accordance with their listing and the manufacturer's instructions.

N 11.5.4.6 Installation.

N 11.5.4.6.1 Battery Management System. An approved battery management system shall be provided for monitoring and balancing cell voltages, currents, and temperatures within the manufacturer's specifications. The system shall transmit an alarm signal to an approved location if potentially hazardous temperatures or other conditions including short circuits, over-voltage (i.e., overcharge) or under voltage (i.e., over discharge) are detected.

N 11.5.4.6.2 Battery Chargers. Battery chargers shall be compatible with the battery manufacturer's electrical ratings and charging specifications. Battery chargers shall be listed in accordance with the UL 1564, *Standard for Industrial Battery Chargers*, or provided as part of a listed pre-engineered or prepackaged lithium-ion battery UPS system.

N 11.5.4.6.3 Signage.

N 11.5.4.6.3.1 Approved signage shall be provided on doors or in approved locations near entrances to lithium-ion battery UPS system rooms.

N 11.5.4.6.3.2 New signage installations shall require the following items:

- (1) Hazard identification markings in accordance with NFPA 704
- (2) "This room contains energized battery systems," or the equivalent
- (3) Lithium-ion batteries
- (4) "AUTHORIZED PERSONNEL ONLY"
- (5) Any potential hazards associated with the batteries

N 11.5.4.6.3.3 Where the lithium-ion battery UPS system disconnecting means is not within sight of the main service disconnect, placards or directories shall be installed at the locations of the main service disconnect to indicate the location of all lithium-ion battery UPS system disconnecting means in accordance with *NFPA 70*.

N 11.5.4.6.3.4 Existing lithium-ion battery UPS systems shall be permitted to include the signage required at the time it was installed.

N 11.5.4.6.3.5 Fire command centers in buildings containing lithium-ion battery UPS systems shall include signage or readily available documentation that describes the location of lithium-ion battery UPS systems, operating voltages, and location of electrical disconnects.

N 11.5.4.6.4* Mixed Battery Systems. Different types of batteries shall not be installed in the same room or cabinet if there is a potential for unsafe interaction between them, as determined by the AHJ.

N 11.5.4.7 Suppression and Detection.

N 11.5.4.7.1 Fire Suppression. Rooms containing lithium-ion battery UPS systems shall be protected by an automatic sprinkler system installed in accordance with NFPA 1, Section 13.3.

N 11.5.4.7.1.1 Commodity classifications for lithium-ion battery UPS systems shall be in accordance with Chapter 5 of NFPA 13.

N 11.5.4.7.2 Smoke Detection. An approved automatic smoke detection system shall be installed in rooms containing lithium-ion battery UPS systems in accordance with *NFPA 72* and the required automatic smoke detection system shall be supervised by an approved central, proprietary, or remote station service or a local alarm that will give an audible signal at a constantly attended location.

N 11.5.4.8 Thermal Runaway. Lithium-ion battery UPS systems shall be provided with a listed device or other approved method shall be provided to preclude, detect, and control thermal runaway.

N 11.5.4.9 Testing, Maintenance, and Repairs.

N 11.5.4.9.1 lithium-ion battery UPS systems and associated equipment and systems shall be tested and maintained in accordance with the manufacturer's instructions.

N 11.5.4.9.2 Any lithium-ion batteries or system components used to replace existing units shall be compatible with the battery charger, battery management systems, other storage batteries, and other safety systems.

N 11.5.5 Other Battery Types. Other battery types not addressed in 11.5.3 or 11.5.4 shall be in accordance with Chapter 52 of NFPA 1.

Chapter 12 Emergency and Recovery Procedures

12.1* Emergency Fire Plan. There shall be a management-approved written, dated, and annually tested emergency fire plan.

12.1.1 Fire Safety of Fire Fighters.

12.1.1.1 Fire Department Information. Where requested by the local fire department, the following shall be provided:

- (1) A general description of the ITE within the building and how it is powered
- (2) An up-to-date floor plan of all ITE systems and ITE areas
- (3) Actions to be taken concerning ventilation and the prevention of contamination of areas not affected by the fire

12.1.1.2* Fire Service Orientation and Information. When requested by the local fire department, orientation and information shall be provided to the fire personnel by the company management as follows:

- (1) A general description of the facilities and all the ITE systems
- (2) An orientation walkthrough of the facility to address all the orientation and information issues to ensure life safety and service continuity are upheld
- (3) The strategy and tactics to confine, suppress, and limit an incident's impact in the ITE area

12.2* Damage Control Plan. There shall be a management-approved written, dated, and annually tested damage control plan.

12.3* Recovery Procedures Plan. There shall be a management-approved written, dated, and annually tested plan covering recovery procedures for continued operations.

Chapter 13 Modular Data Centers

N 13.1 General. This standard applies to modular data centers (MDCs), except as modified by Chapter 13.

N 13.2 (Reserved).

N 13.3 (Reserved).

N 13.4 Fire Protection Approaches. The construction, location, and fire protection and detection equipment for MDCs shall comply with the requirements of Chapter 4.

N 13.5 (Reserved).

N 13.6 Construction Requirements. Construction requirements shall comply as required by Chapter 6.

N 13.7 Materials and Equipment Permitted in Modular Data Centers. Materials and equipment permitted in MDCs shall comply with the requirements of Chapter 7.

N 13.8 (Reserved).

N 13.9 Fire Protection and Detection Equipment. Fire protection and detection equipment for MDCs shall comply with the requirements of Chapter 9.

N 13.10 Records Kept or Stored in Modular Data Centers.

Records kept or stored in MDCs shall not be permitted.

N 13.11* Utilities.

N 13.11.1 Heating, ventilation, and air conditioning and coolant systems shall comply with Sections 11.1 and 11.2.

N 13.11.2 Electrical service shall comply with *NFPA 70*, Article 646, Modular Data Centers.

N 13.12 Emergency and Recovery Procedures. Emergency and recovery procedures for MDCs shall comply with the requirements of Chapter 12.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.2 This standard does not cover installation of ITE and ITE areas that can be made without special construction or protection. It can, however, be used as a management guide for the installation of electrically powered mechanical ITE, small tabletop or desk-type units, and ITE.

The strategic importance placed on ITE and ITE areas by the user is vitally tied to uninterrupted operation of the system. Consequently, by the partial or entire loss of this equipment, an entire operation of vital nature could be temporarily paralyzed.

Not to be overlooked are the one-of-a-kind information technology systems. These are the custom-made models that are designed to perform specific tasks. Replacement units for this type of equipment are not available, and the probability of the existence of duplicate facilities, which could be used to perform vital operations in the event that the one-of-a-kind systems are partially or totally impaired by a fire, is remote.

The prescriptive requirements of this standard are intended to provide a minimum level of fire protection for ITE systems and facilities. As technology changes, information technology facilities might have varying sizes, equipment density, equipment cooling arrangements, physical separations, different numbers of users served by a single facility, and other characteristics. The fire risk assessment required by Chapter 4 is intended to reveal any causes that justify modification of the prescriptive requirements of this standard for a specific facility.

A.1.3 See Figure A.1.3.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in

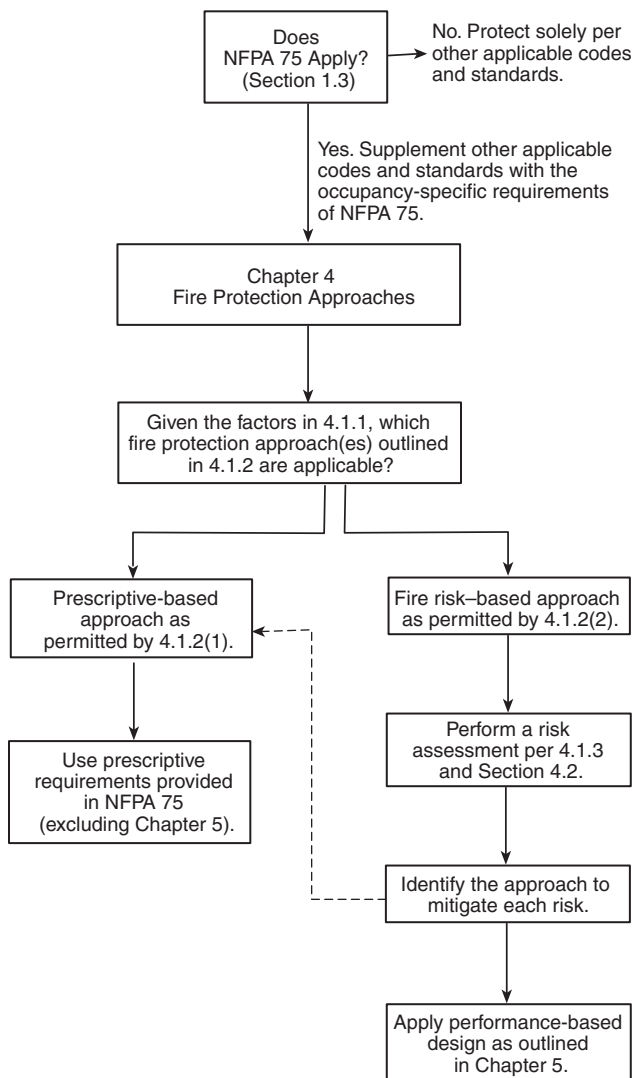


FIGURE A.1.3 Decision Tree for Application of NFPA 75.

NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.4.3 Valve-Regulated Lead Acid (VRLA). In VRLA batteries the liquid electrolyte in the cells is immobilized in an absorptive glass mat (AGM cells or batteries) or by the addition of a gelling agent (gel cells or gelled batteries).

A.3.3.4.4 Vented (Flooded). Vented batteries have a provision for the user to add water to the cell and are equipped with a flame-arresting vent that permits the escape of hydrogen and oxygen gas from the cell in a manner such that a spark or other ignition source outside the cell will not ignite the gases inside the cell.

A.3.3.13 ITE. The term ITE is widely used in the industry to designate electronic equipment such as computers, servers, and data storage devices. It designates equipment both for manipulating and transmitting the signals. It can also include close-coupled associated power and cooling systems located in, on, or on top of the lineups.

A.3.3.14 ITE Area. Areas that support ITE equipment and the ITE room are subject to fires as well. ITE support rooms could contain primary, emergency, and backup power systems; cooling, heating, and air handling equipment; wide area network connections; and network control and operation rooms. Fires in these rooms could affect the operation of the ITE; therefore, the risk in these spaces should be considered.

A.3.3.16 ITE System. Figure A.3.3.16 shows the components that comprise an ITE system.

A.3.3.17.4 Maximum Allowable Quantity (MAQ). Quantities are permitted to exceed the MAQ when they are located in an area complying with Protection Levels 1–5 in accordance with the building code. [1, 2018]

A.3.3.18 Modular Data Center. Equipment enclosures housing only support equipment (e.g., HVAC or power distribution equipment) that are not part of a specific modular data center are not considered a modular data center as defined in this article. [70:646.2 Informational Note No. 4]

A.3.3.21 Raceway. Raceways include, but are not limited to, rigid metal conduit, rigid nonmetallic conduit, intermediate metal conduit, liquidtight flexible conduit, flexible metallic tubing, flexible metal conduit, electrical nonmetallic tubing, electrical metallic tubing, underfloor raceways, cellular concrete floor raceways, cellular metal floor raceways, surface raceways, wireways, and busways.

A.3.3.22 Raised Floor. Raised floors are sometimes referred to as false floors, secondary floors, or access floors.

A.3.3.26 Support Equipment. Support equipment can mean the physical infrastructure equipment necessary for the ITE, such as equipment racks, power supply and distribution equipment, air conditioning, and lighting. It can also include such things as test equipment, material-handling equipment, ladders, tools, and other equipment that may be required for installation and maintenance and that may not be permanently installed. Nonpermanent equipment should be removed from the ITE space when not needed for a particular task.

A.3.4.1 Aisle. The key elements of this definition are as follows:

- (1) A passageway between equipment intended for movement of people and/or equipment
- (2) Typically between opposing rows of ITE enclosures or racks but could be between two free-standing pieces or racks of ITE
- (3) Intended for routine human activity such as service or operation (therefore not a plenum space)

A.3.4.2 Aisle Containment. The key elements of this definition are as follows:

- (1) An occupied area (excluding areas above a ceiling or below a raised floor)
- (2) Utilizing “physical separation” between hot and cold air (excluding construction methods such as fire-rated walls)
- (3) Can be either a “hot aisle” or a “cold aisle” or a mix of both at select portions of the aisle

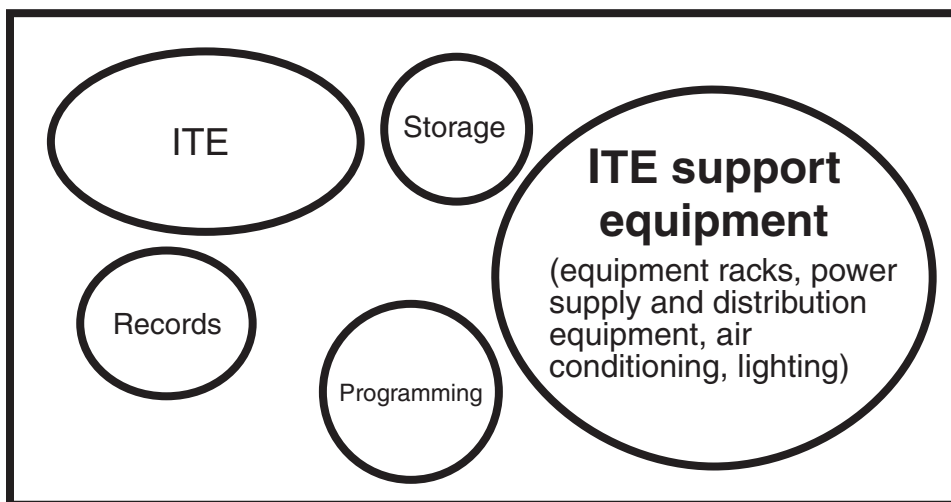


FIGURE A.3.3.16 ITE System.

A.3.4.3 Cold Aisle. The key elements of this definition are as follows:

- (1) Airflow controlled
- (2) Intake air cold, implying an aisle normally intended for operation of the ITE
- (3) Air from the output of the HVAC

A.3.4.4 Hot Air Collar. The key elements of this definition are as follows:

- (1) Air conveyance assembly, sometimes referred to as a “duct” or a “chimney”
- (2) Typically from specific equipment rather than from larger areas such as aisles
- (3) Hot air collar not required to be physically connected to a duct or plenum

A.3.4.5 Hot Aisle. The key elements of this definition are as follows:

- (1) Airflow controlled
- (2) Exhaust air hot, implying an aisle normally intended for servicing of the ITE
- (3) Air returns to the input of the HVAC

A.4.2.1 The fire risk analysis should be evaluated by the stakeholders. See NFPA 551 for additional guidance.

A.4.2.3 The protection for ITE systems and ITE areas should be specific to the nature and anticipated fire risks of each facility. The risk analysis should consider the risk and hazards associated with the site and services provided for a given fire safety problem. Additional considerations can include the following:

- (1) Availability of alternative ITE or ITE rooms
- (2) Permitted downtime of ITE
- (3) Presence of additional fire protection and detection equipment proximate to the ITE room
- (4) Survivability of the ITE systems and ITE room environment
- (5) Number and training of emergency response personnel
- (6) Building construction

NFPA 551 can be used as a reference guide for conducting and evaluating fire risk assessments.

A.5.3 It is essential that the design professional recognize the possibility of fire in ITE facilities. Licensed design professionals who develop performance-based design documents should be well versed in the science of fire, the effects of fire on ITE systems and operations, and options for mitigation of the risk to persons, equipment, and operations presented by fire in ITE facilities.

N A.5.4 The SFPE *Guidelines for Peer Review in the Fire Protection Design Process* provides guidance concerning the peer review process for fire protection designs.

A.5.7.4 The Society of Fire Protection Engineers’ *Engineering Guide to Performance-Based Fire Protection* is a recommended guide that should be used in the development of a design brief and performance-based design. The intent of the permitted deviation would be stated in the design brief or an informational annex of the design brief. The deviation can be permitted as long as the equivalent performance features are maintained.

A.6.1 The structural floor supporting the ITE area should have sufficient floor loading capacity to sustain the expected floor load.

A.6.1.2 NFPA 80A details one method of providing exposure protection.

A.6.1.3 Experience with fires affecting ITE rooms has demonstrated that the fire often starts in areas other than the ITE area and that the fire and its related products, including smoke, soot, and heat, can enter the ITE room if it is not adequately separated by sealed, rated walls. Consideration should be given to raising the rating of perimeter walls to 2 hours where adjacent walls are already rated 2 hours or greater.

The prudent facilities manager would do well to limit the exposure fire hazard by locating an ITE facility in a fully sprinklered building and install self-contained HVAC systems within the information technology area.

The rooms shown in Figure A.6.1.3 are symbolic and do not denote size, shape, or location, nor are the rooms in Figure A.6.1.3 necessarily required in the ITE area. The ITE area includes only those support rooms served by the same special air-conditioning/air-handling equipment as the ITE room. ITE rooms frequently have a raised floor.

A.6.2 The provisions of Section 6.2 do not require inherently noncombustible materials to be tested in order to be classified as noncombustible materials. [101:A.4.6.13]

A.6.2.1.1(1) Examples of such materials include steel, concrete, masonry, and glass. [101:A.4.6.13.1(1)]

A.6.2.2.4 Materials subject to increase in combustibility or flame spread index beyond the limits herein established through the effects of age, moisture, or other atmospheric condition are considered combustible. (See NFPA 259 and NFPA 220.) [101:A.4.6.14]

A.6.3.1 Steam, water, or horizontal drain piping, other than for sprinkler system use, should not be in the space above the suspended ceiling and over ITE.

The ITE area should be located to minimize exposure to fire, water, corrosive fumes, heat, and smoke from adjoining areas and activities. Battery installations, if constructed and ventilated in accordance with 11.5.2, can be adjacent to or incorporated into the ITE room.

Basement areas should not be considered for the location of an ITE area. If ITE is located in a basement, precautions should be taken to facilitate smoke venting and to prevent flooding from interior and exterior sources that can occur, including a fire on an upper floor.

A.6.3.2 Many ITE installations have become prime targets for sabotage and arson. The location and construction should be designed to minimize the possibility of penetration by an explosive or incendiary device. It is essential that access be restricted to only those persons absolutely necessary to the operation of the equipment. A controlled-access system of admittance through positive identification should be maintained at all times. For additional guidance, see NFPA 730 and NFPA 731.

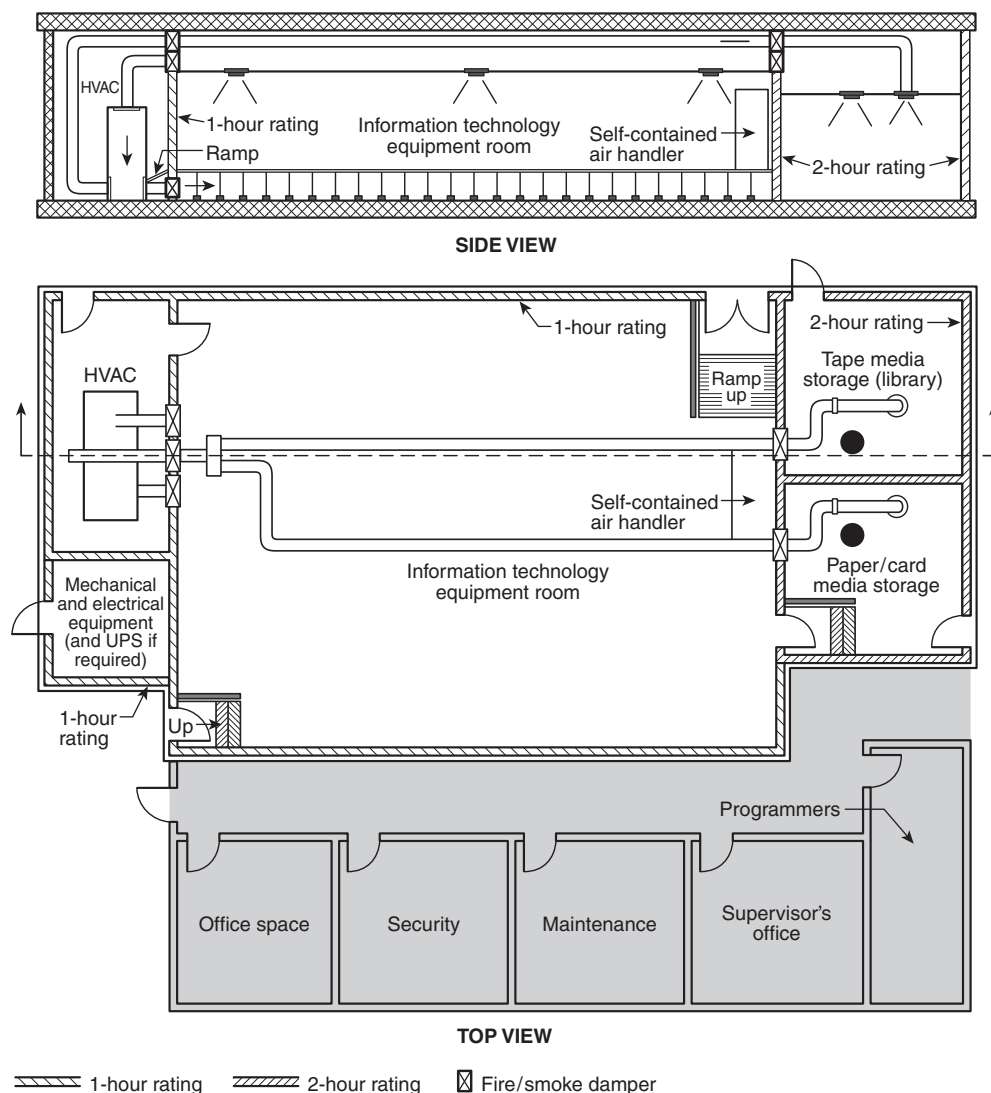


FIGURE A.6.1.3 Diagram of ITE Area.

A.6.3.3 In multistoried buildings, the floor above the ITE room should be made reasonably watertight to avoid water damage to equipment. Any openings, including those for beams and pipes, should be sealed watertight. Where drainage is installed in an area containing an underfloor extinguishing system, provisions should be made for maintaining the drain piping as a closed system unless water is present. These provisions are required to ensure the integrity of a gaseous extinguishing system and allow for maintenance of the necessary concentration level. Because water will evaporate from the standard plumbing trap, mineral oil or another substitute should be considered.

A.6.3.3.1 Some liquids might not be safe to drain to the building's sewer system. The facility should plan for remediation of the spilled liquid — especially in the case of heat transfer fluids for liquid-cooled ITE.

A.6.3.3.2 The leak detection system should be capable of generating a silenceable supervisory signal upon sensor contact with water. The system should continuously supervise all

sensors and interconnecting components for electrical continuity. It should also include a self-test capability.

A.6.5 The determination of the depth of the raised floor should take into consideration air movement and fire detection and extinguishing systems requirements (if installed), as well as building construction restrictions.

A.6.5.4 Openings in raised floors for electric cables or other uses should be protected to minimize the entrance of debris or other combustibles.

A.6.6.3.1 NFPA 75 requires smoke or fire dampers in locations where NFPA 90A may not.

N A.6.7 The principles of Section 6.7 should be followed if an existing ITE room has aisle containment systems added after construction of the room.

A.6.7.4 Where plenums are present, the space above the raised floor and below the suspended ceiling is typically accessible to both occupants and first responders for maintenance

access, fire-fighting activities, and so forth, and therefore does not need to be classified as a plenum. The addition of aisle containment systems installed in accordance with this standard does not change the hazards contained within those containment areas and therefore does not necessitate different construction materials as required in plenum spaces as defined elsewhere in this standard and others.

A.6.7.6 Temperatures of 38°C (100°F) are possible in hot aisles. Temporary increases in temperature above 38°C (100°F) in hot aisles can occur during normal facility operations. Some smoke detectors are listed for maximum operating temperature of 38°C (100°F). Where smoke detectors are located in hot aisles or in the airstream exhausted from hot aisles, detectors should have appropriate listing for temperatures above 38°C (100°F).

Where heat detectors are located in hot aisles, consideration of the operating temperatures within the hot aisles should be made when selecting the temperature rating of the detectors. NFPA 72 and manufacturer's instruction should be consulted for guidance.

During startup of IT equipment, the rate of temperature rise within hot aisles could cause rate-of-rise detectors to activate. Detection systems should be designed to avoid unwanted alarm during IT equipment startup.

The normally elevated temperatures within hot aisles should be taken into account when selecting sprinklers for installation in these aisles. NFPA 13 should be consulted for guidance.

Abnormal conditions can result in even higher temperatures than described above. For example, temperatures as high as 66°C (150°F) have been observed in hot aisles upon failure of the HVAC system.

A.6.7.8.1 This paragraph addresses removable curtains and aisle containment materials, which are otherwise referred to as "removable obstructions." Fixed obstructions are clearly addressed for suppression systems within NFPA 13. Means other than automatic smoke detection used for removing the obstructions (e.g., thermal, mechanical, and fusible links) still need further research by the industry and are not clearly demonstrating the capability of activating without impacting the timed response effective performance of suppression systems.

A.6.7.8.1(1) This action can be compared to readying the space before suppression, such as initiating the closing of fire doors, dampers, and the like.

A.6.7.8.1(4) The releasing devices can be similar to those used for initiating fire doors, dampers, and the like.

A.6.7.10.1 This paragraph addresses removable curtains and aisle containment materials, which are otherwise referred to as "removable obstructions." Fixed obstructions are clearly addressed for suppression systems within NFPA 2001. Means other than automatic smoke detection used for removing the obstructions (e.g., thermal, mechanical, and fusible links) still need further research by the industry and are not clearly demonstrating the capability of activating without impacting the effective performance of suppression systems.

A.6.7.10.1(1) This action can be compared to readying the space before suppression, such as initiating the closing of fire doors, dampers, and the like.

A.6.7.10.1(4) The releasing devices can be similar to those used for initiating fire doors, dampers, and the like.

A.7.1.1 Support equipment, such as high-speed printers, that utilize large quantities of combustible materials should be located outside the ITE room whenever possible.

A.8.1.2 All nonelectrical parts, such as housings, frames, supporting members, and so forth, should not constitute additional fire hazards to the equipment.

A.8.1.4 See ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, or ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*.

A.8.2.1 All sound-deadening materials used in ITE rooms should be of such material and so arranged that the materials do not increase the potential of fire damage to equipment or the potential of fire propagation.

A.9.1.1.3 The use of carbon dioxide systems for the protection of spaces beneath raised floors is discussed in Section B.5 of NFPA 12 wherein it is pointed out that the design of such systems requires compensation for leakage and provision for a soft discharge to minimize turbulence and agent loss through perforated tiles. These same concerns exist for other inert gas clean agent systems installed in accordance with NFPA 2001. Since these spaces are usually of a very limited height, this type of fire suppression system might be easier to design and install than sprinklers.

The use of halocarbon agents for protection of the spaces under a raised floor where the room is not simultaneously protected is not recommended. However, where a room is protected by a halocarbon system, the space beneath its raised floor needs to be included in the system coverage.

A.9.1.2 In facilities that are under the supervision of an operator or other person familiar with the equipment, during all periods that equipment is energized, the normal delay between the initial outbreak of a fire and the operation of a sprinkler system will provide adequate time for operators to shut down the power by use of the electrical disconnecting means as prescribed in Section 11.4. In other instances where a fire can operate sprinkler heads before discovery by personnel, a method of automatic detection should be provided to automatically de-energize the electronic equipment as quickly as possible.

To minimize damage to electronic computer equipment located in sprinkler-protected areas, it is important that power be off prior to the application of water on the fire.

A.9.1.4 It is not intended that small automatic media loaders or AISS units be provided with protection within the unit. The decision of whether to install protection within the unit should be based on the combustible load being added to the room or area. In the absence of further information, it is reasonable to assume that units that handle in the range of 0.76 m³ (27 ft³) of combustible storage space or less need not be provided with protection within the unit. The 0.76 m³ (27 ft³) volume assumes that no single dimension is larger than 0.9 m (3 ft) [for example, 0.9 m × 0.9 m × 0.9 m (3 ft × 3 ft × 3 ft)].

A.9.2 Fire detection and extinguishing systems should be selected after a complete evaluation of the exposures. The amount of protection provided should be related to the building construction and contents, equipment construction, busi-

ness interruption, exposure, and security need. For amplification of the important need of fire protection, see Chapter 4.

▲ A.9.2.2 The following outline provides smoke detector sensitivity and spacing guidance for protection of ITE in high airflow areas:

General.

For smoke detection systems to detect products of combustion, the products must travel from the source to a **spot-type smoke detector** or port and arrive there in sufficient density to be detectable.

Products of combustion follow forced air streams early in the development of a fire or overheat condition where the influence of mechanical systems is greater than the buoyant forces of the fire or overheat condition. Detection system **spot-type smoke detectors** or ports installed in the paths of cooling air exhaust from the cooled equipment can be expected to respond to a small fire in the equipment sooner than **spot-type smoke detectors** or ports located outside of the ventilation air envelope. To be effective, the detection equipment installed within the ventilation air envelope should be suitable to meet the required sensitivity objectives and for the temperatures, air velocities, and other conditions present. If suitable detection equipment cannot be installed within the exhaust ventilation air envelope, a fire in the cooled equipment should be expected to grow to a size at which its energy is sufficient to overcome the mechanical forces of the HVAC containment system.

In the presence of aisle containment systems used to enhance the effectiveness of cooling ITE, **spot-type smoke detectors** or ports located in hot aisles or in the above ceiling plenum are required.

Regardless, **spot-type smoke detectors** or ports located on the ceiling in ITE areas are a basic requirement and contribute to effective detection over a broad range of ITE area configurations.

Listed ITE has inherent fire-resistant characteristics. Failing or overheated components or connections can lead to smoldering events that produce smoke but tend to remain small. In exceptional cases, flaming fires can result.

Automatic fire and smoke detection systems installed to detect smoldering events and/or flaming fires in ITE areas are more effective in detecting flaming fires than smoldering events due to the respective release rates of combustion products and the effects of forced air flow on the products of combustion. The greater the air flow, which dilutes and channels detectable products of combustion, the less effective will be the performance of the detection system. Damage or losses that could result from smoldering events or flaming fires in ITE prior to detection are likely to be greater in the presence of greater forced air flow due to the likely decrease in detection system performance.

Smoke Detection Systems for Early Detection. Where a smoke detection system is installed for the primary purpose of summoning responsible people to the presence of a small ITE fire or electrical event that produces smoke (known as “pre-alarm”), the system should be arranged with high sensitivity and close spacing to achieve response to low-density products of combustion suspended in air with reasonable stability and tolerance of the environment.

Smoke Detection Systems to Initiate Operation of HVAC Dampers or to Close Openings in Fire-Rated Walls. Where a smoke detection system is installed for the primary purpose of initiating operation of dampers, shutters, doors, or other closures in the event of a fire in an ITE area, the system should be arranged with medium sensitivity and spacing less than listed spacing to assure the integrity of fire-resistive barriers.

Smoke Detection Systems to Initiate Release of a Fire Suppression Agent. Where a smoke detection system is installed for the primary purpose of initiating the release of a fire suppression agent into an ITE area, the system should be arranged with low sensitivity and spacing less than listed spacing and should include a form of logical confirmation of the presence of products of combustion to assure that a single indication does not release the agent.

Sensitivity and Spacing Ranges. The following is guidance for sensitivity and spacing ranges for different locations in high airflow areas:

- (1) **Spot-type smoke detector** and port spacing on ceilings in the presence of high air movement should follow the requirements of 17.7.6.3 of *NFPA 72*.
- (2) Where air changes per hour (ACH) in the room served by the ventilation system exceeds 60, and where the supply air is delivered to the room through a raised floor, studies show that **spot-type smoke detectors** or ports under the floor might not be effective in detecting a fire originating under the floor without abnormally close spacing. Experience has shown that **spot-type smoke detectors** or ports under the floor can be effective in detecting a fire originating in an air-handling unit supplying air to the underfloor space, even in high airflow areas.
- (3) In applying the **spot-type smoke detector** or port spacing, it is recommended that **spot-type smoke detectors** and ports be located at strategic points where smoke is likely to pass — for example, in hot air return streams and at return air registers.
- (4) For **spot-type smoke detectors** and ports installed in the exhaust/return air stream in hot aisles or above ceiling plenums, the spacing and sensitivities listed in Table A.9.2.2 should be used. The guidance in Table A.9.2.2 comes partly from a study sponsored by the Fire Protection Research Foundation. That guidance is conservative because it is based on testing using airflow without recirculation into the volume being studied.

A.9.2.2(3) Products of combustion follow forced air streams early in the development of a fire or overheat condition when the influence of mechanical systems is greater than the buoyant forces of the fire or overheat condition. Detection system **spot-type smoke detectors** or ports installed in the paths of cooling air exhaust from the cooled equipment can be expected to respond to a small fire in the equipment sooner than **spot-type smoke detectors** or ports located outside of the cooling air exhaust stream. To be effective, the detection equipment installed within the cooling air exhaust stream should be suitable to meet the required sensitivity objectives and for the temperatures, air velocities, and other conditions present. If suitable detection equipment cannot be installed within the cooling air exhaust stream, a fire in the cooled equipment should be expected to grow to a size at which its energy is sufficient to overcome the mechanical forces of the HVAC containment system.

Table A.9.2.2 Recommended Sensitivity and Spacing of Spot-Type Smoke Detectors or Ports in Exhaust/Return Air Streams in ITE Areas with High Airflow

Intended Function	Low ACH — Up to 30		High ACH — Greater Than 30	
	Sensitivity	Spacing	Sensitivity	Spacing
Early detection	≤0.2%/ft	≤200 ft ²	≤0.1%/ft	≤100 ft ²
Operating dampers, doors, and shutters	≤1.5%/ft	≤400 ft ²	≤0.75%/ft	≤200 ft ²
Suppression agent release	>2.5% ≤4%/ft	≤400 ft ²	>1.5% ≤3%/ft	≤200 ft ²

Notes:

(1) See Fire Protection Research Foundation reports "Validation of Modeling Tools for Detection Design in High Air Flow Environments," and "Validation of Modeling Tools for Detection Design in High Air Flow Environments — Phase II," and FM Global report "Experimental Data for Model Validation of Smoke Transport in Data Centers."

(2) It is essential that the user understand the material in A.9.2.2 prior to the application of the recommended sensitivity and spacing in this table.

(3) The sensitivity levels for early detection should be considered to be pre-alarm levels.

(4) The sensitivity levels in the table should be considered to be above the ambient obscuration level. The listed sensitivity level should be added to the recorded average peak level in the ambient environment.

A.9.2.3 Sampling ports or spot-type detectors should be located where smoke is more likely to migrate. For example, in an unventilated (i.e., sealed) cabinet, detection should be within the top 10 percent of the cabinet, whereas in a ventilated cabinet, detection should be provided where the ventilation exits the cabinet. In a naturally vented cabinet, this will be the upper ventilation vent.

A.9.3.2 For more information, see NFPA 10.

A.9.4.1 If major concerns over potential fire loss of specific critical data or equipment or serious interruption to operations cannot be resolved or alleviated by equipment redundancy, subdivision of the ITE area, or use of leased facilities, automatic gaseous agent total flooding might be the only feasible approach to handling an incipient fire situation with an acceptable minimum amount of damage. At the same time, this sophisticated protection approach requires that all environmental design criteria — for example, damper closure, fan shutdown, and sealed openings — be carefully maintained to ensure that the needed concentration for extinguishment will be achieved.

A.9.4.3 Various methods of isolating the aisles between rows of equipment racks, known as hot aisle or cold aisle containment, are employed to prevent mixing of hot exhaust air or cold intake air through the ITE. In the event that a fire triggers the release of a clean agent gaseous suppression system, the gas suppressant should be able to penetrate all of the ITE. In most cases of whole room total flooding systems, the flow of air through the ITE normally would be sufficient to satisfy this requirement, but the method should be evaluated on a case-by-case basis.

A.9.4.4 The gaseous extinguishing system can be actuated by the automatic fire detection system required in Section 9.2 when designed to do so.

A.9.4.5 This provision requires that all environmental design criteria — for example, damper closure, fan shutdown, and sealed openings — be carefully maintained to ensure that needed concentration for extinguishment will be achieved. It is

preferable, but not essential, to de-energize ITE prior to discharge if ITE shutdown does not cause major service interruptions.

A.9.4.6 Predischage and discharge alarms are provided to facilitate evacuation of all occupants if considered necessary.

A.10.1 The protection of records storage with an extinguishing system does not reduce the need for duplicate records. In the event of a fire, some damage to the records can occur prior to operation of the extinguishing system.

The evaluation of records should be a joint effort of all parties concerned with the safeguarding of ITE operations. The amount of protection provided for any record should be directly related to its importance in terms of the mission of the ITE system and the reestablishment of operations after a fire. It is assumed that ITE capable of properly using the records will be available. (See Chapter 12.)

A.10.2.1 The size of record storage rooms should be determined by an engineering evaluation of the operation and the application of sound fire protection engineering principles. The evaluation should include, but not be limited to, the following:

- (1) Classification of records
- (2) Quantity of plastic-based records and type of container
- (3) Type and capacity of fire suppression system
- (4) Venting available for removal of products of combustion
- (5) Type and arrangement of fire detection system
- (6) Building construction materials

A.11.1.2 A dedicated HVAC system is normally used in the ITE space to regulate the higher cooling and ventilation requirements of the equipment. However, that is not always feasible. Even when there is a dedicated system, there might still be some building air in the room. For example, air economizers could be utilized for efficiency improvement. Section 11.1 is permitted to be evaluated as part of the performance-based risk analysis as outlined in Chapters 4 and 5.

A.11.1.6 Electric reheat units can collect dust over a period of time. When heat is applied after several months of nonuse and a significant amount of dust and lint has accumulated on the heating elements, energizing of the elements can cause sufficient smoke particles to actuate a sensitive smoke detector in the smoke exhaust (air discharge) area. These reheat units should be set up with a weekly timer circuit to burn off the small amounts of dust that have collected to maintain these reheat units in a clean condition.

A.11.3 The requirements in Section 11.3 apply to all power and service wiring supplying the ITE. The requirements of Section 11.3 do not apply to wiring and components within the actual equipment or to wiring connecting various units of equipment. The equipment and interconnected wiring requirements are set forth in Chapter 8.

▲ A.11.3.1 For the installation of electrical equipment and wiring and optical fiber cabling to conform to *NFPA 70*, the applicable articles in the *NEC* need to be identified. The first step in applying the *NEC* is to review the definition of *modular data center* in Section 646.2. If the data center is determined to be modular, then the installation is required to conform to Article 646, *Modular Data Centers*, and all other sections of the *NEC* that are referenced therein.

If the data center is not modular, the next step is to determine if Article 645, Information Technology Equipment, applies. Since Article 645 covers ITE in an ITE room, the definitions of *ITE* and *ITE room* in Section 645.2 should be reviewed. If the installation comprises ITE in an ITE room, Article 645 could be applicable to the installation.

Article 645 is permissive. Section 645.4 states: “This article shall be permitted to provide alternate wiring methods to the provisions of Chapter 3 and Article 708 for power wiring, Parts I and III of Article 725 for signaling wiring, and Parts I and V of Article 770 for optical fiber cabling where all of the following conditions are met.”

There are six conditions. See Section 645.4 of the *NEC* to review the conditions.

If an installation does not meet the six conditions, then Article 645 is not permitted to be used, the provisions of Chapter 3 must be followed for power wiring, and the provisions of Article 725 and Article 770 must be followed for data wiring and optical fiber cabling. Even if a data center meets the six conditions, it is permissible to opt out of Article 645 and follow all the rules in Chapter 3, Article 725, and Article 770.

Regardless of whether Article 645 is used, installations of power wiring must comply with Chapters 1, 2, and 4 of the *NEC*, and installations of communications wiring must comply with Chapter 8 of the *NEC*.

The bonding requirements in the product standards governing this listed equipment ensure that it complies with Article 250 [of *NFPA 70*]. [70:645.15 Informational Note 1]

Where isolated grounding-type receptacles are used, see 250.146(D) and 406.3(D) [of *NFPA 70*]. [70:645.15 Informational Note 2]

A.11.3.4 Besides providing protection against lightning surges as required in *NFPA 70*, it is recommended that the building housing an ITE area be protected against lightning in accordance with *NFPA 780*.

A.11.3.7 The installation of general-purpose and riser cables exposed to the airflow in the air space below a raised floor is permitted only where the space is protected by an automatic fire suppression system. (See 9.1.1.3.)

A.11.4.3 Abandoned cable can interfere with airflow and extinguishing systems. Abandoned cable also adds to the fuel loading.

A.11.4.5.1 Approved means include remote disconnect controls and approved procedures. Due to the criticality of ITE to operations and life safety, a sequential shutdown might be appropriate. The strategic importance placed on ITE and ITE areas by the user is vitally tied to uninterrupted operation of the system. Consequently, the partial or total loss of the equipment could cause an entire operation of vital nature to be temporarily or permanently paralyzed. A risk analysis would factor in the criticality of the operation, including life safety, as well as the presence of the following:

- (1) An approved procedure to identify shutdown procedures under identified conditions
- (2) Trained and qualified personnel who can perform sequential shutdown or meet emergency responders and advise them of disconnecting methods
- (3) Smoke-sensing fire detection systems installed in the ITE room
- (4) Fire suppression system suitable for the application installed in the ITE room
- (5) Power and signal cabling installed in accordance with *NFPA 70*

A.11.4.5.2 Cooling of ITE is critical to its operation. Information technology (IT) servers run applications that are crucial to business continuity and frequently have life safety implications. An unplanned shutdown of ITE can cause loss of control over life support systems, emergency response systems, and security systems, as well as loss of essential data. Therefore, it can be undesirable, even dangerous, to automatically shut down equipment that is not directly involved in a fire.

Modern server racks contain multiple processing units that can create a large amount of heat. Storage technology can handle many terabytes of data. If air conditioning equipment that is used to cool the ITE is shut down, temperatures can increase by as much as 22°C (40°F) in a matter of minutes, potentially causing more damage than the heat of a small electronic fire. Therefore, it is desirable to maintain cooling air flow for as long as possible.

Thermal sensing devices are built into individual servers to immediately depower overheating components in an attempt to prevent permanent damage to entire server systems. If a single server or single server rack is shut down by thermal protective devices, other servers would generally remain available to maintain functionality. But if the room or area environmental cooling air suddenly ceased due to initiation of a fire detector under a raised floor, all equipment in the area could shut down on thermal overload. This would cause the uncontrolled loss of all functions provided by the ITE and result in potentially serious consequences.

Fire suppression systems used in IT facilities are often designed to detect and extinguish a fire in its incipient stage while cooling airflow through the facility is maintained and servers remain running. If depowering of equipment is required as part of the fire protection, such depowering is generally done in a planned, programmed sequence to mini-

mize loss of data. When an IT facility is providing support or control related to life safety or security, the depowering sequence typically includes provision to transfer support or control functions to a backup IT facility.

Determination of when it is safe to shut off ventilation to the ITE is part of the planned depowering sequence. In IT facilities protected by automatic gaseous extinguishing systems, the activation of more than one detector is usually required to confirm existence of fire and release the fire extinguishing gas. Airflow is taken into account in locating smoke detectors.

Cessation of normal air flow upon activation of a single smoke detector can delay the activation of additional smoke detectors in the IT facility and delay the release of an automatic gaseous extinguishing agent in facilities equipped with such systems.

Airflow and its effects on fire detection in IT facilities and telecommunications facilities are the subject of ongoing research. Recent research indicates that, for the type of fire typical in IT facilities, extinguishment might actually be aided by continuous flow of air through the fire zone. The airflow helps maintain air pressure, cools the fire zone, and because of the typically smoldering nature of these fires in their early stages can reduce the amount of heat available to be carried by conduction to nearby materials.

Upon detection of smoke or fire anywhere within an IT facility, personnel will be alerted to the danger by the fire alarm system. Personnel are given the opportunity for appropriate evacuation or response to the alarm, contingent on their training and qualifications.

A.11.4.5.4 The purpose of a disconnecting means is to remove electrical energy from the source of a fire. The objectives of a well-designed disconnecting means (commonly referred to as emergency power off [EPO]) include the safety of personnel and to minimize the impact on the operation of the ITE.

A poorly designed, installed, or maintained disconnecting means can become a single point of failure that can have severe adverse effects on the operation of ITE and, by extension, life safety that depends on the proper and continued operation of the ITE.

A good design can allow the creation of zones. A zone can include everything needed to prevent the spread of a fire, including detection, suppression, and power disconnection. Zones minimize impact on the safety of personnel in the ITE area and on the impact of IT devices affected.

The decision on the manner of disconnecting means is based on the risk assessment described in Chapter 4. The assessment will include, but not be limited to, considerations such as the following:

- (1) What is the criticality of the operation?
- (2) What would be the consequences of an unplanned shutdown on life safety and on mission performance?
- (3) Can operations be transferred elsewhere in a timely manner?
- (4) Is there an approved procedure for removing power and air within a room or zone?
- (5) Are qualified personnel available at all hours who can manually and safely disconnect the affected equipment?
- (6) Are personnel available who are trained and certified as first responders?

- (7) Is fire suppression in place that can localize the impact on equipment that is not involved in the fire?
- (8) Are smoke-sensing detectors in place within the room or zone (per requirements of Section 8.2)? What are their sensitivity and reliability?
- (9) What is the possibility of accidental operation of the disconnecting means?
- (10) Does the complexity of the system increase or decrease the probability of a false alarm shutdown?

A.11.4.5.5 NFPA 70, Article 685, concerns integrated electrical systems, which are systems that could include ITE that is integrated into the controls of complex industrial processes. Locating overcurrent devices and their associated disconnection means so that they are not readily accessible to unqualified personnel is one of the preventive measures used to help maintain continuity of operation and to prevent injury to personnel, severe equipment damage, or catastrophic failure.

• **N A.11.5.3.2.3.2** Methods of achieving this protection can include, but are not limited to, the following:

- (1) Liquidtight sloped or recessed floors in indoor locations or similar areas in outdoor locations
- (2) Liquidtight floors in indoor locations or similar areas in outdoor locations provided with liquidtight raised or recessed sills or dikes
- (3) Sumps and collection systems
- (4) Spill containment systems such as that described in A.11.5.3.2.4.1

[1:A.52.2.2.4.2]

N A.11.5.3.2.4.1 One method to determine compliance with the neutralization requirements of this subsection is found in Underwriters Laboratories Subject 2436, *Outline of Investigation for Spill Containment for Stationary Lead Acid Battery Systems*. Subject 2436 investigates the liquid tightness, level of electrolyte absorption, pH neutralization capability, and flame spread resistance of spill containment systems. [1:A.52.2.2.5.1]

N A.11.5.3.2.5 Information on battery room ventilation can be found in IEEE 1635/ASHRAE 21, *Guide to Battery Room Ventilation and Thermal Management*. [1:A.52.2.2.6]

N A.11.5.4.3 A stationary battery array is an arrangement of individual stationary storage batteries in close proximity to each other, mounted on storage racks or in modules, battery cabinets, or other enclosures. [1:A.52.3.2.3]

N A.11.5.4.5.2 A prepackaged stationary storage battery system is designed and investigated as a single unit, assembled in a factory, and shipped to the site. A pre-engineered stationary storage battery system is designed and investigated as a single unit, but is shipped in modular form for assembly at the site. [1:A.52.3.2.5.1]

N A.11.5.4.6.4 This section is intended to address unique situations where the installation of different types of batteries in the same room or cabinet could create a situation where there is unacceptable chemical, thermal, or other interaction between them, or where the surrounding environment is not within the battery manufacturers' specifications. The AHJ has the option to require a hazard mitigation analysis, conducted in accordance with 52.3.2.4 of NFPA 1, to identify hazards and potential solutions that will mitigate the hazards. [1:A.52.3.2.6.8]

A.12.1 A written emergency fire plan should be prepared and posted at each installation that assigns specific responsibilities

to designated personnel. *NFPA 1600* provides guidance on emergency planning that could be used in the creation of this fire plan. This plan should be coordinated with all responding emergency agencies. Personnel should receive continuing instructions in at least the following:

- (1) The method of turning off all electrical power to the following:
 - (a) The ITE under both normal and emergency conditions
 - (b) The air-conditioning systems serving the area
- (2) Alerting the fire department or fire brigade
- (3) Evacuation of personnel and designated assembly area
- (4) The operations of all fire-extinguishing and damage control equipment, including automatic detection equipment
- (5) The use of extinguishers through actual operation on a practice fire
- (6) Control of hazardous materials
- (7) Coordination with the fire department or other emergency responders

A.12.1.1.2 Fire service orientation and information might include the review of the ITE placement, depowering issues, and how to perform depowering. Additionally, it might be in the best interest of the facility manager to initiate the fire service orientation. Figure A.12.1.1.2 is an example of a pre-fire plan drawing.

A.12.2 A damage control plan should provide a means for at least the following:

- (1) Preventing or minimizing damage to electronic equipment
- (2) Preventing or minimizing damage to operations and other equipment

For example, whenever electronic equipment or any type of record is wet, smoke damaged, or otherwise affected by the results of a fire or other emergency, it is vital that immediate action be taken to clean and dry the electronic equipment. If water, smoke, or other contamination is permitted to remain in


the equipment longer than absolutely necessary, the damage can be grossly increased.

In addition, a means should be provided for preventing water damage to electronic equipment. The proper method of doing this will vary according to the individual equipment design. Consideration should be given to the provision of waterproof covers, which should be stored in easily accessible locations.

Δ A.12.3 Emergency procedures for the continued operation of an ITE system should include, but not be limited to, the following:

- (1) A program to protect records in accordance with their importance as set forth by Chapter 10
- (2) An analysis of the workload and its effect on continuity of operations
- (3) A written set of requirements for the backup site, including the following:
 - (a) Backup files and equipment required
 - (b) Configuration of mainframe computer and peripheral units
 - (c) Alternative locations for backup processing
 - (d) Availability of backup system
 - (e) Telecommunications required at backup site
 - (f) Files, input work, special forms, and so forth, needed
 - (g) Personnel staffing and transportation
 - (h) Agreements and procedures for the emergency use of ITE at a contingency site

N A.13.11 Since 2014, *NFPA 70* has addressed MDCs as special equipment in its Article 646, Modular Data Centers. Therefore, electrical requirements for MDCs, as an alternative, can be evaluated in accordance to *NFPA 70*, Article 646 as an alternative to the extracted material from *NFPA 70*, Article 645 in Chapter 11, Utilities. UL has a published UL 2755, *Outline of Investigation for Modular Data Centers*, which has been referenced in 646.4 of *NFPA 70* since the 2014 edition.

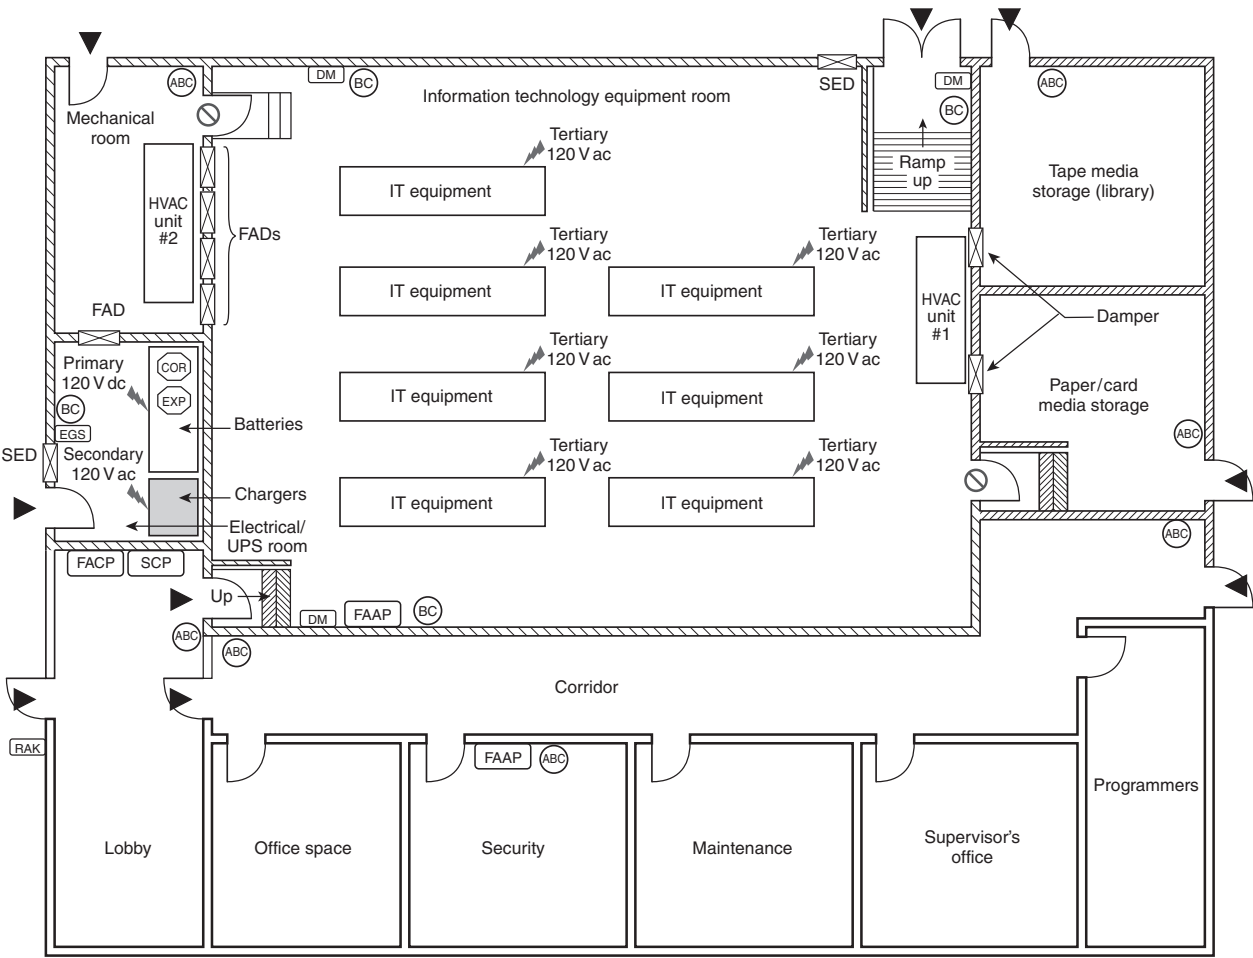

Note: Drawing is intended to convey some of the items that should be documented as part of the pre-fire plan. It is not intended to demonstrate good design practice nor compliance with any code or standard.

LEGEND

Symbol	Description	Symbol	Description
FACP	Fire alarm control panel	EGS	Emergency generator shutoff switch
FAAP	Fire alarm annunciator panel	ABC	Type ABC portable fire extinguisher
SCP	Smoke control panel	BC	Type BC portable fire extinguisher
▶	Fire fighter access	⊠	Damper
⊘	No fire fighter access—contamination hazard	⊠ SED	Smoke exhaust damper
⚡	Power supply and voltage	⊠ FAD	Fresh air damper
COR	Corrosive material	RAK	Rapid access keyboard
EXP	Explosive gas potential	▬	1-hour rating
■	Equipment containing PCBs	▬	2-hour rating
DM	IT and HVAC disconnecting means		

▲ FIGURE A.12.1.1.2 Pre-Fire Plan Drawing.

Annex B What to Do in the First 24 Hours for Damaged Electronic Equipment and Magnetic Media

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 The following material is extracted from the BMS CAT publication “Electronics & Magnetic Media Recovery.”

B.2 This plan attempts to detail the necessary recovery steps to be taken after a disaster has occurred to electronic equipment. The plan considers fire, heat, smoke, and water damage and is designed to limit and mitigate potential losses. The equipment under discussion includes office computers, word processors, telephone switching equipment, test equipment, audio-video equipment, and other electrical and electronic apparatus.

WARNING: It is most important that power be disconnected from all wet and smoke contaminated electronic equipment immediately. Not only is there a continuing danger from electrical shorts to the equipment, but voltage potential within the circuitry tends to plate contaminants onto printed circuit boards and backplanes.

B.3 Smoke Damage. Primary damage to electronic equipment is caused by smoke that contains corrosive chloride and sulfur combustion by-products. Smoke exposure during the fire for a relatively short period of time does little immediate damage. However, the particulate residue left after the smoke has dissipated contains the active by-product that will corrode metal contact surfaces in the presence of moisture and oxygen.

The ultimate objective in restoration is the removal of the contaminant. Since all of the equipment cannot be cleaned simultaneously, it is most important that immediate steps be taken to arrest the corrosion process.

- (1) Move the exposed equipment into an air-conditioned and humidity controlled environment as soon as possible (40–50 percent relative humidity will generally prevent an acceleration of corrosive activity).
- (2) If moving the equipment is not possible, make sure the equipment area is sealed off from outside elements. (Caution: do not wrap the individual pieces of equipment in any material that tends to trap moisture inside the chassis.)
- (3) Spray connectors, backplanes and printed circuit board surfaces with Freon or Freon-alcohol solvents for preliminary cleanup.
- (4) Follow up with any corrosion inhibiting aerosol spray to stabilize metal contact surfaces. This will leave a thin but easily removable coating helping to prevent oxygen and moisture from activating the corrosion process.

Once the corrosion process is stabilized, an analysis can be made of the contaminants, and appropriate decontamination processes can be applied.

B.4 Water Damage. It is a popular misconception that electronic equipment exposed to water and moisture is permanently damaged. Water that is sprayed, splashed, or dripped onto electronic equipment can be easily removed. Even equipment that has been totally submerged can be restored. However, in every case of water damage, immediate countermeasures are imperative. It is most important to turn off all electrical power to the equipment; i.e., **DO NOT ENERGIZE ANY WET EQUIPMENT.**

- (1) Open cabinet doors, remove side panels and covers, and pull out chassis drawers to allow water to run out of equipment.
- (2) Set up fans to move room temperature air through the equipment for general drying. Move portable equipment to dry air conditioned areas.
- (3) Use compressed air at no higher than 50 psi to blow out trapped water.
- (4) Use hand-held dryers on lowest setting to dry connectors, backplane wirewraps, and printed circuit cards. (Caution: Keep the dryer well away from components and wires. Overheating of electronic parts can cause permanent damage.)
- (5) Use cotton-tipped swabs for hard-to-reach places. Lightly dab the surfaces to remove residual moisture. Do not use cotton tipped swabs on wirewrap terminals.
- (6) Water displacement aerosol sprays containing Freon-alcohol mixtures are effective in first step drying of critical components.
- (7) Follow up with professional restoration as soon as possible.

B.5 Tape/Disk Drive. The most important asset to be preserved following the loss is the corporate media (company database).

Severe damage to disk read/write heads and tape transport mechanisms is probable if an attempt is made to operate with media that is not clean. A “head-crash” caused by particulate on the surface of a disk will not only damage the drive but result in a loss of data. Dirty tapes will stick and break causing loss of data. Emergency one-time cleaning of contaminated tapes and disks, for data recovery, is possible. The damaged media is then discarded after data recovery.

First step emergency procedures are:

- (1) Place all contaminated magnetic media in air conditioned area to remove water and stabilize media surfaces.
- (2) Remove media from wet and contaminated containers where possible. Identify all media as to type, application, and location.
- (3) Wipe exterior surfaces with alcohol or Freon-alcohol solutions to remove contamination.
- (4) Data recovery from contaminated floppy disks, tapes, hard disks, and all associated drive and read/record equipment.

Annex C Risk Considerations, Business Interruption, and Temperature Considerations

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

C.1 Risk Considerations.

C.1.1 ITE is a vital and commonplace tool for business, industry, government, and research groups. The use of such equipment is a direct result of the increased complexity of modern business, industrial, governmental, and research needs. Particularly pertinent are the increasing number of variables that must be taken into consideration in everyday decisions — overlooking any one item can spell the difference between profit and loss, success and failure, and life and death. To keep track of all these variables, ITE offers practical answers.

C.1.2 ITE has become the accepted tool to research, store, and exchange information, to process large amounts of statistical, problematical, or experimental information, and to print out or display information in very short periods of time. Reliance is placed on the equipment to perform the repetitive, the experimental, and, in some cases, even the whole programming operation for business, industry, government, and research groups.

C.1.3 Risk considerations include the selection of proper equipment, preparation of areas to receive the equipment, requirements for utilities, orientation and training of personnel to operate the equipment, as well as consideration for expansion of the initial facility. One other factor should be included in this vital study, namely, protection against fires of either accidental or deliberate origin, such as sabotage and incendiary.

C.1.4 ITE and materials for data recording and storage can incur damage where exposed to sustained elevated ambient temperatures. The degree of such damage will vary depending upon the exposure, equipment design, and composition of materials for data recording and storage.

C.2 Business Interruption. Business interruption is the effect on business operations from the time that equipment was initially lost or damaged until it has been restored to the former level of operation.

C.3 Temperature Considerations. The following are guidelines concerning sustained high ambient temperatures.

- (1) Damage to functioning ITE can begin at a sustained ambient temperature of 79.4°C (175°F), with the degree of damage increasing with further elevations of the ambient temperature and exposure time.
- (2) Damage to magnetic tapes, flexible discs, and similar media can begin at sustained ambient temperatures above 37.8°C (100°F). Damages occurring between 37.8°C (100°F) and 48.9°C (120°F) can generally be reconditioned successfully, whereas the chance of successful reconditioning lessens rapidly with elevations of sustained ambient temperatures above 48.9°C (120°F).
- (3) Damage to disc media can begin at sustained ambient temperatures above 65.6°C (150°F), with the degree of damage increasing rapidly with further elevations of sustained ambient temperatures.
- (4) Damage to paper products, including punched cards, can begin at a sustained ambient temperature of 176.7°C (350°F). Paper products that have not become brittle will generally be salvageable.
- (5) Damage to microfilm can begin at a sustained ambient temperature of 107.2°C (225°F) in the presence of steam or at 260°C (500°F) in the absence of steam.

Annex D General Guidance for Gaseous Agent Systems in Information Technology Equipment Spaces

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

D.1 Gaseous Agents. The use of gaseous agents provides the potential for automatic fire suppression in the incipient fire stage so that the information technology system can continue to perform its mission with little or no interruption. Where coupled with a well-designed early warning detection system, the gas can be automatically released in the early stages of a

fire scenario and, being three dimensional, it will penetrate all portions of the space protected, including internal volumes of key components of the system when they are ventilated from the room. Thus an operator does not have to be present or, if present, does not have to determine if and where the fire is occurring and how to deal with it.

Gaseous agents fall into the following two general categories: inert gases and chemical agents.

D.1.1 Inert Gases. Inert gases include gases that extinguish fires by reducing the oxygen level to a point where it will not support combustion. The inert gases found in NFPA 2001 generally consist of a single gas (nitrogen or argon), blends of gases (nitrogen and argon), or blends with carbon dioxide as a secondary component. See NFPA 2001 for specific agent and system design guidance.

Carbon dioxide also falls into the category of inert gases; however, at the concentration normally used for total flooding of protected spaces, the resulting environment is hazardous to personnel. The use of carbon dioxide systems is contained in NFPA 12.

D.1.2 Chemical Agents. Chemical agents include gases that have been found to be effective in suppressing fires by chemical means or, in some cases, by a combination of chemical reaction and cooling. See NFPA 2001 for specific agent and system design guidance.

While these systems have proven to be effective and relatively trouble-free when installed as approved, it is prudent to consider the following factors in integrating such systems into a facility:

- (1) Effectiveness of agent on types of fires expected
- (2) Energized versus de-energized equipment
- (3) Possible effect of "neat" agent discharges on the equipment and/or space that is being protected
- (4) Dealing with products of combustion and/or products of decomposition created in a fire and fire suppression
- (5) Potential hazard to personnel
- (6) Long-term availability of agent and/or system components
- (7) Compatibility of system operation with facility operation
- (8) Selection of detection system

D.2 Effectiveness of Fire-Suppressing Agent. The effectiveness can vary depending on combustibles present and certain characteristics of the hazard protected. Systems are tested and listed or approved so they will afford protection of most hazards when the system is installed in accordance with the system manual. An owner should become familiar with the system design parameters as given in the manual. Certain combustibles can need higher concentrations than the standard combustibles used in the approval process. Refer to information giving recommended concentrations for specific materials.

Total flooding agents are effective when the gas envelops the protected equipment at the proper concentration, a minimum concentration is held until the ignition source is removed, and any smoldering fire that remains after flame extinguishment is controlled. This statement generally means that the enclosure to be flooded needs to be enclosed as much as possible to retain the gas discharged. Integrity of the space protected can need verification and means taken to close off openings to ensure an adequate gas concentration holding time.