



# **UL 4248-12**

## **STANDARD FOR SAFETY**

**Fuseholders – Part 12: Class R**

ULNORM.COM : Click to view the full PDF of UL 4248-12 2023

ULNORM.COM : Click to view the full PDF of UL 4248-12 2023

UL Standard for Safety for Fuseholders – Part 12: Class R, UL 4248-12

Second Edition, Dated January 19, 2018

### **Summary of Topics**

***This revision of ANSI/UL 4248-12 dated February 6, 2023 is being issued to update the title page to reflect the most recent designation as a Reaffirmed American National Standard (ANS). No technical changes have been made.***

***As noted in the Commitment for Amendments statement located on the back side of the title page, UL, CSA, and ANCE are committed to updating this harmonized standard jointly. However, the revision pages dated February 6, 2023 will not be jointly issued by UL, CSA, and ANCE as these revision pages only address UL ANSI approval dates.***

Text that has been changed in any manner or impacted by UL's electronic publishing system is marked with a vertical line in the margin.

The requirements are substantially in accordance with Proposal(s) on this subject dated December 16, 2022.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-12 2023



Association of Standardization and Certification  
NMX-J-009-4248-12-ANCE  
Second Edition



CSA Group  
CAN/CSA-C22.2 No. 4248.12-18  
Second Edition



Underwriters Laboratories Inc.  
UL 4248-12  
Second Edition

## Fuseholders – Part 12: Class R

January 19, 2018

(Title Page Reprinted: February 6, 2023)



ANSI/UL 4248-12-2018 (R2023)



## **Commitment for Amendments**

This standard is issued jointly by the Association of Standardization and Certification (ANCE), the Canadian Standards Association (operating as "CSA Group"), and Underwriters Laboratories Inc. (UL). Comments or proposals for revisions on any part of the standard may be submitted to ANCE, CSA Group, or UL at anytime. Revisions to this standard will be made only after processing according to the standards development procedures of ANCE, CSA Group, and UL. CSA Group and UL will issue revisions to this standard by means of a new edition or revised or additional pages bearing their date of issue. ANCE will incorporate the same revisions into a new edition of the standard bearing the same date of issue as the CSA Group and UL pages.

---

## **Copyright © 2018 ANCE**

Rights reserved in favor of ANCE.

---

**ISBN 978-1-4883-1159-8 © 2018 Canadian Standards Association**

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

This Standard is subject to review within five years from the date of publication, and suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to [inquiries@csagroup.org](mailto:inquiries@csagroup.org) and include "Proposal for change" in the subject line: Standard designation (number); relevant clause, table, and/or figure number; wording of the proposed change; and rationale for the change.

To purchase CSA Group Standards and related publications, visit CSA Group's Online Store at [www.csagroup.org/store/](http://www.csagroup.org/store/) or call toll-free 1-800-463-6727 or 416-747-4044.

---

## **Copyright © 2023 ULSE INC.**

Our Standards for Safety are copyrighted by ULSE Inc. Neither a printed nor electronic copy of a Standard should be altered in any way. All of our Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of ULSE Inc.

This ANSI/UL Standard for Safety consists of the Second Edition including revisions through February 6, 2023.

The most recent designation of ANSI/UL 4248-12 as a Reaffirmed American National Standard (ANS) occurred on February 6, 2023. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, Title Page (front and back), or the Preface.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

To purchase UL Standards, visit UL's Standards Sales Site at <http://www.shopulstandards.com/HowToOrder.aspx> or call toll-free 1-888-853-3503.

---

## CONTENTS

PREFACE .....	5
1 General .....	7
1.1 Scope.....	7
4 Classification .....	7
5 Characteristics .....	7
5.1 Summary of characteristics .....	7
6 Marking .....	7
6.1 Marking of fuseholder .....	7
7 Construction .....	7
7.6 Contacts of a cartridge fuseholder.....	7
8 Tests .....	10
8.1 General .....	10
8.4 Verification of temperature rise .....	10
8.6A Verification of effectiveness of rejection member .....	12
8.6A.2 Acceptability of test results .....	12

ULNORM.COM : Click to view the full PDF of UL 4248-12-18-2023

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-12 2023

## PREFACE

This is the harmonized ANCE, CSA Group, and UL standard for Fuseholders - Part 12: Class R. It is the second edition of NMX-J-009-4248-12-ANCE, the second edition of CAN/CSA-C22.2 No. 4248-12, and the second edition of UL 4248-12. This edition of CAN/CSA-C22.2 No. 4248-12 supersedes the previous edition published on February 28, 2007. This edition of UL 4248-12 supersedes the previous edition published on February 28, 2007.

This harmonized standard was prepared by the Association of Standardization and Certification, (ANCE), CSA Group and Underwriters Laboratories Inc. (UL). The efforts and support of the Technical Harmonization Subcommittee, CANENA Technical Harmonization Subcommittee 32B – Low Voltage Fuses on the Harmonization of Electrotechnical Standards of the Nations of the Americas (CANENA), are gratefully acknowledged. are gratefully appreciated.

This standard is considered suitable for use for conformity assessment within the stated scope of the standard.

This standard was reviewed by the CSA Subcommittee on Fuses and Fuseholders, under the jurisdiction of the CSA Technical Committee on Industrial Products and the CSA Strategic Steering Committee on Requirements for Electrical Safety, and has been formally approved by the CSA Technical Committee. This standard has been developed in compliance with Standards Council of Canada requirements for National Standards of Canada. It has been published as a National Standard of Canada by CSA Group.

### Application of Standard

Where reference is made to a specific number of samples to be tested, the specified number is to be considered a minimum quantity.

**Note:** *Although the intended primary application of this standard is stated in its scope, it is important to note that it remains the responsibility of the users of the standard to judge its suitability for their particular purpose.*

### Level of Harmonization

This standard is published as an identical standard for ANCE, CSA Group, and UL.

An identical standard is a standard that is exactly the same in technical content except for national differences resulting from conflicts in codes and governmental regulations. Presentation is word for word except for editorial changes.

### Interpretations

The interpretation by the standards development organization of an identical or equivalent standard is based on the literal text to determine compliance with the standard in accordance with the procedural rules of the standards development organization. If more than one interpretation of the literal text has been identified, a revision is to be proposed as soon as possible to each of the standards development organizations to more accurately reflect the intent.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 4248-12 2023

# Fuseholders – Part 12: Class R

## 1 General

*This Part is intended to be read together with the Standard for Fuseholders – Part 1: General Requirements, hereafter referred to as Part 1. The numbering of the Clauses in this Part corresponds to like numbered Clauses in Part 1. The requirements of Part 1 apply unless modified by this Part. For Clauses not shown below, refer to the Standard for Fuseholders – Part 1: General Requirements, NMX-J-009-4248-ANCE ♦ CSA C22.2 No. 4248.1 ♦ UL 4248-1.*

### 1.1 Scope

1.1.2 These requirements cover fuseholders intended for use with Class R Fuses as described in NMX-J-009-4248/12-2000-ANCE, CSA C22.2 No. 248.12, UL 248-12, Low-Voltage Fuses – Part 12: Class R Fuses.

## 4 Classification

4.1 Class R fuseholders have a short-circuit withstand rating of 200,000 A. Class R fuseholders are rated 250 V or 600 V, and are divided into six body sizes in each voltage rating corresponding to the Class R fuse body sizes.

## 5 Characteristics

### 5.1 Summary of characteristics

#### 5.1.3 Voltage and current rating

5.1.3.1 Class R fuseholders shall be rated 250 V or 600 V.

5.1.3.2 Class R fuseholders shall be rated 30, 60, 100, 200, 400, or 600 A.

#### 5.1.4 Withstand rating

5.1.4.1 Class R fuseholders shall have a short-circuit withstand rating of 200,000 A.

## 6 Marking

### 6.1 Marking of fuseholder

6.1.1.1 In addition to the requirements of Part 1, the fuseholder shall be marked "Use Class R Fuses".


## 7 Construction

### 7.6 Contacts of a cartridge fuseholder

7.6.1 The dimensions of a Class R fuseholder shall be as specified in [Figure 7.6A](#) or [Figure 7.6B](#), whichever is applicable. Class R fuseholders shall be provided with a rejection member to prevent the installation of fuses of other classes.

Figure 7.6A

## Class R fuseholder, Ferrule contact type with rejection member

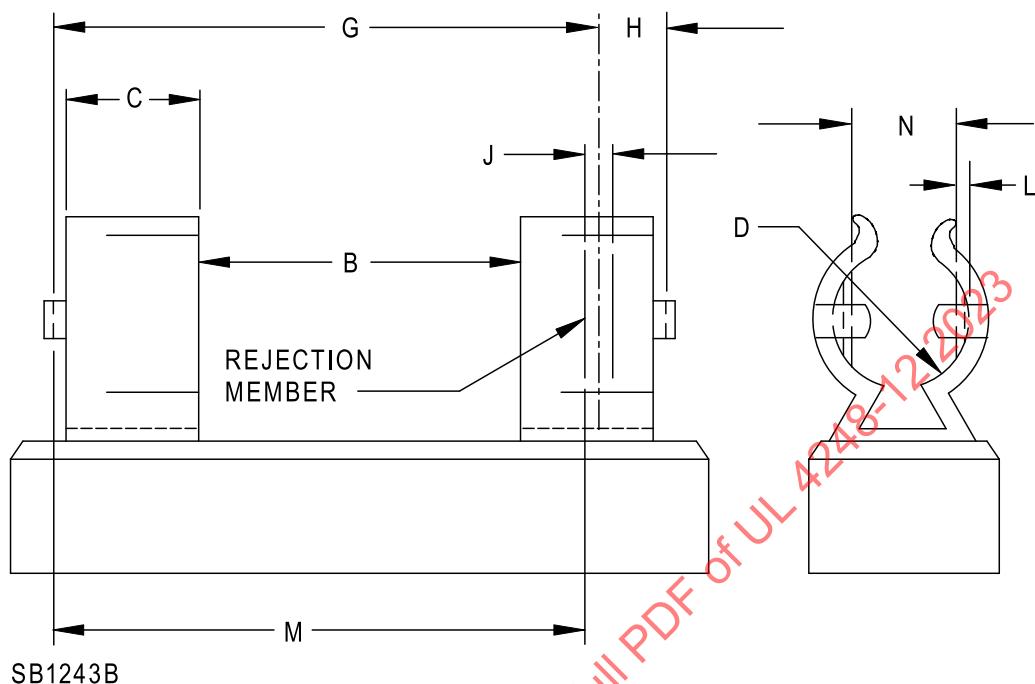

Tabs shown are a typical end-stop configuration.

Class of fuse	Potential rating of fuse, volts	Current rating of fuse, amperes	Dimensions, mm (in)			
			B	C	D	E
R	250	30	25.4 (1.0)	12.7 (0.5)	14.27 (0.562)	—
		60	44.45 (0.750)	15.88 (0.625)	20.62 (0.812)	—
		100	101.6 (4.0)	22.22 (0.437)	—	3.18 (0.125)
		200	114.3 (4.5)	31.75 (1.250)	—	4.75 (0.187)
		400	127.0 (5.0)	44.44 (1.750)	—	6.35 (0.250)
		600	152.4 (6.0)	53.97 (2.062)	—	6.35 (0.250)
	600	30	101.6 (4.0)	12.7 (0.5)	20.62 (0.812)	—
		60	107.95 (0.250)	15.88 (0.625)	26.97 (1.062)	—
		100	152.4 (6.0)	22.22 (0.875)	—	3.18 (0.125)
		200	177.8 (7.0)	31.75 (1.250)	—	4.75 (0.187)
		400	203.2 (8.0)	44.44 (1.750)	—	6.35 (0.250)
		600	228.6 (9.0)	53.97 (2.062)	—	6.35 (0.250)

NOTE – See [Figure 7.6B](#) for dimensions G, H, J, K, L, M, N, and I.


<sup>a</sup> Tolerances for the B dimensions are:

60 A or less: plus 0.79 mm (0.031 in) and minus 1.57 mm (0.062 in);

100 and 200 amperes: plus 1.57 mm (0.062 in) and minus 0.79 mm (0.031 in);

400 and 600 amperes: plus 2.36 mm (0.093 in).

**Figure 7.6B**  
**Class R fuseholder, Blade type with rejection member**

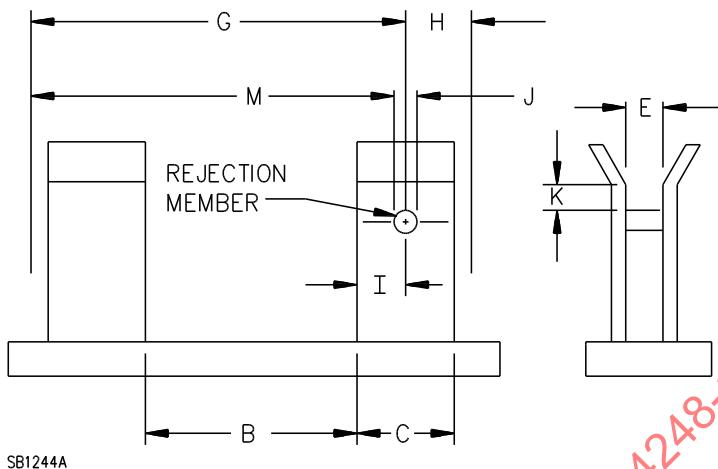

**Figure 7.6B continued**

Class of fuse	Potential rating of fuse, volts	Current rating of fuse, amperes	Dimensions, mm (in)							
			G	H	J	K <sup>a</sup>	L <sup>b</sup>	M	N <sup>c</sup>	I
			Minimum distance from center of rejection member to end stop	Maximum distance from center of rejection member to end stop	Maximum width of rejection member	Contact above rejection member	Extension of rejection member from inside surface of clip	Maximum distance frm end of rejection member to end stop	Rejection member opening	Minimum / maximum distance to center rejection member
R	250	30	48.1 (1.892)	4.19 (0.165)	1.65 (0.065)	—	2.03 (0.080)	48.41 (1.906)	10.29 (0.405)	—
		60	72.6 (2.860)	4.98 (0.196)	2.06 (0.081)	—	2.03 (0.080)	73.81 (2.906)	16.64 (0.655)	—
		100	—	—	6.48 (0.255)	7.14 (0.281)	—	—	—	10.92/12.29 (0.430/0.484)
		200	—	—	6.48 (0.255)	11.91 (0.469)	—	—	—	15.7/17.07 (0.6108/0.672)
		400	—	—	9.65 (0.380)	16.66 (0.655)	—	—	—	22.07/23.44 (0.869/0.923)
		600	—	—	12.83 (0.505)	19.84 (0.781)	—	—	—	26.82/28.19 (1.056/1.110)
	600	30	123 (4.860)	4.98 (0.196)	2.06 (0.081)	—	2.032 (0.080)	124.61 (4.906)	16.64 (0.655)	—
		60	134.6 (5.298)	6.6 (0.260)	2.06 (0.081)	—	2.03 (0.080)	137.31 (5.406)	22.99 (0.905)	—
		100	—	—	6.48 (0.255)	7.14 (0.281)	—	—	—	10.92/12.29 (0.430/0.484)
		200	—	—	6.48 (0.255)	11.91 (0.469)	—	—	—	15.7/17.07 (0.618/0.672)
		400	—	—	9.65	16.66	—	—	—	22.07/23.44

**Figure 7.6B continued Continued on Next Page**